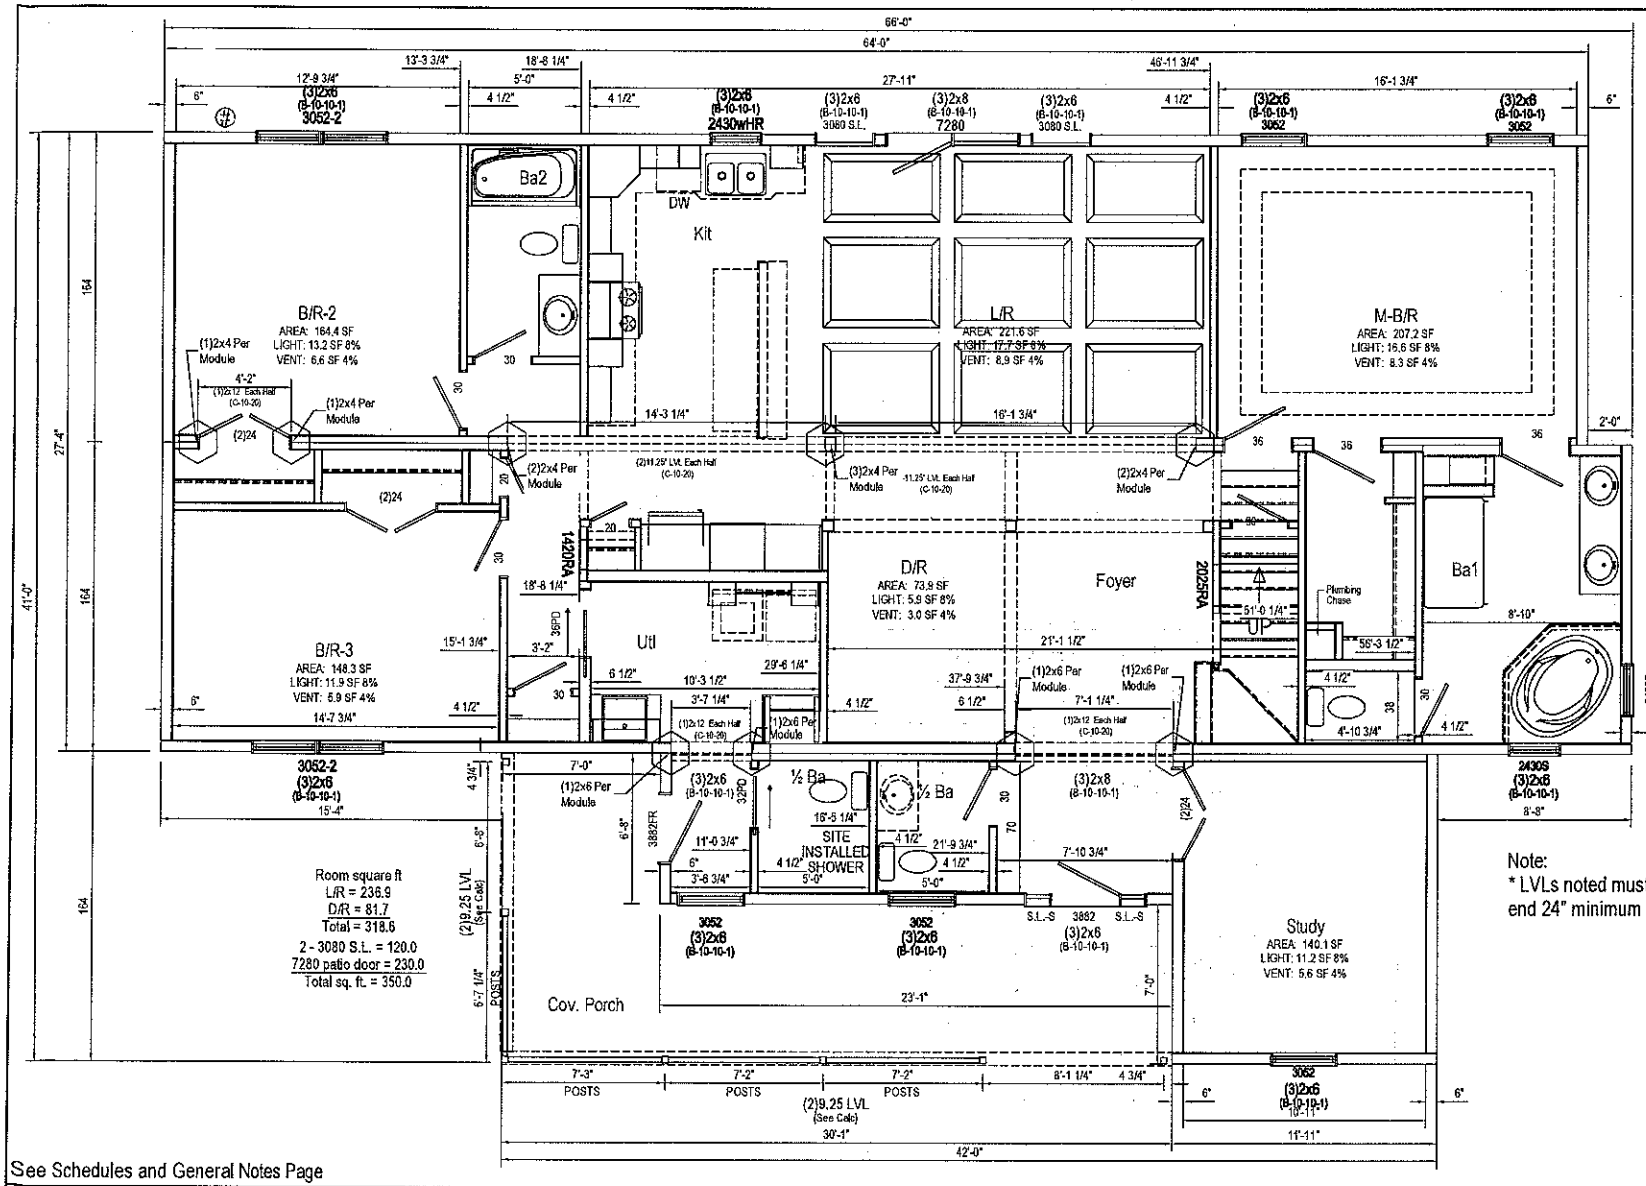


Acknowledgement Of Plans Submittal ONLY!
Date 4/5/16
Date 4-5-16

Notes:
1. Exterior opening headers and jack studs are SPF #2 unless otherwise noted.
2. Sidewall headers may use alternate construction per section B-10 of Systems Manual.
3. LVL's where specified to be minimum of 1 1/2" wide, M.O.E. = 2.0 and fb = 2900 PSI.

Note:
* LVLs noted must extend past column on at least one end 24" minimum and be overlayed with OSB sheathing.

APPROVED BY
NTA INC. 11/13/2015
Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.
Luke Lehman

See Schedules and General Notes Page

Builder: R-Anell Housing Group, LLC - Subsidiary of The Commodore Corp.
Title: Floor Plan

Callout	Revisions			Scale	Date	Cust: Hildergrand	Model/Eng. No.:
4166/42	Date	Number		3/16" = 1'-0"	10/26/2015	Dlr: Synergy	RAE110-A4
	11/11/15	300		Drawn By: NE	Reference: EV850	S/N: 40358	Pg: FP