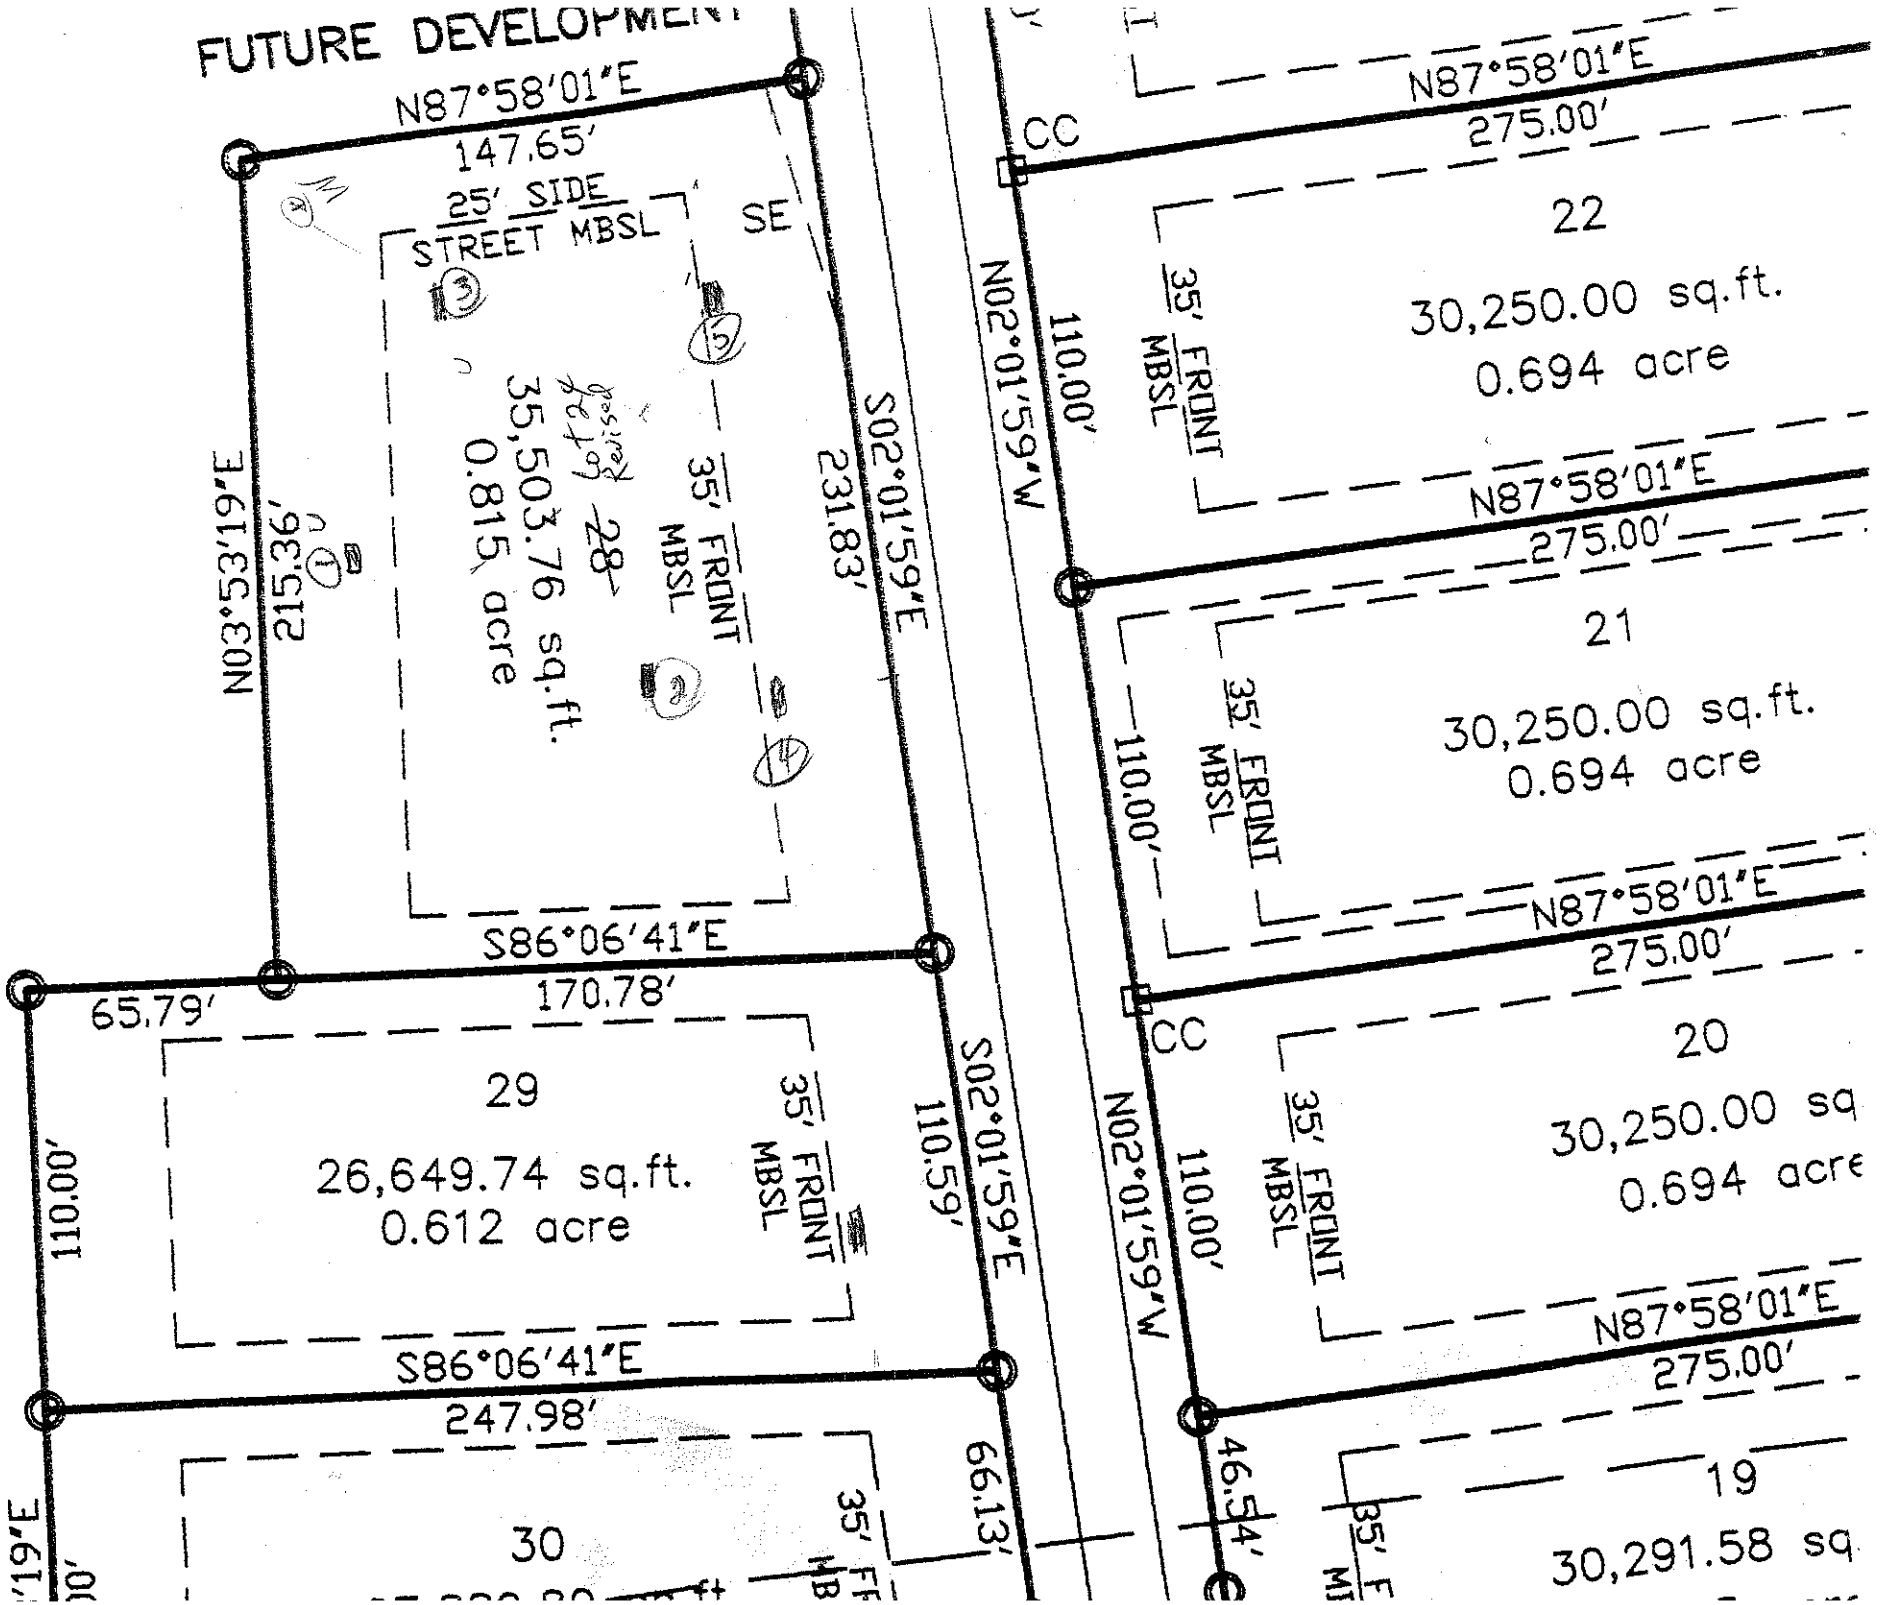

FUTURE DEVELOPMENT
N87°58'01"E
147.65'
25' SIDE STREET MBSL
SE
35' FRONT MBSL
35,503.76 sq.ft.
0.815 acre
Lot 28 Revised
N03°53'19"E
215.36'
S02°01'59"E
231.83'
S86°06'41"E
65.79'
170.78'
29
26,649.74 sq.ft.
0.612 acre
110.00'
110.59'
S86°06'41"E
247.98'
66.13'
30
N02°01'59"W
110.00'
CC
N87°58'01"E
275.00'
22
30,250.00 sq.ft.
0.694 acre
21
30,250.00 sq.ft.
0.694 acre
20
30,250.00 sq
0.694 acre
46.54'
19
30,291.58 sq

DEPARTMENT OF ENVIRONMENT AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: Roger Driscoll APPLICATION DATE _____
ADDRESS: _____ DATE EVALUATED: 5-29-03
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____ PROPERTY SIZE: _____
LOCATION OF SITE: Lot 28 phs 2 Shumille Est PROPERTY RECORDED: _____
WATER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

Now Lot 24

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-12	gr lsm scl	frss sp					(4)
		12-40	wk f-m sbk RC/cl	fj-fr sss p (high dist)					
		40-%	(BC) wk sbk yel	fi-fr sss p	Common chr 2 12-40"				
			appears bedrock deep						
2		0-6	gr lsm scl	fr ss sp					.3
		6-18	ABK RC	fr SO ss p					
		18-2	int sbk cl	fr ss sp					
3		0-8	gr lsm scl	fr ss sp					(4)
		8-54	wk M ABK RC	fr SO p	common y brn mottles, few-common chr 2 12"				
4	6-10%	0-6	compacted scl/c						.25-.3
		6-22	wk f-m sbk RC/cl	fr ss-ss p					
		22-50	wk f-m sbk LSAP	fr ss p					

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	PS	PS
System Type(s)	25% Red	25% Red
Site LTAR	.25	.25

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): S
EVALUATED BY: DKH
OTHER(S) PRESENT: _____

COMMENTS: _____

#5 0-5 gr lsm scl fr ss sp
5-30 lt f-m sbk RC/cl fr ss-ss p common y brn mottles .25
30-51 wk f-m sbk RC/cl fr ss sp SAP few-common chr 2