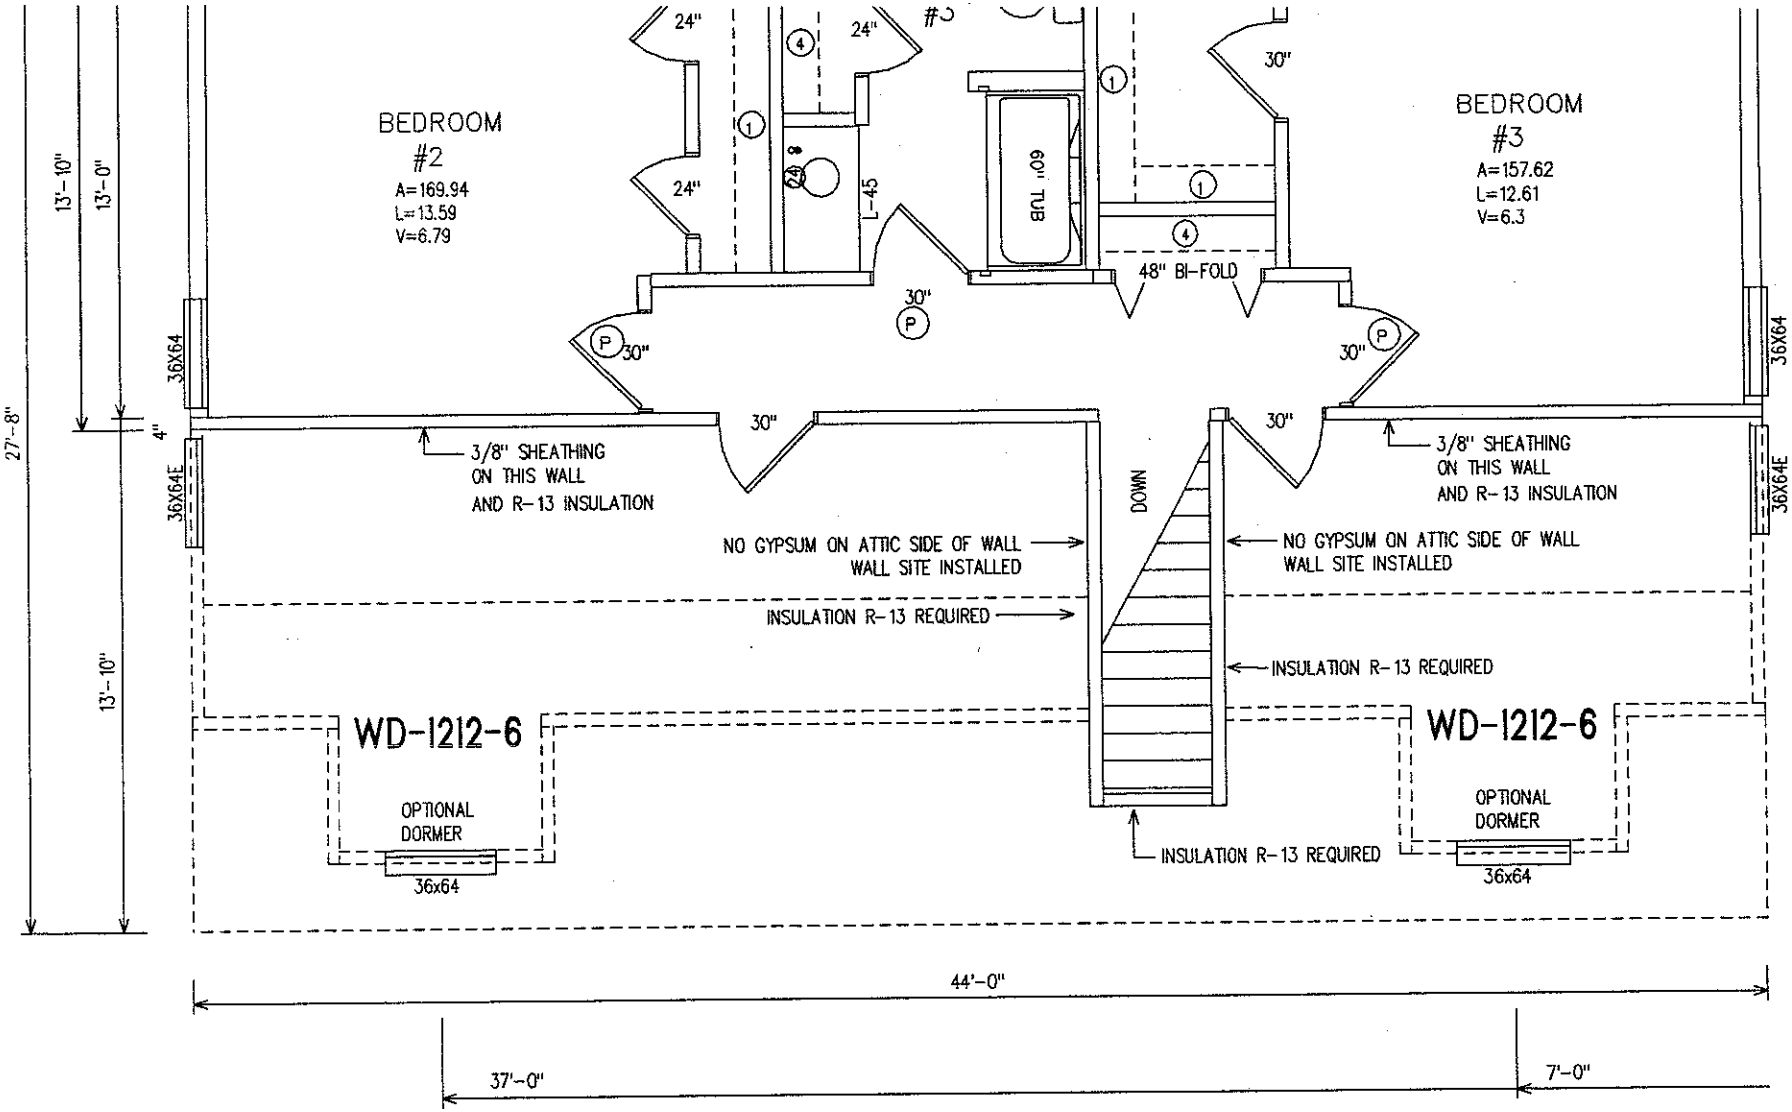


APPROVED BY
NTA INC. 01/28/03
Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.
Michael Faller

8'-0" FLAT THRU-OUT STD.


R-ANELL HOUSING GROUP, LLC HWY. 16 DENVER, N.C. 28037	TITLE: FLOOR PLAN 2ND FLOOR	DATE: 12/13/2002	DRAWN BY: RTR	JOB NUMBER:	
	DESCRIPTION: 661	SCALE: 3/16"=1'-0"	FILE NUMBER: 0000	DRAWING NUMBER:	

www.edocs.com/novo/tra/16332/index.cgi?shortscale=1#height:control:scroll:viewpage=1

Acknowledgement Of Plans Submitted

W Sparks R.S. Date 10/3/05

James Pretty Date 10/3/05

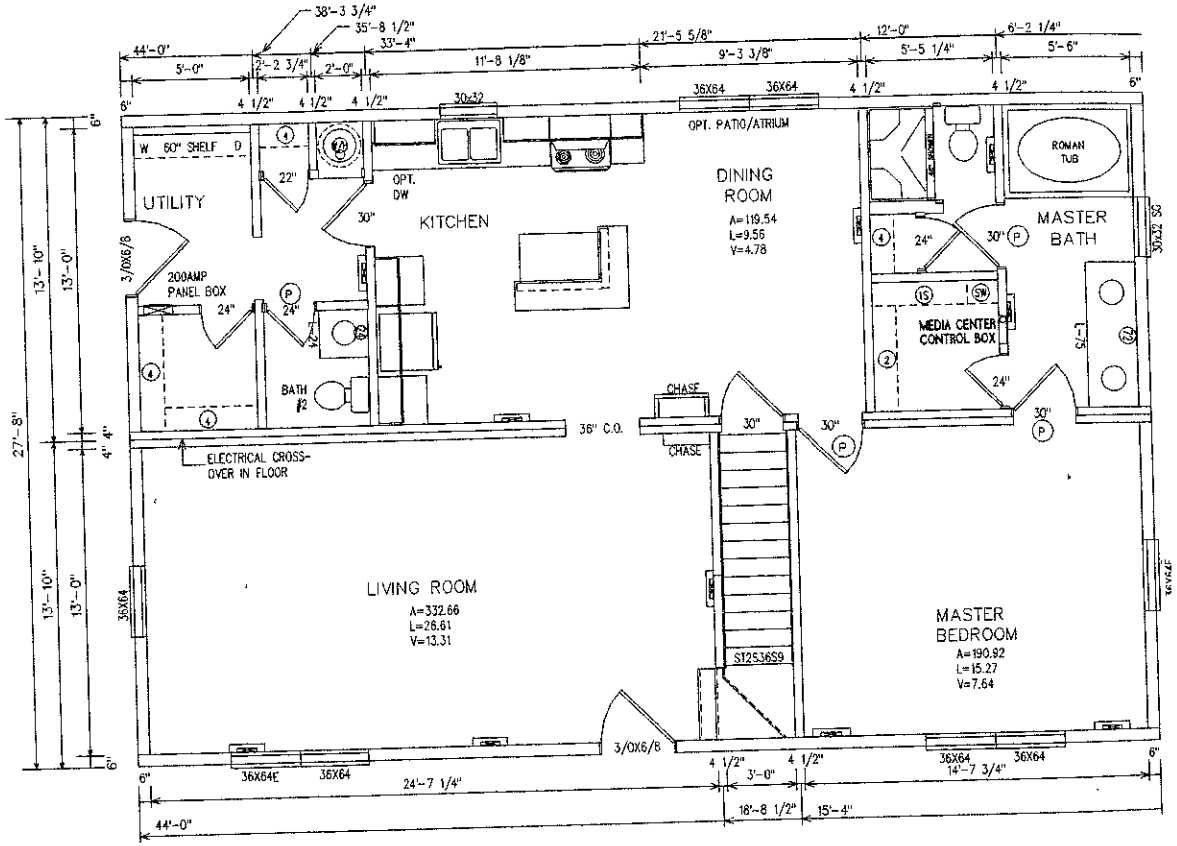

EGRESS NOTE :

EGRESS WINDOWS MUST HAVE A MINIMUM NET CLEAR OPENING OF 5.7 SQ. FT. (5.0 SQ. FT. AT GRADE LEVEL). THE MINIMUM CLEAR WIDTH SHALL BE 20 INCHES, THE MINIMUM CLEAR HEIGHT SHALL BE 24 INCHES. THE SILL HEIGHT SHALL NOT EXCEED 44 INCHES ABOVE THE FLOOR. ALL MUST BE OPERABLE FROM THE INSIDE WITHOUT THE USE OF SEPERATE TOOLS.

FLAMESPREAD NOTE :

ALL WALL AND CEILING FINISHES MUST HAVE A FLAMESPREAD CLASSIFICATION OF LESS THAN 200. THE SMOKE DENSITY DEVELOPMENT RATING SHALL NOT BE GREATER THAN 450. ALL SMOKE DETECTORS ARE PROVIDED WITH A BATTERY BACKUP.

(15) =SHELF & ROD W/SHOE RACK UNDERNEATH			
(1) =1 SHELF	(2) =2 SHELVES		
(4) =4 SHELVES	(SW) =SWEATER SHELVES		
⊕ = DUCT CONNECTOR			
(6) =20"x25"RAG/DOOR	(7) =20"X25"RAG/WALL		
(8) =2"X10" OVER DOOR	(24) =24X36 MIRROR		
	(72) =72X36 MIRROR		

FLOOR PLAN LEGEND

E EGRESS WINDOW	(T) THERMOSTAT		
ELECTRICAL PANEL	(S) SMOKE DETECTOR		
(A) 22"x 30" ATTIC ACCESS	(P) PRIVACY LOCK		
R STEREO	SG SAFTEY GLAZED		

STANDARD
TOTAL GLASS R.O.= 194.64 S.F.

R-ANELL HOUSING GROUP, LLC
HWY. 16 DENVER, N.C. 28037

TITLE:	FLOOR PLAN FIRST PLAN
DESCRIPTION:	661
DATE:	12/13/2002
SCALE:	3/16"=1'-0"
DRAWN BY:	RTR
FILE NUMBER:	0000

9'-0" FLAT THRU