12598

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR T+T CO DATE 5-6-91 PERMIT NO. 5K 6 A23

PHONE: Business ______ Home ______

LOCATION 70 E TR Bethesda Rd

S. R. No. ______

SUBDIVISION NAME Forest Acres LOT NO. 96 SECTION OR BLOCK NO. III

House ( ) Mobile Home (✓) Business ( ) Other ______

No. Bedrooms 2 No. Bathrooms 2

Garbage Disposal Unit Yes ( ) No (✓)

Auto. Dishwasher Yes ( ) No (✓)

Auto. Wash. Machine Yes (✓) No ( )

Site Suitable Yes (✓) No ( )

Lot Area 1/2 acre

Character & Porosity of Soil Clayey


Percolation Rate .4

Topography 2 to 6 %

Depth to Water Table 10'+

Rock or other impervious formations None

______ Basement with Plumbing ______ Basement without Plumbing ______ No Basement

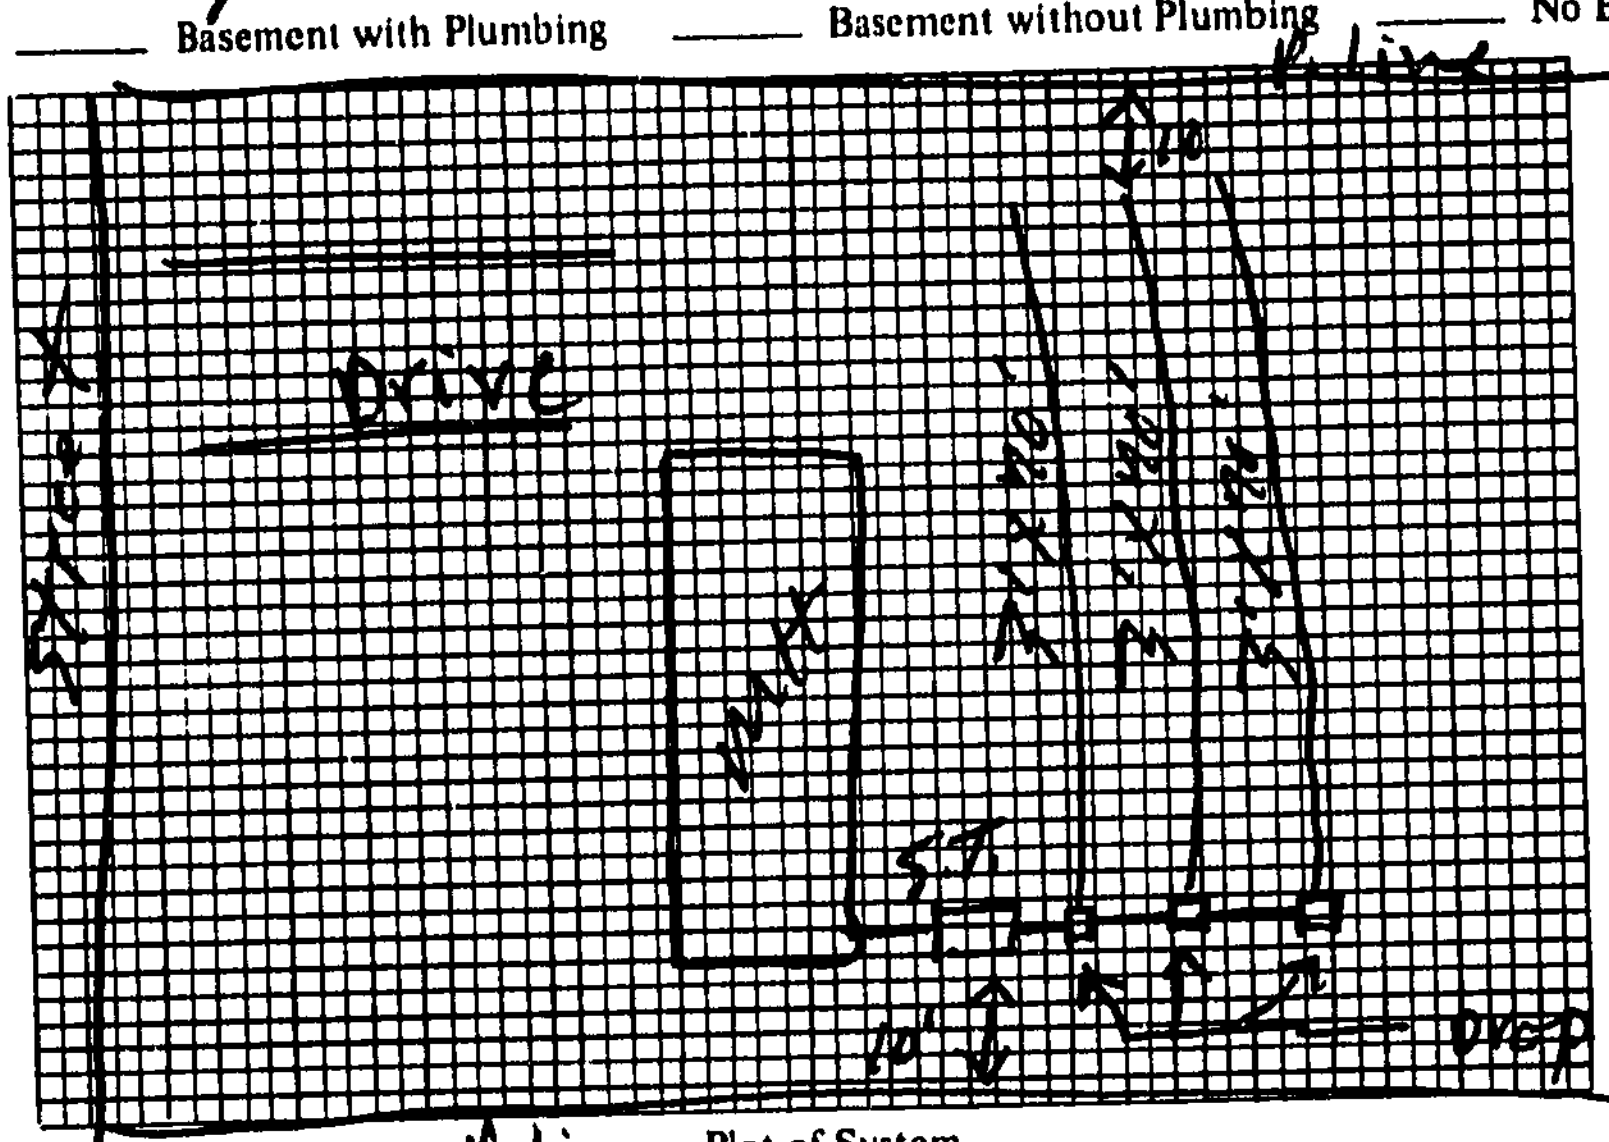

Plot of System

Size of Tank 1000 Gals.

Nitrification Field:

No. of Lines 3

Sq. Ft. 630 Linear Ft. 210

Depth of Stone in Lines 12"

Water Supply: Individual ( )

Public (✓)

Installed by Donald Lackey

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: ______

IMPROVEMENTS PERMIT BY J. C. Moore

COMMENTS: ______

CERTIFICATE OF COMPLETION BY J. C. Moore DATE 5-6-91

EXISTING SYSTEM CHECKED BY: ______ DATE ______

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold