Plans In File Cabinet under Chi Kwong Lai

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System -- G. S. Chapter 130 Article 13C)

OWNER OR CONTRACTOR Chi-Kwong Lai DATE 3-7-88 PERMIT NO. ____

PHONE: Business ____ Home ____

LOCATION East Broad St TR on St. Andrews at end TL 2nd lot on left. S. R. No. ____

SUBDIVISION NAME Shannon Acres LOT NO. 365 SECTION OR BLOCK NO. ____

House (✓) Mobile Home ( ) Business ( ) Other ____


No. Bedrooms 4 No. Bathrooms 3

Garbage Disposal Unit	Yes ( )	No (✓)
Auto. Dishwasher	Yes (✓)	No ( )
Auto. Wash. Machine	Yes (✓)	No ( )
Site Suitable	Yes (✓)	No ( )

Character & Porosity of Soil Clayey
Percolation Rate .2 gal/sq ft/day
Topography 2 to 6%
Depth to Water Table 10'+
Rock or other impervious formations None

Lot Area 1.06 acres

____ Basement with Plumbing ____ Basement without Plumbing ____ No Basement

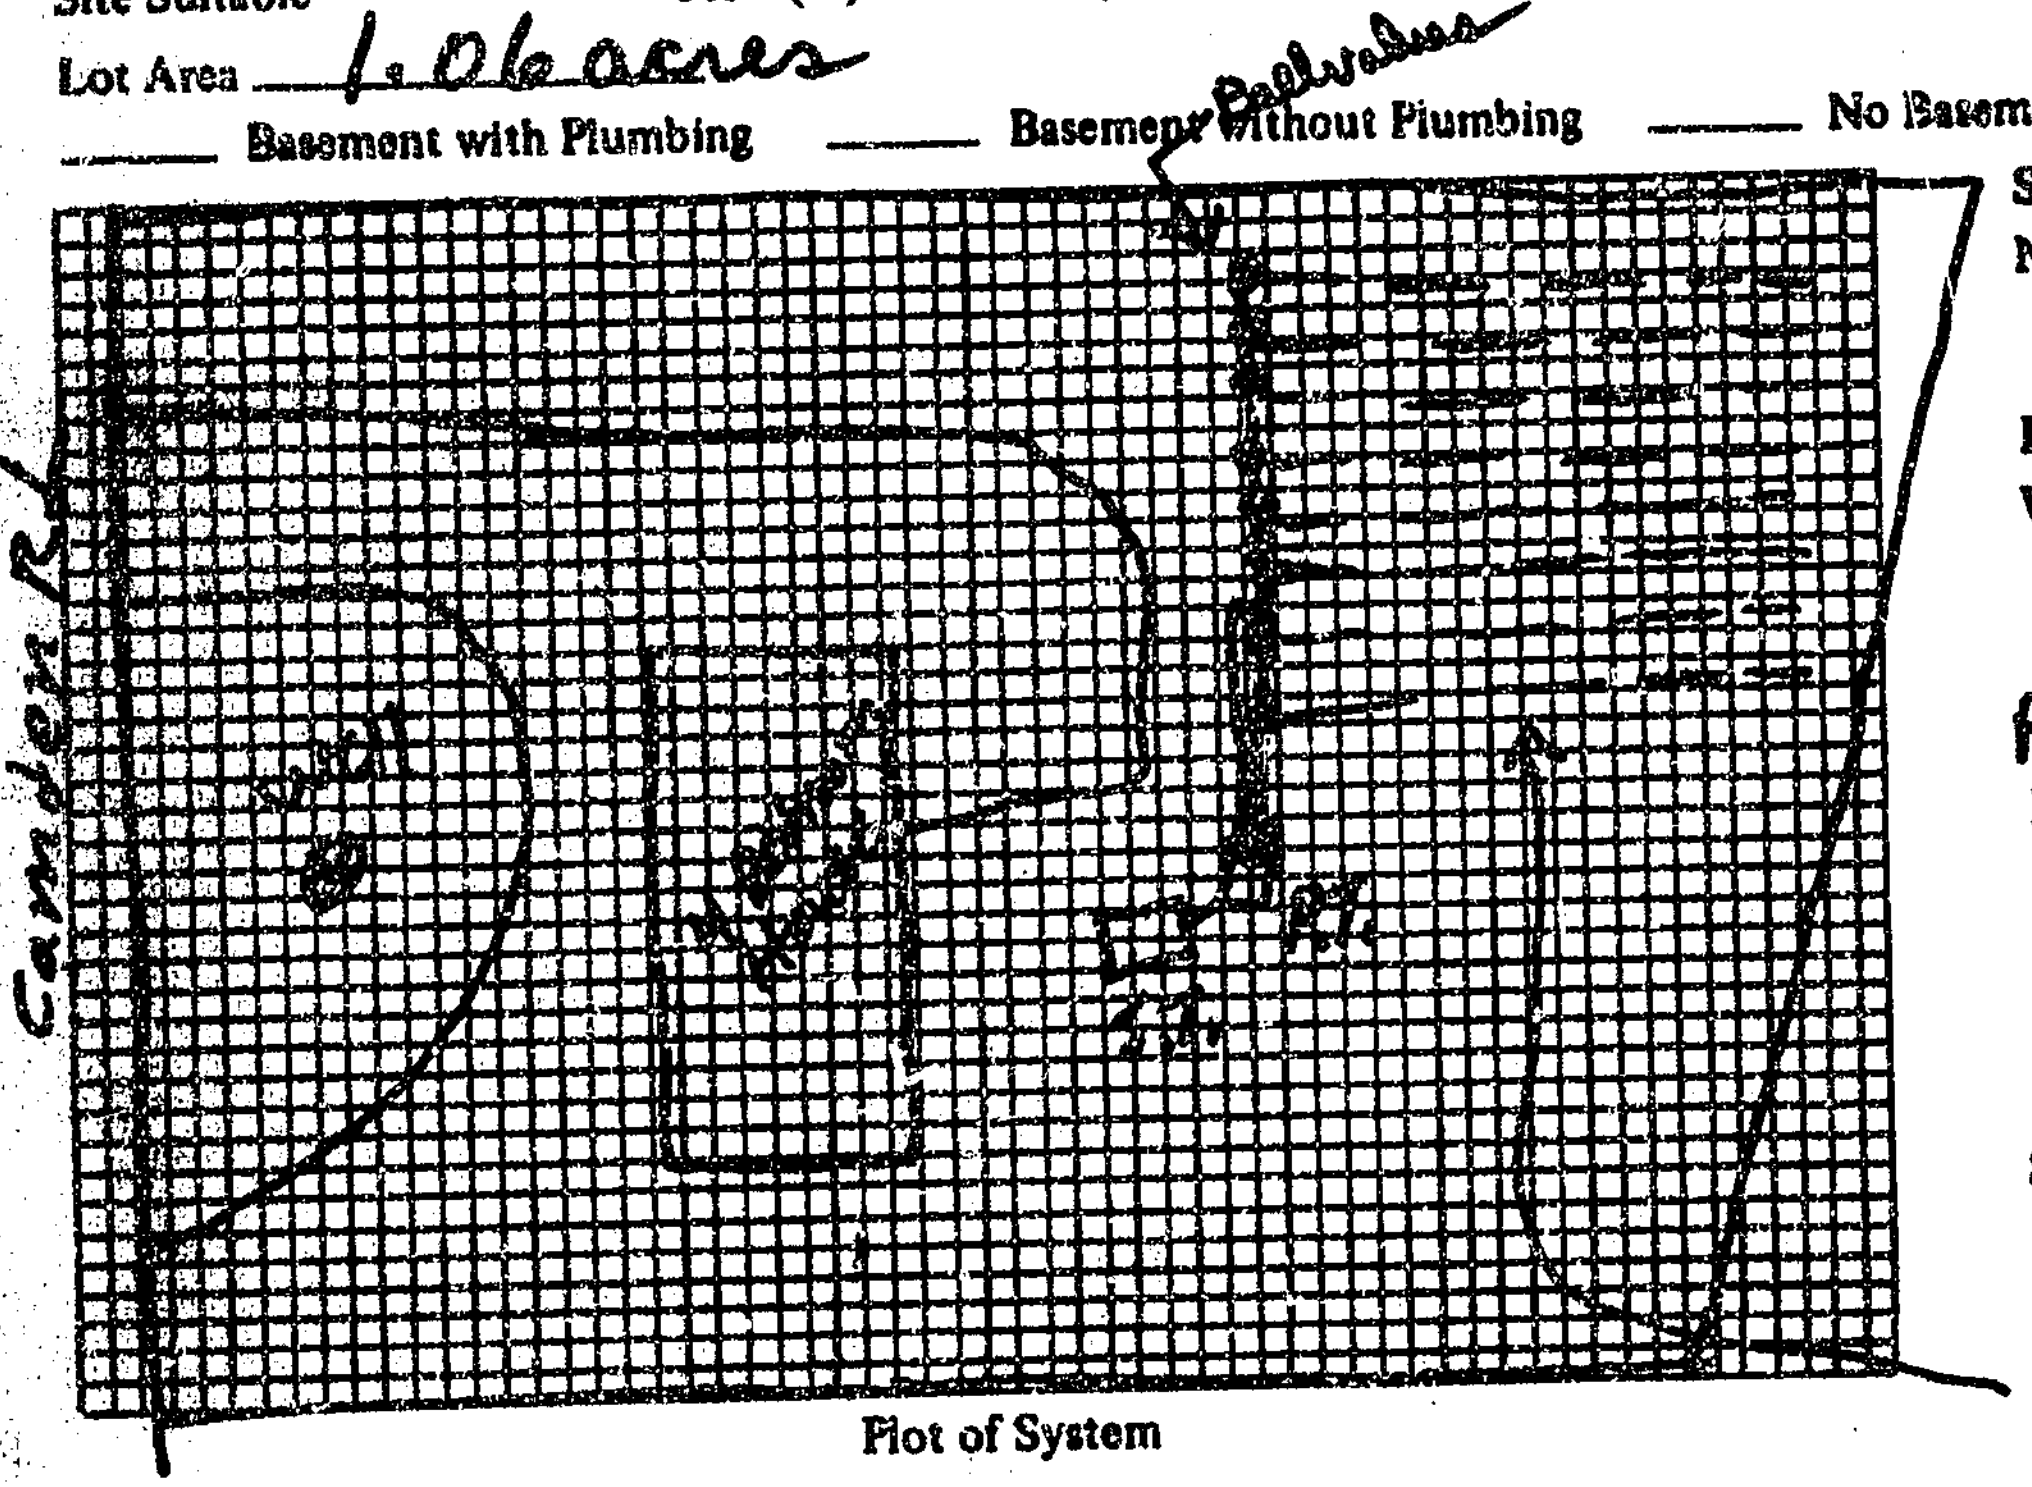

Plot of System

Size of Tank 1000 gal P.T. 1500 gal S.T. Gals.

Nitrification Field:
No. of Lines ____
Sq. Ft. ____ Linear Ft. ____
Depth of Stone in Lines ____
Water Supply: Individual ( )
Public ( )

2400 sq' low Pressure Pipesystem

Installed by Wayne Orbison

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: ____

2400 sq' low Pressure field 8 lines

IMPROVEMENTS PERMIT BY L. C. Moore

COMMENTS: Engineered by James M. Wooten + Associates 2-18-87 Drawing No. 1263

CERTIFICATE OF COMPLETION BY L. C. Moore DATE 3-7-88

EXISTING SYSTEM CHECKED BY: ____ DATE ____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold