DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

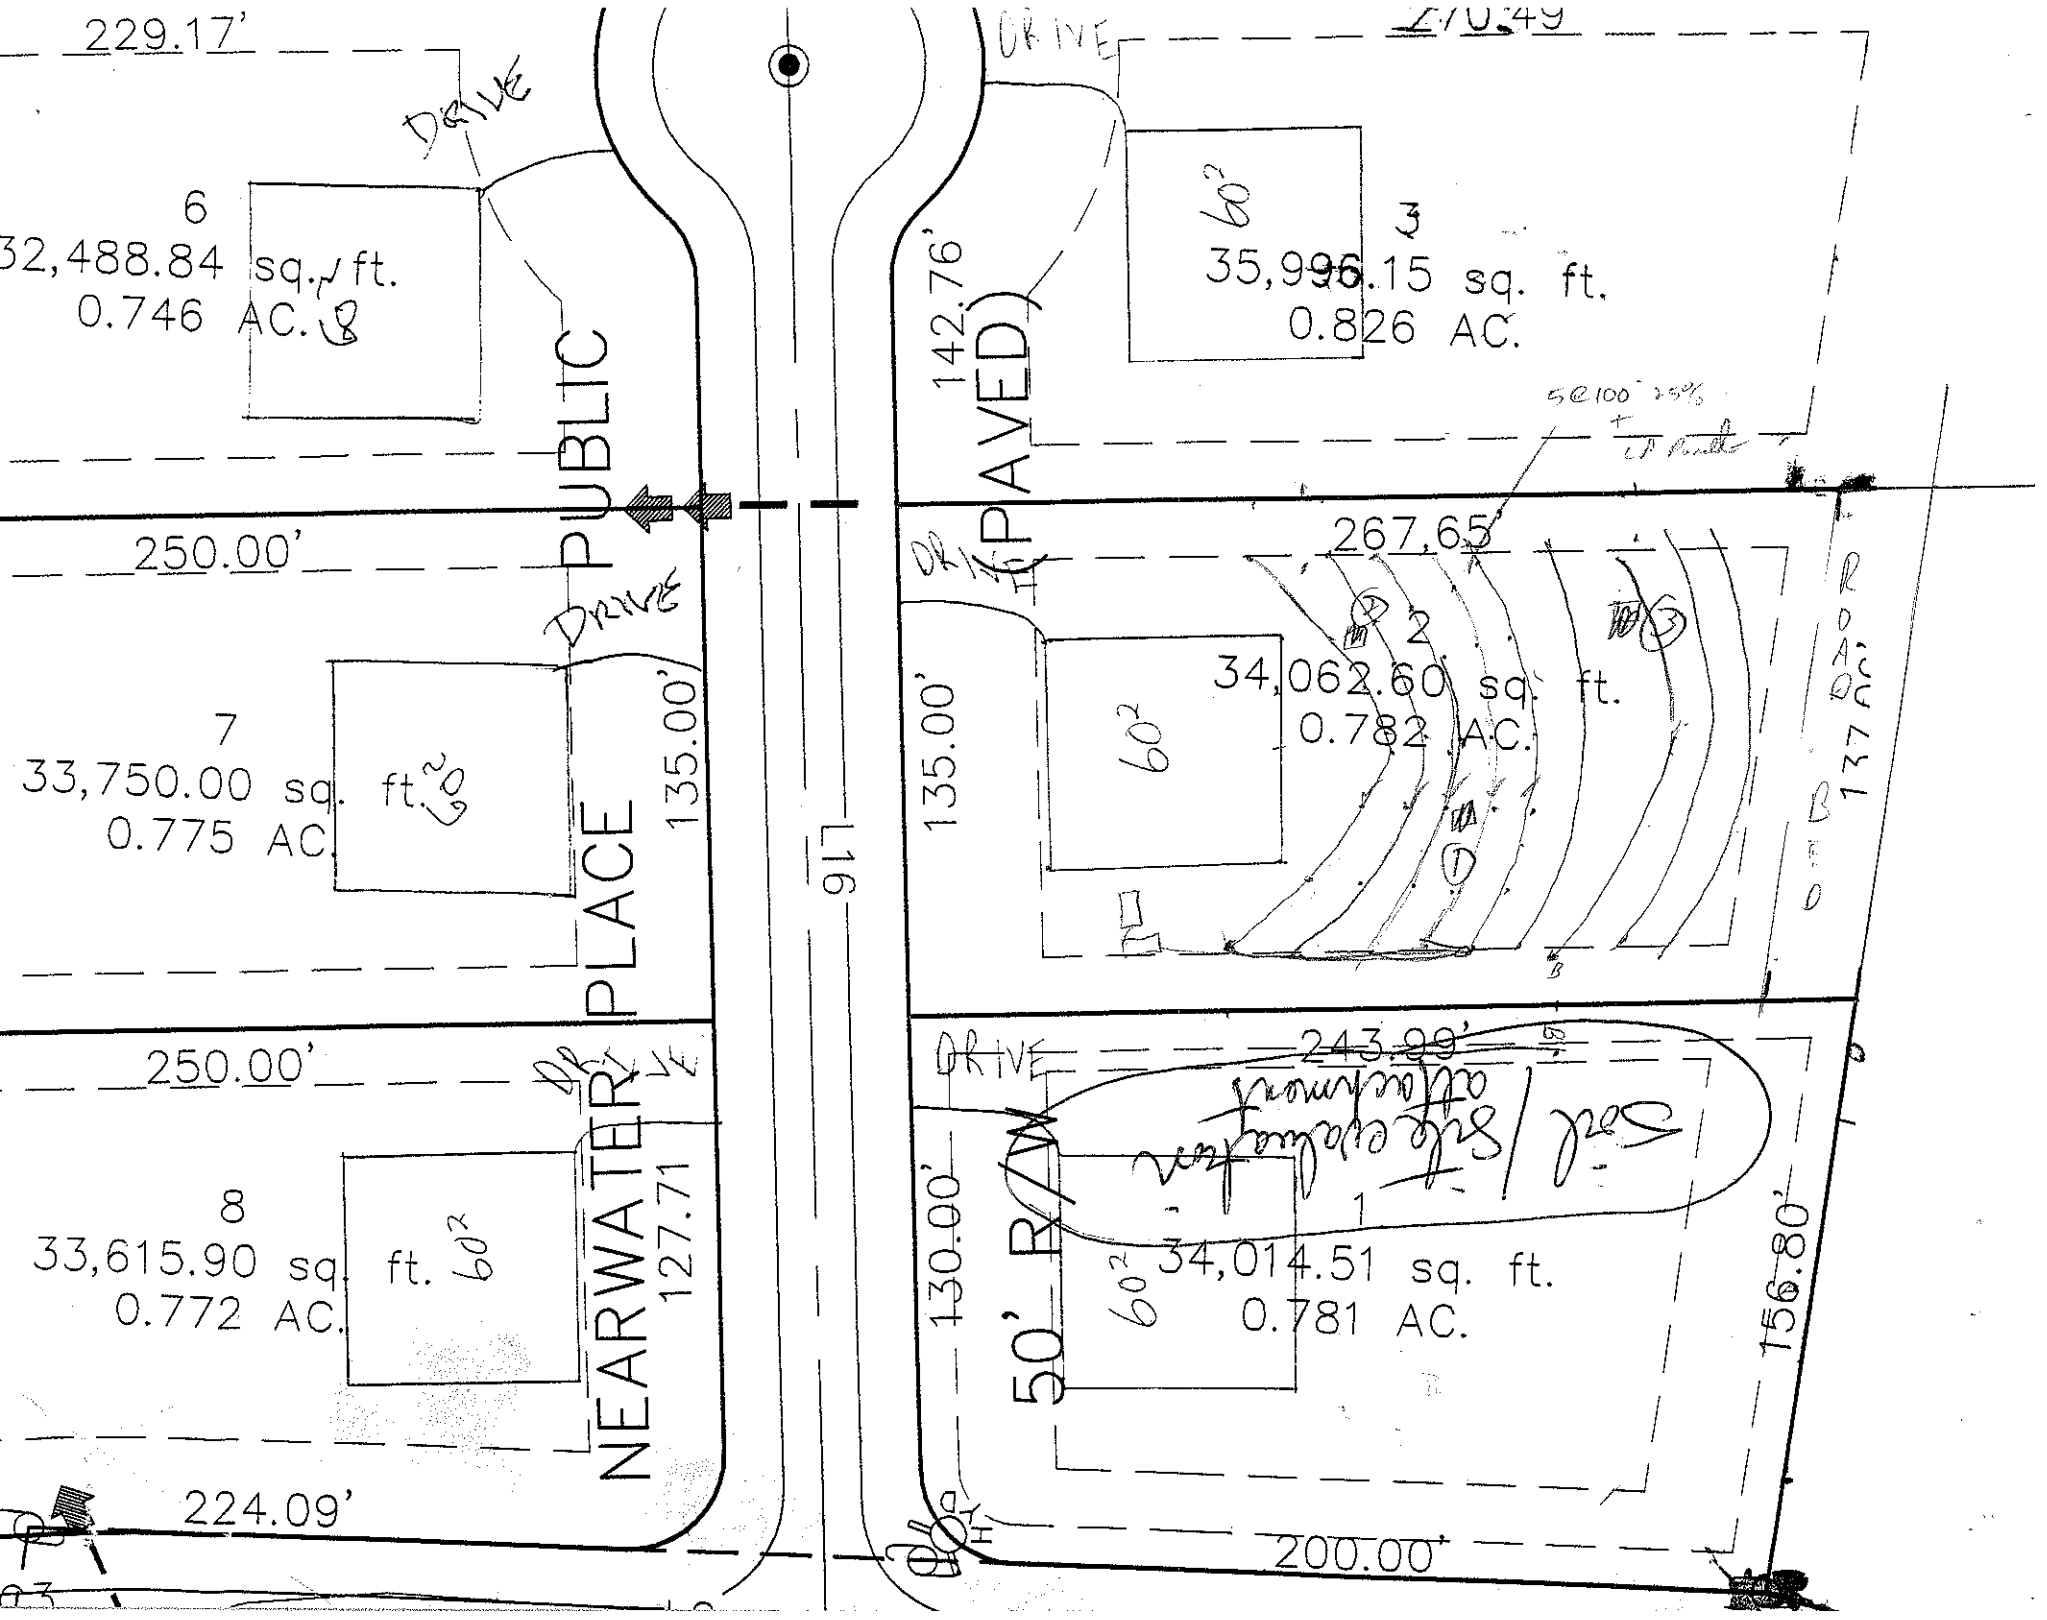
OWNER: _____ APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: _____
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____ PROPERTY SIZE: _____
LOCATION OF SITE: lot 2 Carter Lane PROPERTY RECORDED: _____
WATER SUPPLY: ☑ Private ☐ Public ☐ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☑ Pit ☐ Cut
TYPE OF WASTEWATER: ☑ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	OTHER PROFILE FACTORS .1943 SOIL DEPTH	OTHER PROFILE FACTORS .1956 SAPRO CLASS	OTHER PROFILE FACTORS .1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-7	BSCL CWR	fri SSSP so-p					PS .3
		7-26	RC SMPSBK	fri SSP/so-p					
		26-43	YRCL WPSBK	fri SSSP so-p - common SAP					
		43-54	RYL SAP m	fri SSSP - few CR inc					
2		0-8	BYL WR	fri SSSP/so-p					PS .25
		8-34	RYC ABK/SBK	fri SSSP - few YBS					
		34-55	RCL MPSBK	fri SSSP					
3		0-9	BSCL CWR	fri SSSP so-p					PS .25
		9-26	RC MPSBK	fri SP so-p					
		26-50	RC WPSBK	fri/fi SP - few YBS/so-p					
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)		
Site LTAR		

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): _____

EVALUATED BY: _____
OTHER(S) PRESENT: _____


229.17'
DRIVE
6
32,488.84 sq. ft.
0.746 AC.
PUBLIC
PLACE
250.00'
DRIVE
7
33,750.00 sq. ft.
0.775 AC.
135.00'
250.00'
DRIVE
8
33,615.90 sq. ft.
0.772 AC.
NEARWATER
127.71
224.09'
916
DRIVE
142.76'
(PAVED)
3
35,996.15 sq. ft.
0.826 AC.
267.65
2
34,062.60 sq. ft.
0.782 AC.
135.00'
243.99'
DRIVE
50' R/W
1
34,014.51 sq. ft.
0.781 AC.
130.00'
156.80'
200.00'