
PUMP TANK DESIGN

ATTACHMENT TO PROPERTY DESCRIPTION # 204584

TAX MAP # 4765319068

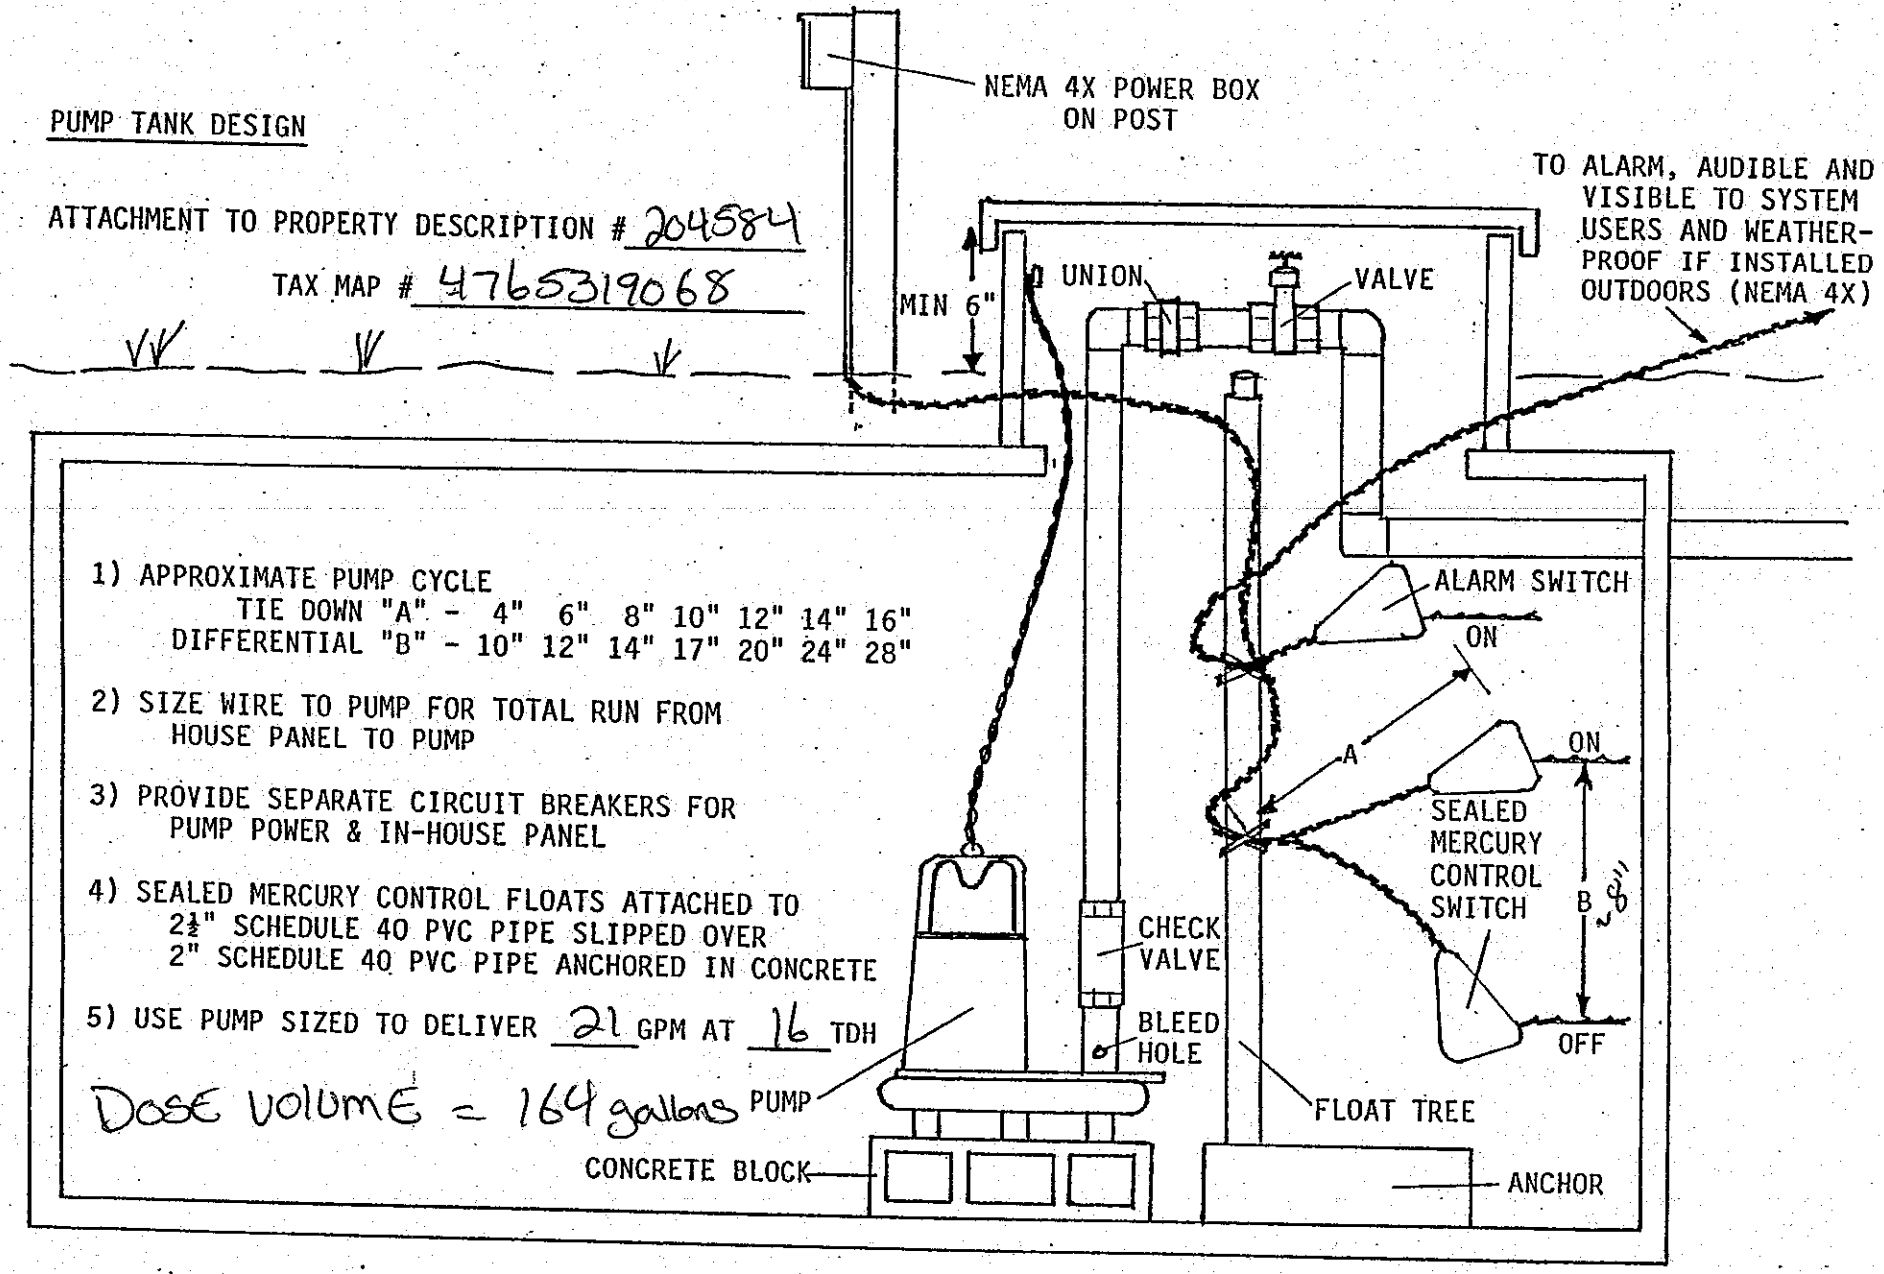

1) APPROXIMATE PUMP CYCLE
   TIE DOWN "A" - 4" 6" 8" 10" 12" 14" 16"
   DIFFERENTIAL "B" - 10" 12" 14" 17" 20" 24" 28"

2) SIZE WIRE TO PUMP FOR TOTAL RUN FROM HOUSE PANEL TO PUMP

3) PROVIDE SEPARATE CIRCUIT BREAKERS FOR PUMP POWER & IN-HOUSE PANEL

4) SEALED MERCURY CONTROL FLOATS ATTACHED TO
   2½" SCHEDULE 40 PVC PIPE SLIPPED OVER
   2" SCHEDULE 40 PVC PIPE ANCHORED IN CONCRETE


5) USE PUMP SIZED TO DELIVER 21 GPM AT 16 TDH

DOSE VOLUME = 164 gallons

PRESSURE MANIFOLD DESIGN

ATTACHMENT TO P.D.# 204584

TAX MAP # 4765319068

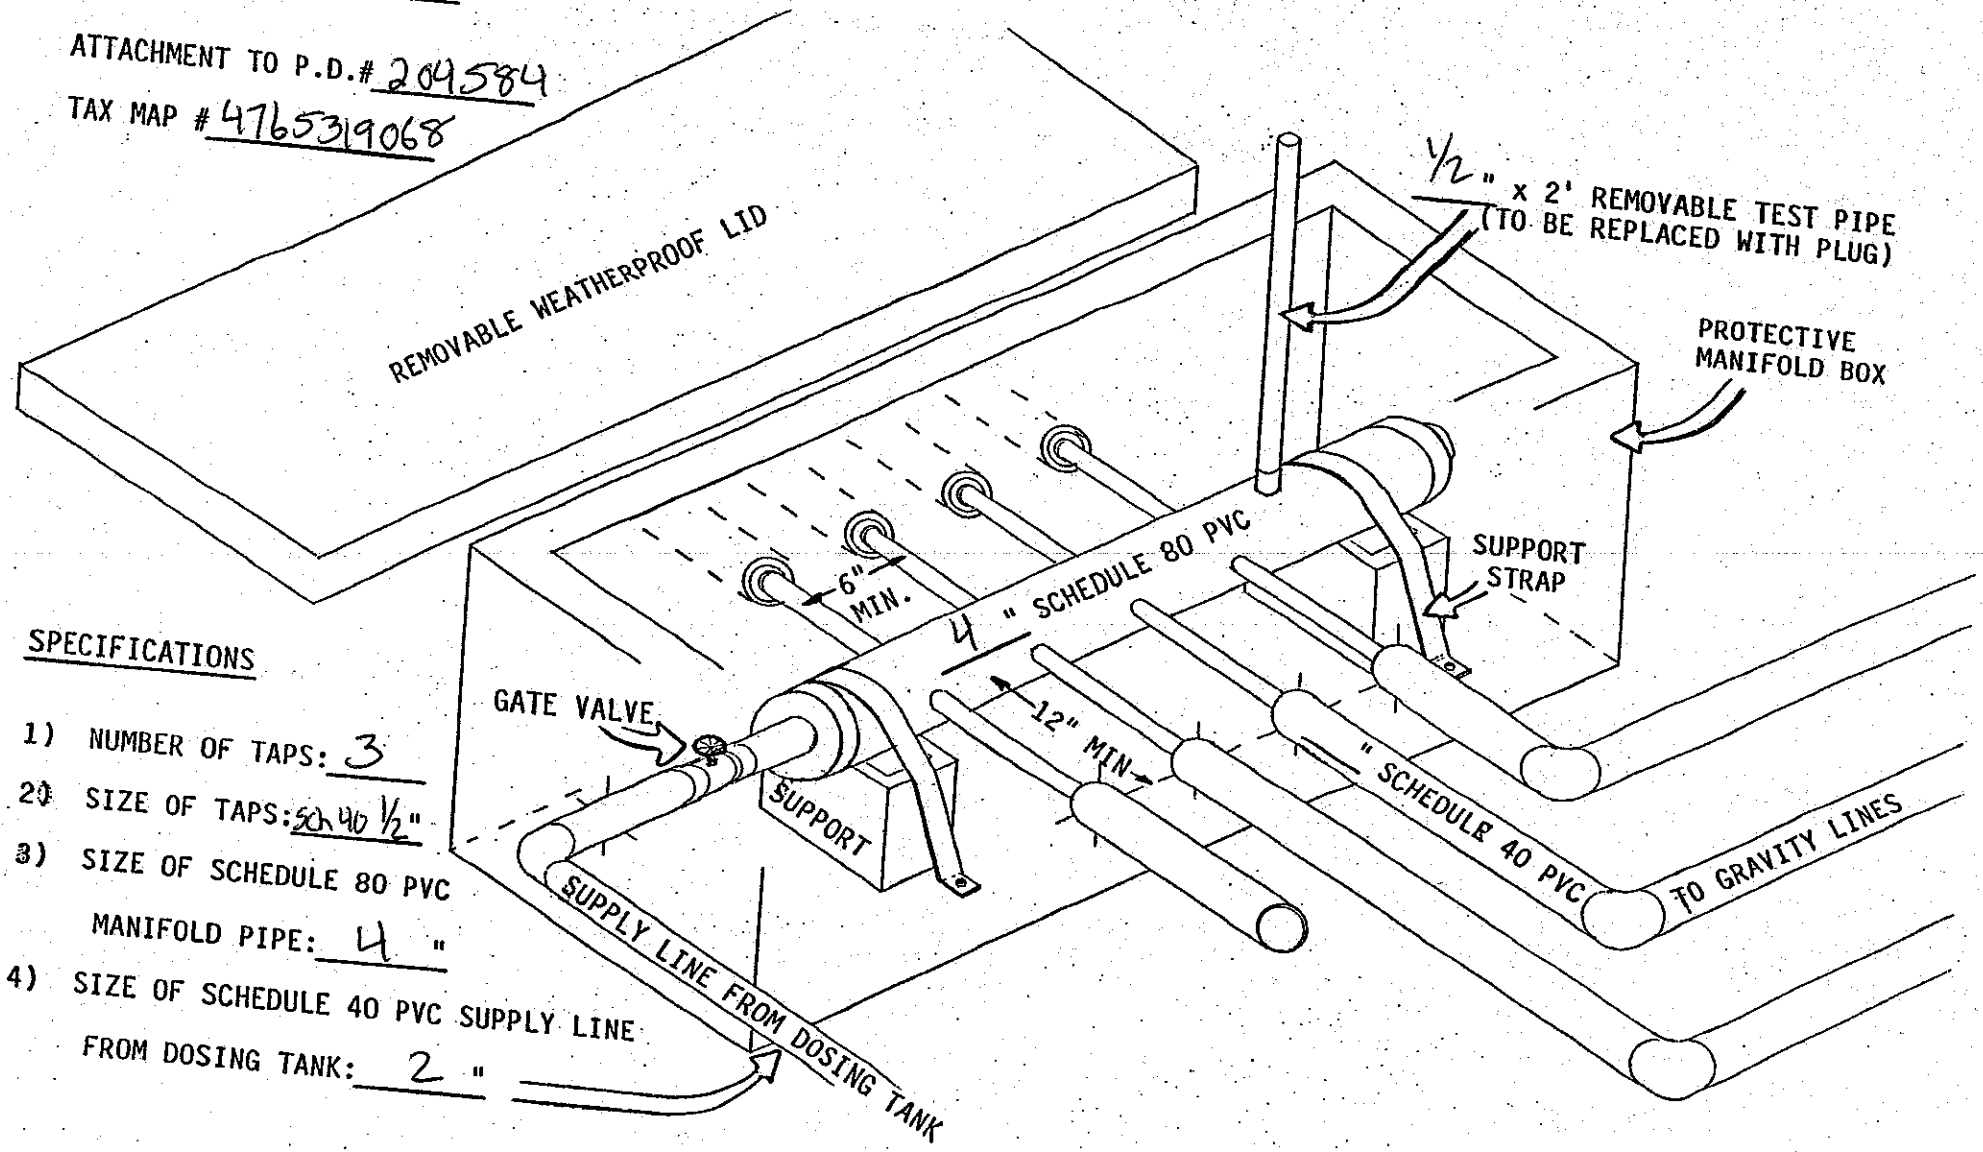

SPECIFICATIONS

1) NUMBER OF TAPS: 3
2) SIZE OF TAPS: Sch 40 ½"
3) SIZE OF SCHEDULE 80 PVC MANIFOLD PIPE: 4 "
4) SIZE OF SCHEDULE 40 PVC SUPPLY LINE FROM DOSING TANK: 2 "