repaired 6-25-80 by low pressure Pump system

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION

Papers attached

(Ground Absorption Sewage Disposal System — G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Fortis Corp DATE 5-11-79 PERMIT NO.

PHONE: Business Home

LOCATION 64 E TR on Bell Rd

S. R. No.


SUBDIVISION NAME Cedar Hills LOT NO. 61 SECTION OR BLOCK NO.

House (✓) Mobile Home ( ) Business ( ) Other

No. Bedrooms 3 No. Bathrooms 1½

Garbage Disposal Unit	Yes ( )	No (✓)	Character & Porosity of Soil	Appling clay	
Auto. Dishwasher	Yes (✓)	No ( )	Percolation Rate	120 min/inch	
Auto. Wash. Machine	Yes (✓)	No ( )	Topography	2 to 4%	
Site Suitable	Yes (✓)	No ( )	Depth to Water Table	10'+	
			Rock or other impervious formations	none	

Lot Area ½ acre

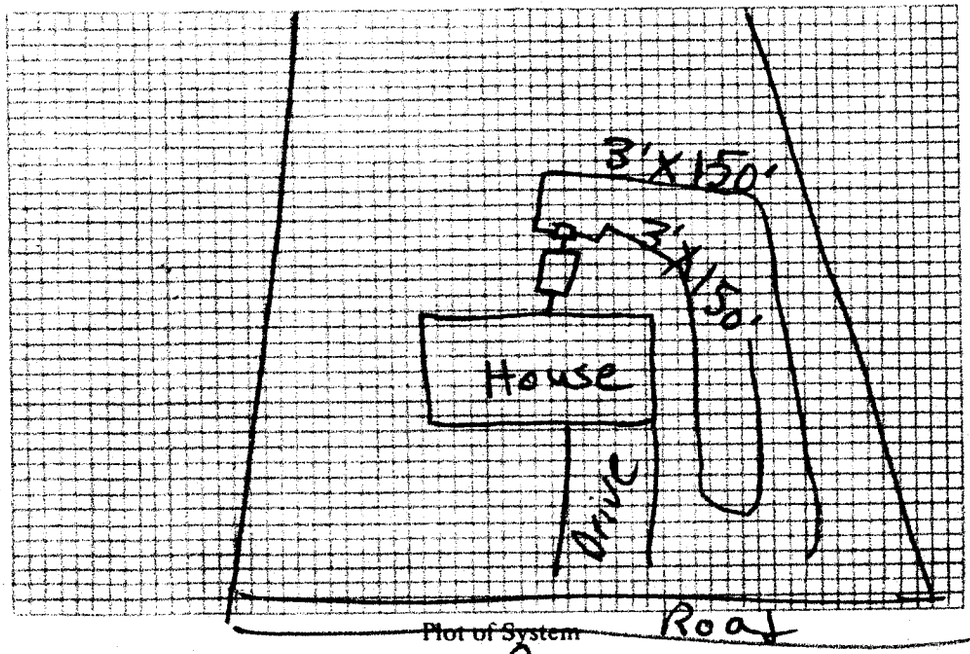

Plot of System

Size of Tank 1000 Gals.

Nitrification Field:
No. of Lines 2
Sq. Ft. 900 Linear Ft. 300
Depth of Stone in Lines 10"

Water Supply: Individual ( )
Public (✓)

Installed by Pfaff + Sale

IMPROVEMENTS PERMIT BY J. C. Moore

COMMENTS: landscape + Pipe Gutters so that water ties not stand over Tank or lines.

CERTIFICATE OF COMPLETION BY J. C. Moore DATE 5-11-79

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold