DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: 101339
COUNTY: 4765-93-7795.0

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: AH INC APPLICANT: SAME
ADDRESS: 1150 AUCTION DR SALISBURY APPLICATION DATE: 8-27-01 DATE EVALUATED: 10-8-01
PROPOSED FACILITY: HOUSE PROPOSED DESIGN FLOW (.1949): 360 PROPERTY SIZE: 1.505 0
LOCATION OF SITE: TRIPLE OAKS LOT 9 PROPERTY RECORDED: ___
WATER SUPPLY: ☐ Private ☒ Public ☐ Well ☐ Spring ☐ Other ___
EVALUATION METHOD: ☒ Auger Boring 10-1-01 ☒ Pit 10-8-01 ☐ Cut
TYPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFIL CLASS & LTAR
1	6% CC	0-3"	compacted clay	FARMED	FRENCH/ORGN ≥ 2 chroma mottles 3-60"				PS .2
		3-40"	hvy clay mod abk	fr, s, p, sexp					
		40-60"	cl mix sap/med/abk	fr, ss, sp, sexp					
2	6% CC	0-8"	compacted clay	FARMED	FRENCH/ORGN ≥ 2 chroma mottles 3-60"				PS .2
		3-42"	hvy clay mod abk	fr, s, p, sexp					
		42-66"	cl mix sap/med/abk	fr, ss, sp, sexp					
3	6% CC	0-6"	compacted clay	FARMED	FRENCH/ORGN ≥ 2 chroma Mottles 3-60"				PS .2
		6-40"	hvy clay mod abk	fr, s, p, sexp					
		40-60"	cl mix sap/med/abk	fr, ss, sp, sexp					
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	YES	NO
System Type(s)	LPPANEL	N/A
Site LTAR	.2	N/A

OTHER FACTORS (.1946): ___
SITE CLASSIFICATION (.1948): US
EVALUATED BY: L. COOK / B. FREEM
OTHER(S) PRESENT: MIKE SPEAR

LEGEND

use the following standard abbreviations

LANDSCAPE POSITION	GROUP	SOIL TEXTURE	CONVENTIONAL .1955 LTAR	LPP .1957 LTAR	MINERALOGY/ CONSISTENCE	STRUCTURE
CC (Concave Slope)	I	S (Sand)	1.2 - 0.8	0.6 - 0.4	NEXP (Non-expansive)	G (Single Grain)
CV (Convex Slope)		LS (Loamy Sand)			SEXP (Slightly Expansive)	M (Massive)
D (Drainage Way)					EXP (Expansive)	CR (Crumb)
DS (Debris Slump)	II	SL (Sandy Loam)	0.8 - 0.6	0.4 - 0.3		GR (Granular)
FP (Flood Plain)		L (Loam)				SBK (Subangular Blocky)
FS (Foot Slope)						ABK (Angular Blocky)
H (Head Slope)	III	SI (Silt)	0.6 - 0.3	0.3 - 0.15		PL (Platy)
L (Linear Slope)		SICL (Silty Clay Loam)				PR (Prismatic)
N (Nose Slope)		CL (Clay Loam)				
R (Ridge)		SCL (Sandy Clay Loam)			MOIST	WET
S (Shoulder Slope)		SLC (Silt Loam Clay)				
T (Terrace)					VFR (Very Friable)	NS (Non-sticky)
	IV	SC (Sandy Clay)	0.4 - 0.1	0.2 - 0.05	FR (Friable)	SS (Slightly Sticky)
		SIC (Silty Clay)			FI (Firm)	S (Sticky)
					VFI (Very Firm v. Very Sticky)	VS (Very Sticky)
		O (Organic)	None		EFI (Extremely Firm)	NP (Non-plastic)
						SP (Slightly Plastic)
						P (Plastic)
						VP (Very Plastic)


NOTES

HORIZON DEPTH	In inches below natural soil surface
DEPTH OF FILL	In inches from land surface
RESTRICTIVE HORIZON	Thickness and depth from land surface
SAPROLITE	S(suitable) or U(unsuitable)
SOIL WETNESS	Inches from land surface to free water or inches from land surface to soil colors with chroma 2 or less - record Munsell color chip designation
CLASSIFICATION	S (Suitable), PS (Provisionally Suitable), or U (Unsuitable)

Evaluation of saprolite shall be by pits.

Long-term Acceptance Rate (LTAR): gal/day/ft²


Show profile locations and other site features (dimensions, reference or benchmark, and North).

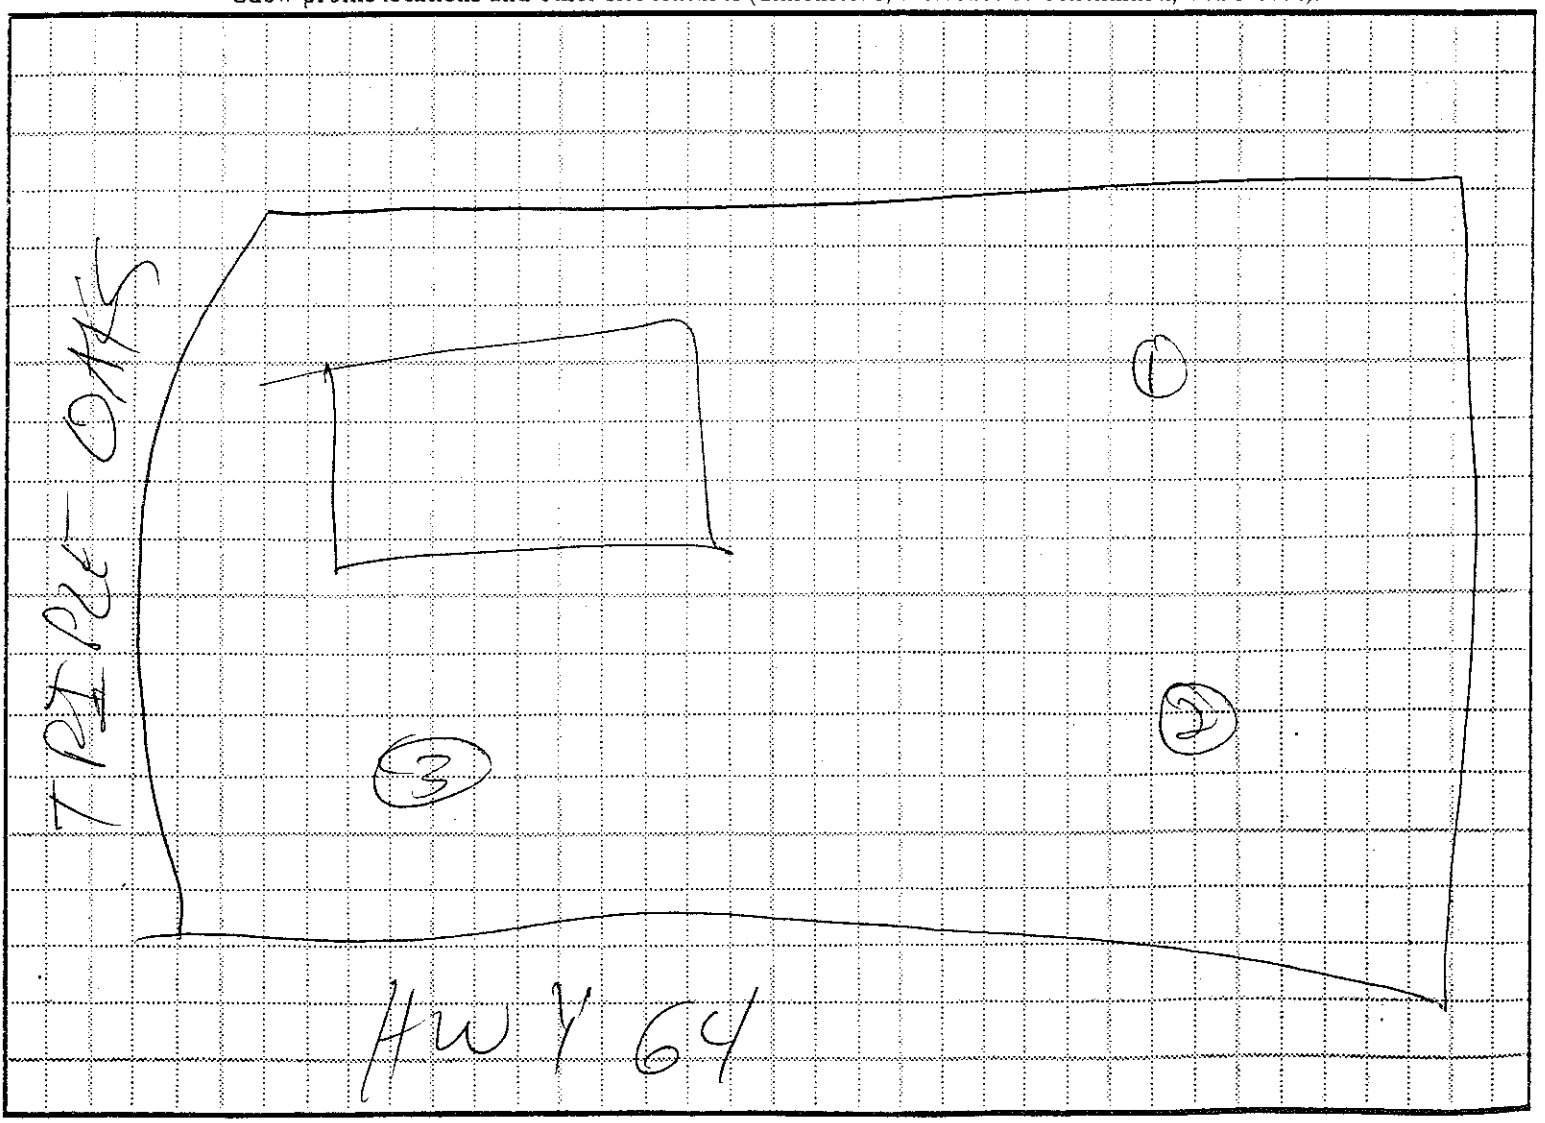

W	DL 1	20'
B	DL 2	30'
R	DL 3	60'
B	DL 4	40'
W	DL 5	100'
B	DL 6	80'
W	DL 7	110'
B	DL 8	75'
W	DL 9	60

575 TOTAL NEED 600

NOT TO SCALE

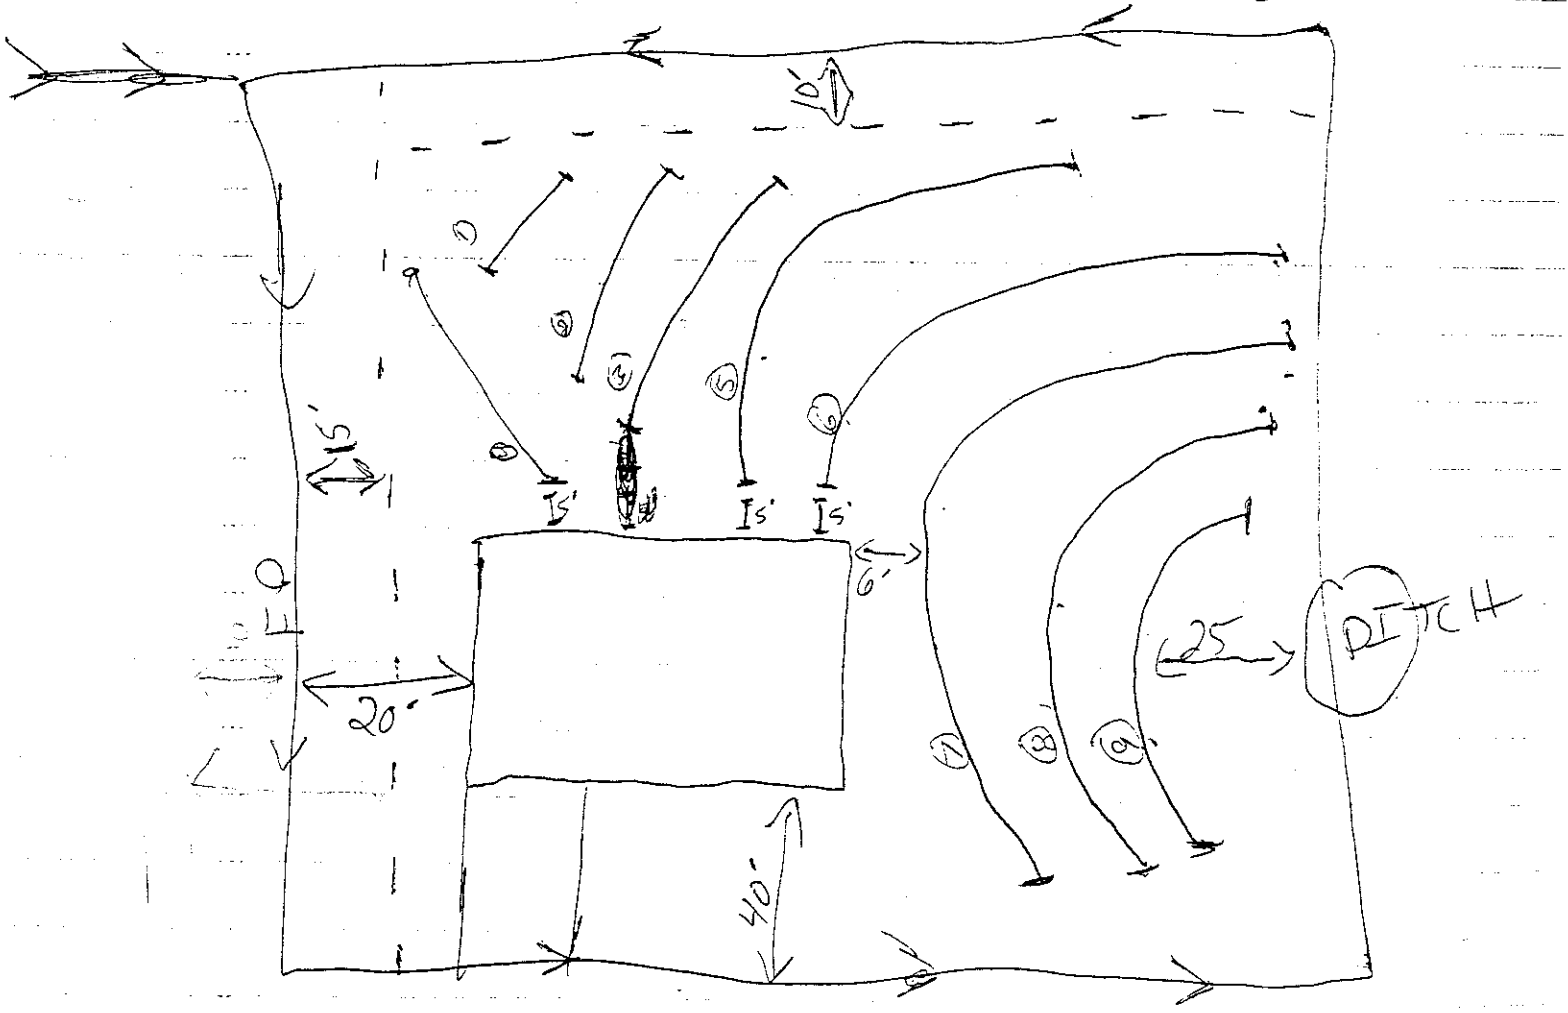

EVEN WITH HOOSE SLID UP TO 35' OFF "NO ROOM" FOR SYSTEM