00650

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION

(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Julian Brown

PHONE: Business ______ Home ______ DATE 07-23-84 PERMIT NO. ______

LOCATION Hwy 70 E, 8 miles, 2nd lot past AME Zion Church (Across from Idaho Rd)

SUBDIVISION NAME ______ S. R. No. ______

LOT NO. ______ SECTION OR BLOCK NO. ______

House ( ) Mobile Home ( ) Business (✓) Other 14 seat Grill

No. Bedrooms 0 No. Bathrooms 2

Garbage Disposal Unit Yes ( ) No ( )

Auto. Dishwasher Yes ( ) No ( )

Auto. Wash. Machine Yes ( ) No ( )

Site Suitable Yes ( ) No ( )

Lot Area 0.67 Acres

Character & Porosity of Soil Class III


Percolation Rate 0.5 gal/ft²/day

Topography 2-6% slope

Depth to Water Table 10'+

Rock or other impervious formations none

___ Basement with Plumbing ___ Basement without Plumbing ✓ No Basement

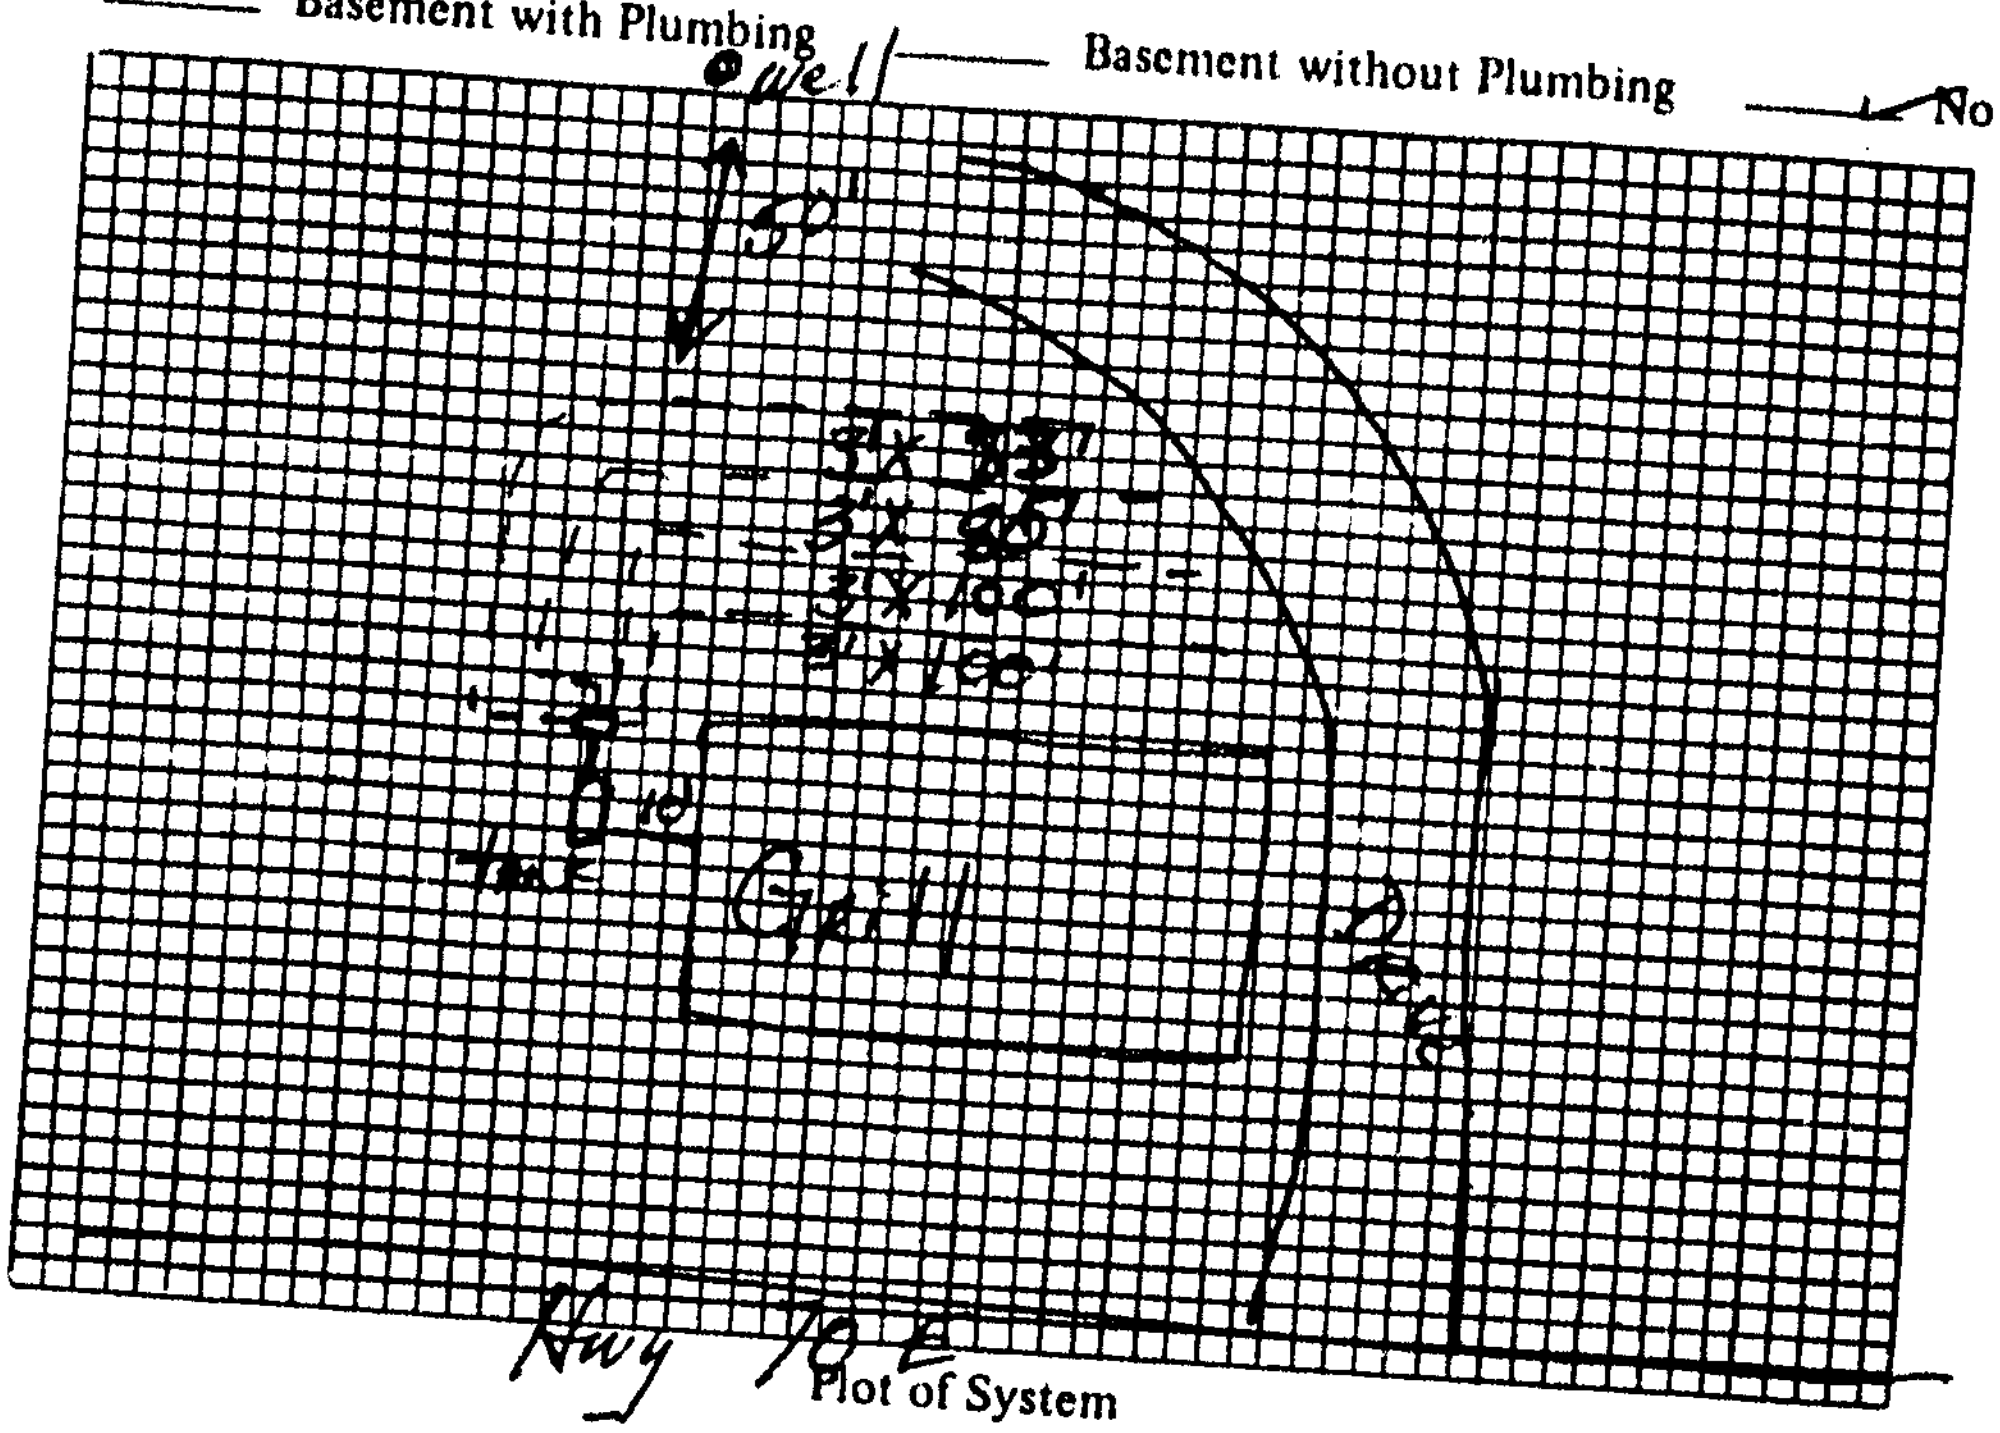

Plot of System

Size of Tank 1000 Gals.

Nitrification Field:

No. of Lines 4

Sq. Ft. 1104 Linear Ft. 368

Depth of Stone in Lines 12"

Water Supply: Individual (✓) Public ( )

Installed by Cuthbertson

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: ______

IMPROVEMENTS PERMIT BY J. C. Moore

COMMENTS: Replaces permit issued 07-06-83 by Terry L. Pierce for double wide mobile home.

CERTIFICATE OF COMPLETION BY Terry L Pierce DATE 07-23-84

EXISTING SYSTEM CHECKED BY: ______ DATE ______

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold