DEPARTMENT OF ENVIRONMENT AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet 1 of 1
PROPERTY ID #:
COUNTY:

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: Don Williams
ADDRESS:
APPLICATION DATE
PROPOSED FACILITY: 3 BR SFD — PROPOSED DESIGN FLOW (.1949): 360 GPD — DATE EVALUATED: 06/01/06
LOCATION OF SITE: @ End of JJ Lane — PROPERTY SIZE: 1.9 Ac.
WATER SUPPLY: ☒ Private ☐ Public ☒ Well ☐ Spring ☐ Other — PROPERTY RECORDED:
EVALUATION METHOD: ☒ Auger Boring ☐ Pit ☐ Cut — TYPE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	Very Slight N ~2%	0-6	W,M,Sbk,SCL	Fr-Fi,SS,SP,SEXP	2.5Y 7/8	>48"	N/A	>48"	PS 0.30
		6-19	W,M,Sbk,C	Fi,SS,SP,SEXP					
		19-46	W,M,Sbk,C	Fi,SS,SP,SEXP	10YR 6/3 @19"-22"				
		46-48	C w/ SAP Inclus. (<50% SAP)						
2	Slight N 2%	0-4	W,M,Sbk,SCL	Fr,SS,NP,NEXP	2.5Y 7/8	>48"	N/A	>48"	PS 0.30
		4-20	W,M,Sbk,C	Fi,SS,SP,SEXP					
		20-22	C w/ Few Mottles		10YR 6/3 @20"				
		22-48	C w/ SAP Inclus. (<50% SAP						
3	Slight N 2%	0-4	W,M,Sbk,SCL	VFr,SS,NP,NEXP	2.5Y 7/8	>48"	N/A	>48"	PS 0.30
		4-15	W,M,Sbk,C	Fr-Fi,SS,SP,SEXP	10YR 6/3 @16"				
		15-48	C w/ SAP Inclus. (<50% SAP)						
4	L ~3%	0-11	W,Sbk,SCL	VFr,NS,NP	2.5Y 7/8	>48"	N/A	>48"	PS 0.30
		11-22	W,M,Sbk,C	Fr,SS,SP,SEXP					
		22-25	C w/ Few Mottles		10YR 6/3				
		25-48	C w/ SAP Inclus. (<50% SAP)						

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	900 ft²	900 ft²
System Type(s)	Gravity 25% Red	Pump 25% Red
Site LTAR	0.30	0.30

OTHER FACTORS (.1946): PS
SITE CLASSIFICATION (.1948):
EVALUATED BY: P. Mitchell
OTHER(S) PRESENT:

COMMENTS:

LEGEND

use the following standard abbreviations

LANDSCAPE POSITION	GROUP	SOIL TEXTURE	CONVENTIONAL .1955 LTAR*	LPP .1957 LTAR*	MINERALOGY/ CONSISTENCE	STRUCTURE
CC (Concave Slope) CV (Convex Slope) D (Drainage Way) DS (Debris Slump) FP (Flood Plain) FS (Foot Slope) H (Head Slope) L (Linear Slope) N (Nose Slope) R (Ridge) S (Shoulder Slope) T (Terrace)	I	S (Sand) LS (Loamy Sand)	1.2 - 0.8	0.6 - 0.4	NEXP (Non-expansive) SEXP (Slightly Expansive) EXP (Expansive)	G (Single Grain) M (Massive) CR (Crumb) GR (Granular) SBK (Subangular Blocky) ABK (Angular Blocky) PL (Platy) PR (Prismatic)
	II	SL (Sandy Loam) L (Loam)	0.8 - 0.6	0.4 - 0.3		
	III	Si (Silt) SiCL (Silty Clay Loam) CL (Clay Loam) SCL (Sandy Clay Loam) SiL (Silt Loam)	0.6 - 0.3	0.3 - 0.15		
	IV	SC (Sandy Clay) SiC (Silty Clay) C (Clay)	0.4 - 0.1	0.2 - 0.05		
		O (Organic)	None	None		

MOIST	WET
VFR (Very Friable)	NS (Non-sticky)
FR (Friable)	SS (Slightly Sticky)
FI (Firm)	S (Sticky)
VFI (Very Firm v. Very Sticky)	VS (Very Sticky)
EFI (Extremely Firm)	NP (Non-plastic)
	SP (Slightly Plastic)
	P (Plastic)
	VP (Very Plastic)

*Adjust LTAR due to depth, consistence, structure, soil wetness, landscape, position, wastewater flow and quality.


NOTES

HORIZON DEPTH	In inches below natural soil surface
DEPTH OF FILL	In inches from land surface
RESTRICTIVE HORIZON	Thickness and depth from land surface
SAPROLITE	S(suitable) or U(unsuitable)
SOIL WETNESS	Inches from land surface to free water or inches from land surface to soil colors with chroma 2 or less - record Munsell color chip designation
CLASSIFICATION	S (Suitable), PS (Provisionally Suitable), or U (Unsuitable)

Evaluation of saprolite shall be by pits.

Long-term Acceptance Rate (LTAR): gal/day/ft^2

Show profile locations and other site features (dimensions, reference or benchmark, and North).

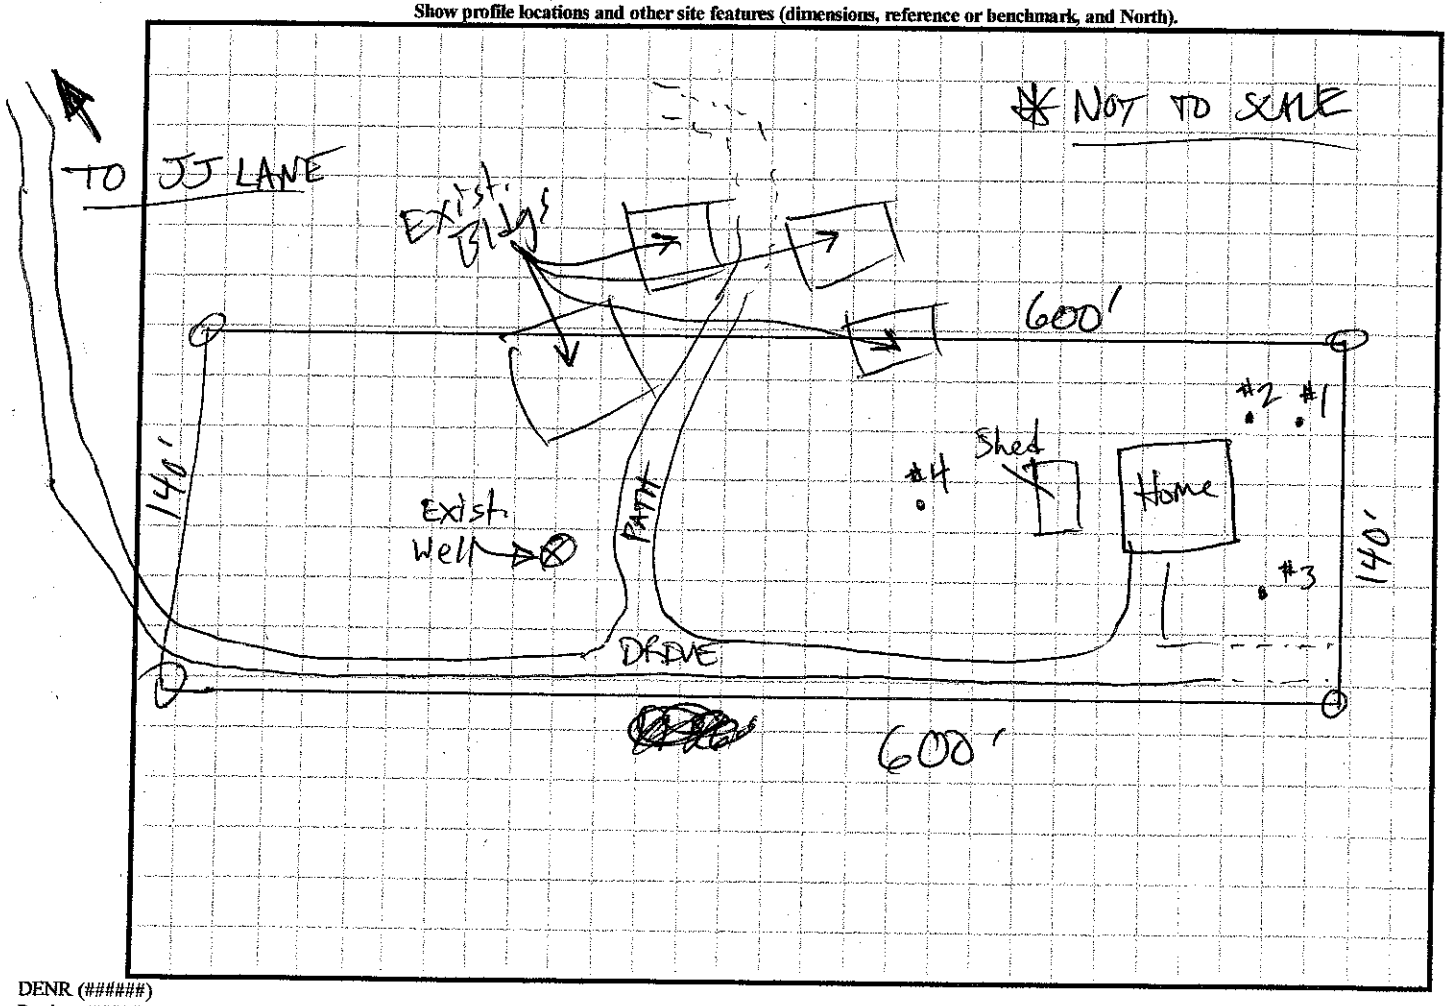

DENR (######)
Review (#####)