
Tim Hamby
12-1-94
Salem meadows
lot 5

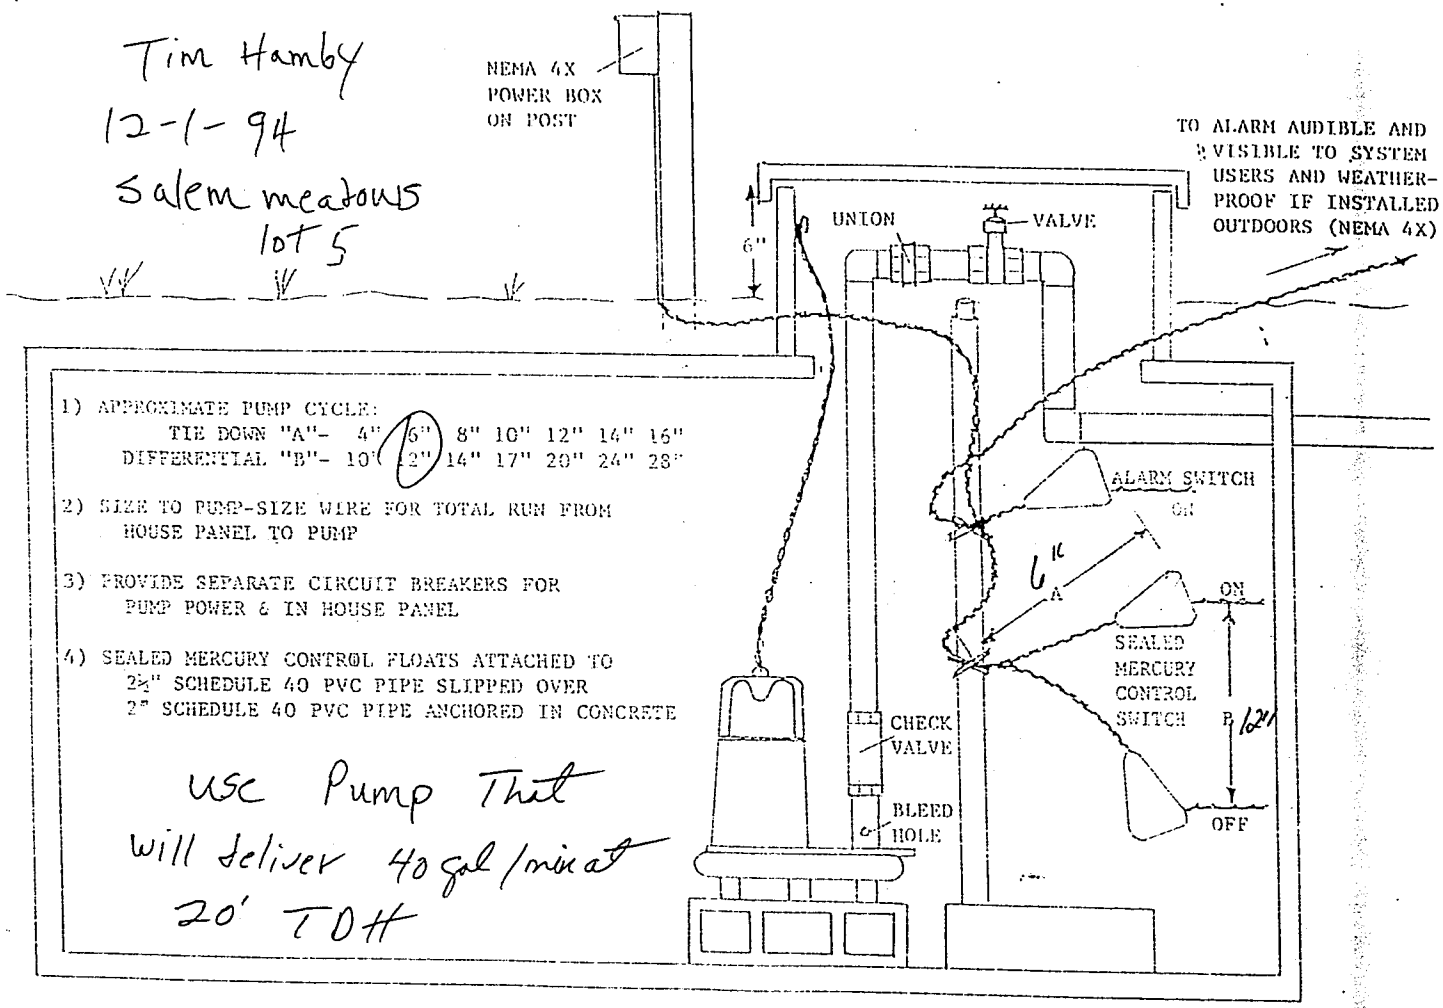

1) APPROXIMATE PUMP CYCLE:
TIE DOWN "A"- 4" 6" 8" 10" 12" 14" 16"
DIFFERENTIAL "B"- 10" 12" 14" 17" 20" 24" 28"

2) SIZE TO PUMP-SIZE WIRE FOR TOTAL RUN FROM HOUSE PANEL TO PUMP

3) PROVIDE SEPARATE CIRCUIT BREAKERS FOR PUMP POWER & IN HOUSE PANEL

4) SEALED MERCURY CONTROL FLOATS ATTACHED TO 2½" SCHEDULE 40 PVC PIPE SLIPPED OVER 2" SCHEDULE 40 PVC PIPE ANCHORED IN CONCRETE

use Pump That
will deliver 40 gal/min at
20' TDH

- PUMP TANK DESIGN -

S 5000