
Acknowledgement of
Plans Submitted ONLY
Date 3-15-08

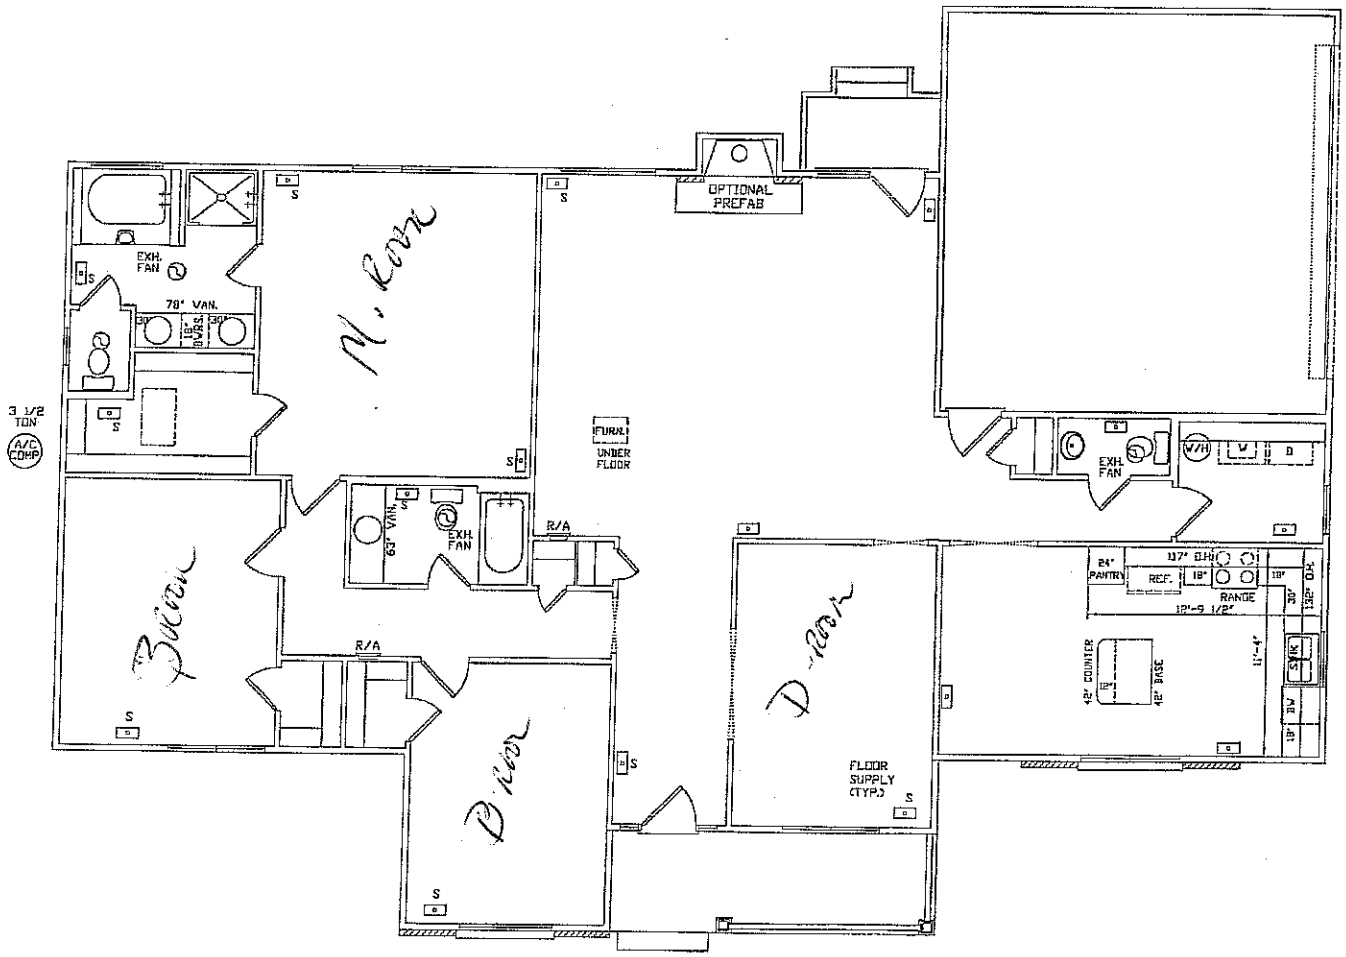

① NOTE: ALL FURNACES NOT LO
IN HEATED AREA TO BE AS C
LOCATED AS POSSIBLE IN ACC
WITH ALL APPLICABLE CODES

② NOTE: BUILDER & HVAC CON
RESERVE THE RIGHT TO LOC
SUPPLY VENTS OR LINES

③ NOTE: LOCATE RETURN AIR
AS CLOSE TO FURNACE LO
CENTRALLY LOCATED, AS

④ NOTE: OUTSIDE COMPRESSOR
BE LOCATED AS CLOSE TO
AIR HANDLER, AS POSSIBLE.
COMPRESSOR TO BE MINIMU
FROM DRYER VENT, WHERE