10753

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Chris Shoobritge DATE 12-19-91 PERMIT NO. 5P-A-5

PHONE: Business ______ Home ______

LOCATION 64E TR Barry Oak TR Elmwood 1.8mi TR back out in field behind Ex. House S. R. No. ______

SUBDIVISION NAME ______ LOT NO. ______ SECTION OR BLOCK NO. ______

House (✓) Mobile Home ( ) Business ( ) Other ______

No. Bedrooms 4 No. Bathrooms 3

Garbage Disposal Unit Yes ( ) No (✓)

Auto. Dishwasher Yes (✓) No ( )

Auto. Wash. Machine Yes (✓) No ( )

Site Suitable Yes (✓) No ( )

Character & Porosity of Soil Clayey

Percolation Rate .2

Topography 2to10%

Depth to Water Table 10'+

Rock or other impervious formations None

Lot Area 23 acres

Basement with Plumbing ______ Basement without Plumbing ______ No Basement ______

3' X 150'

Size of Tank 1250 Gals.

Nitrification Field: 9


No. of Lines ______

Sq. Ft. 3600 Linear Ft. 1200

Depth of Stone in Lines 12"

Water Supply: Individual (✓)

Public ( )

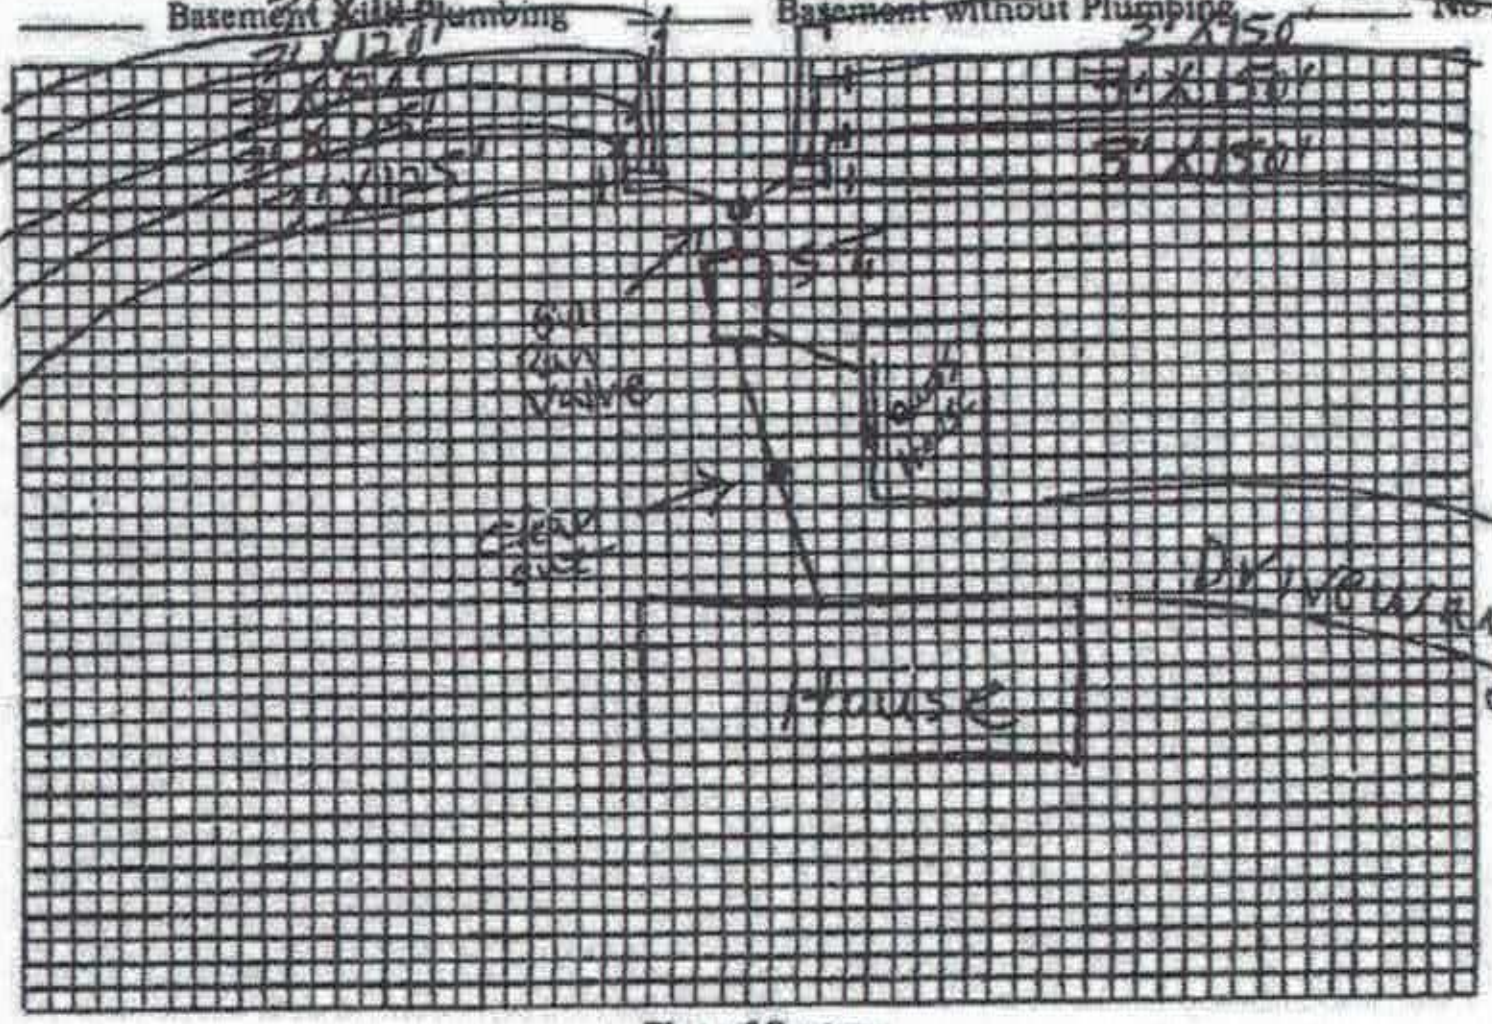

Plot of System

Installed by Eddie Yountz + Sons

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: ______

IMPROVEMENTS PERMIT BY J. C. Moore

COMMENTS: Switch valve every 6 mos.

CERTIFICATE OF COMPLETION BY J. C. Moore DATE 12-19-91

EXISTING SYSTEM CHECKED BY: ______ DATE ______

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold