
PUMP TANK DESIGN

SPRING FOREST #26

ATTACHMENT TO PROPERTY DESCRIPTION # 12|204

TAX MAP # 4775-05-0198

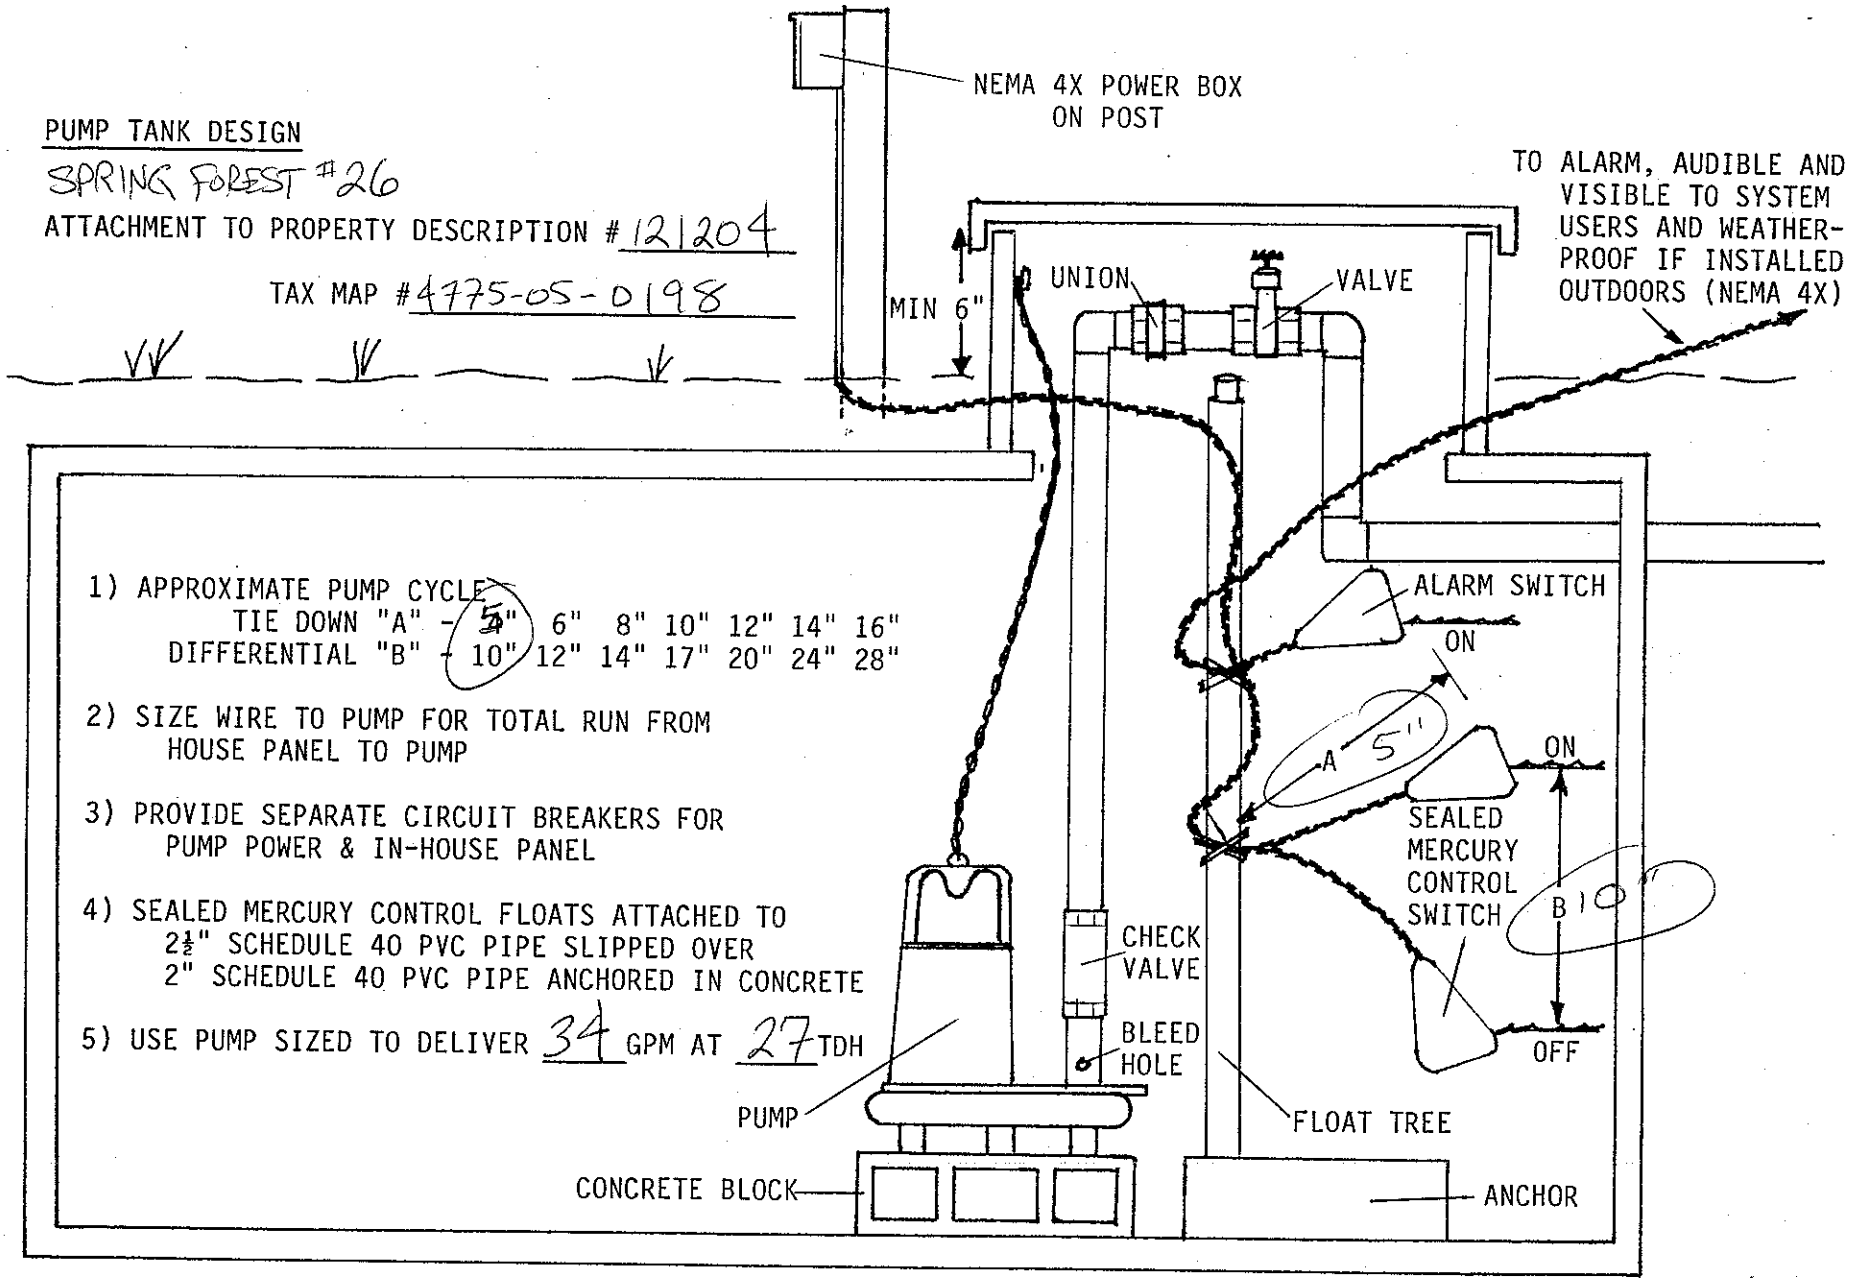

1) APPROXIMATE PUMP CYCLE
   TIE DOWN "A" - ~~5~~" 6" 8" 10" 12" 14" 16"
   DIFFERENTIAL "B" - 10" 12" 14" 17" 20" 24" 28"

2) SIZE WIRE TO PUMP FOR TOTAL RUN FROM HOUSE PANEL TO PUMP

3) PROVIDE SEPARATE CIRCUIT BREAKERS FOR PUMP POWER & IN-HOUSE PANEL

4) SEALED MERCURY CONTROL FLOATS ATTACHED TO
   2½" SCHEDULE 40 PVC PIPE SLIPPED OVER
   2" SCHEDULE 40 PVC PIPE ANCHORED IN CONCRETE


5) USE PUMP SIZED TO DELIVER 34 GPM AT 27 TDH

PRESSURE MANIFOLD DESIGN

SPRING FOREST #26

ATTACHMENT TO P.D.# 121209

TAX MAP # 4775-05-0198

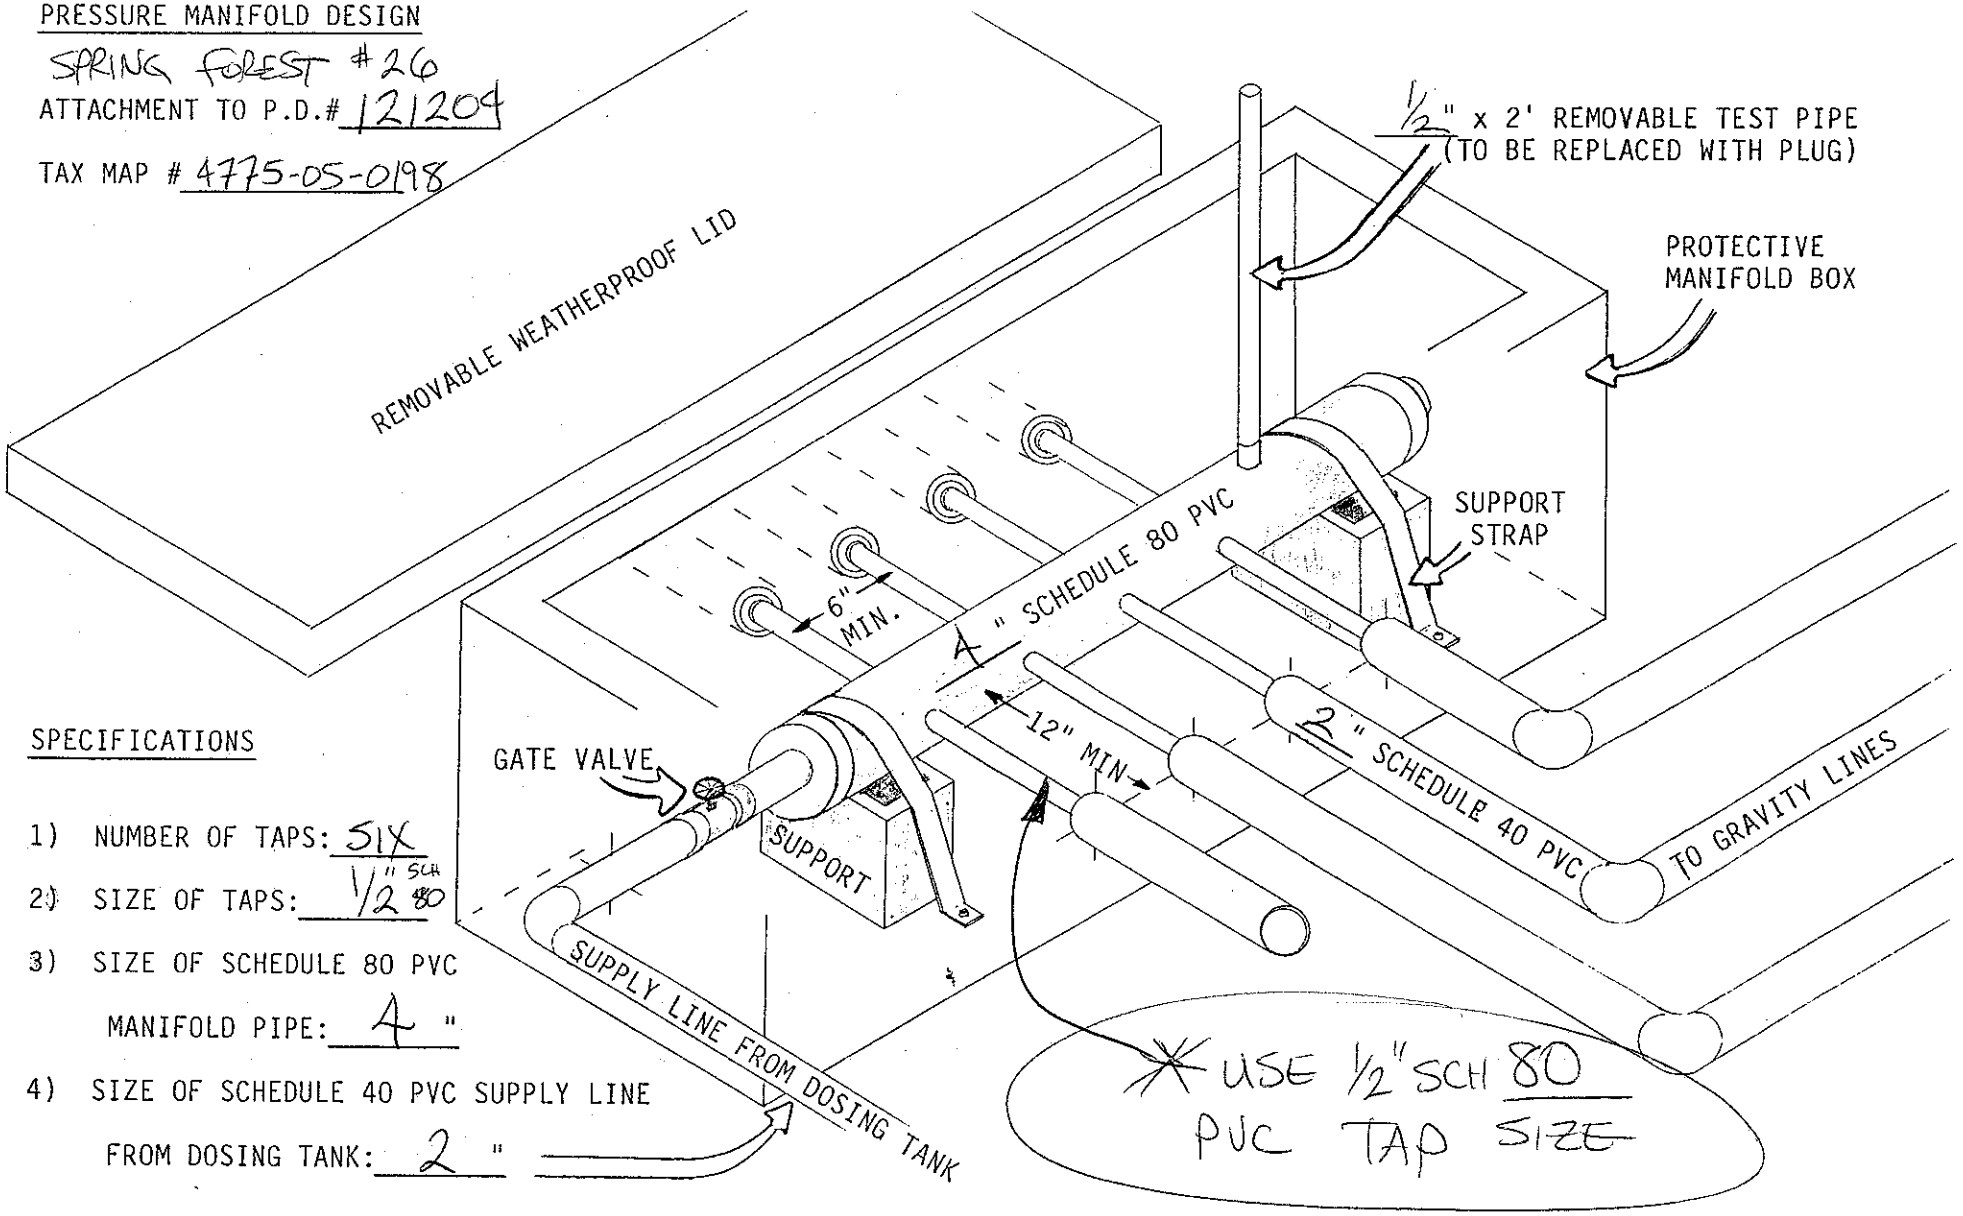

SPECIFICATIONS

1) NUMBER OF TAPS: SIX

2) SIZE OF TAPS: 1/2" SCH 80

3) SIZE OF SCHEDULE 80 PVC
MANIFOLD PIPE: 4 "

4) SIZE OF SCHEDULE 40 PVC SUPPLY LINE
FROM DOSING TANK: 2 "