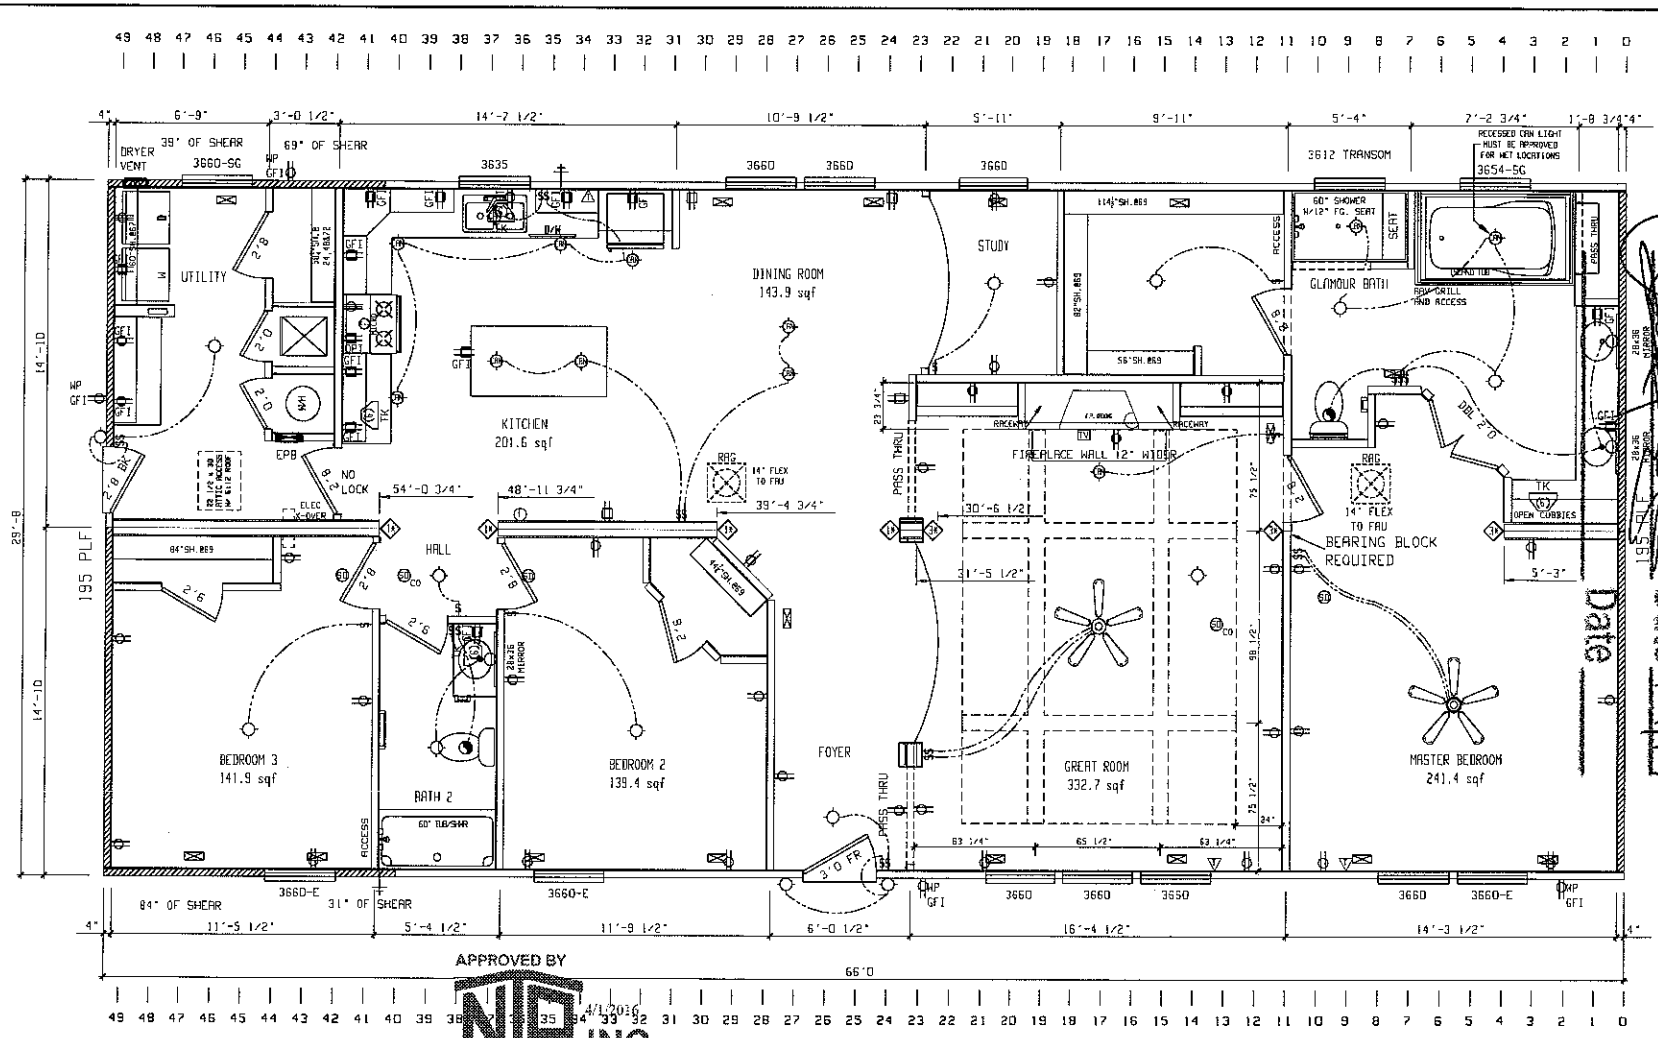


Acknowledgement Of Plans Submittal ONLY
Date 3/27/17
Date

APPROVED BY
NTA INC.
4/1/2016
Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws
David Richter

195PLF EFFECTIVE LENGHTS
BASED ON SW-31.10._.N.C.17._.78.1-2
ENGINEERED METHOD.
UNBLOCKED DIAPHRAGM SW-20-389B.1

DESIGN LOADS WIND-ROOF PSF
90-30
120-30
136-30

RETURN AIR REQUIREMENTS
1. 20"x16" GRILL REQUIRED
2. 4"x10" GRILL W/ 2 1/2" DOOR UNDERCUT
3. DOOR(S) MUST BE UNDERCUT 2 1/2" MIN.
4. 4"x24" OR 6"x14" GRILL REQUIRED

◇ INDICATES REQUIRED NUMBER OF STUDS IN COLUMN
◈ THE # SPECIFIES THAT THERE CAN BE NO HOLES IN STUDS IN COLUMNS

BRAND	SERIES
SCHULT	MD32

CLAYTON HOME BUILDING GROUP

REVISIONS	BY	DATE

GENERAL NOTES
CEILING HEIGHT = 108.0
FLOOR FRAMING SPACING = 16
TOTAL WINDOW SQFT = ENTER TOTAL CALCULATED

DRAWING TITLE
MASTER PLAN

MODEL NAME			SQ. FT.
			1958
PLANT	DESCRIPTION		MODEL NO.
958	32X66 3BR-2BA		SN248005
DRAWN BY	ORIG. DATE	DATE PRINTED	SHEET NO.
TXH	03/25/2016	04/01/2016	1-1