DEPARTMENT OF ENVIRONMENT AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

4778-79-6936

Sheet 1 of ___
PROPERTY ID #: ___
COUNTY: IRE

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: FLEETWOOD
ADDRESS: 1270 NORTHSIDE 28625
PROPOSED FACILITY: 3BR
PROPOSED DESIGN FLOW (.1949): 360
LOCATION OF SITE: US 21N TR MT BETHEL ~2MI ON RT.
WATER SUPPLY: ☐ Private ☑ Public ☐ Well ☐ Spring ☐ Other ROCKGATE #66
EVALUATION METHOD: ☑ Auger Boring ☐ Pit ☐ Cut
APPLICATION DATE 12/9/04
DATE EVALUATED: 1/21/05
PROPERTY SIZE: ___
PROPERTY RECORDED: Y
TYPE OF WASTEWATER: ☑ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	L	0-12	WK SBK CL	FR S/P SEXP	—	42"	—	—	PS 0.30
		12-30	MO SBK C	FR S/P SXP					
		30-42	MO SBK SL SAP	FR S/P SXP					
		42+	SL M SAP	—					
2	L	0-10	WK SBK SCL	FR S/P SXP	—	36"	—	—	PS 0.30
		10-26	MO SBK C	FR S/P SXP					
		26-36	MO SBK SL SAP	FR S/P SXP					
		36+	SL M SAP	—					
3	L	0-3	WK SBK SCL	FR S/P SXP	—	36"	—	—	PS 0.30
		3-36	MO SBK C	FR S/P SXP					
		36+	SL M SAP	—					
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	PS	PS
System Type(s)	CON GRAVITY	PUMP CONV.
Site LTAR	0.30	0.30

OTHER FACTORS (.1946): NO
SITE CLASSIFICATION (.1948): PS
EVALUATED BY: CS
OTHER(S) PRESENT: BRIAN SPURRIER

COMMENTS: ___

LEGEND

use the following standard abbreviations

LANDSCAPE POSITION	GROUP	SOIL TEXTURE	CONVENTIONAL .1955 LTAR*	LPP .1957 LTAR*	MINERALOGY/ CONSISTENCE	STRUCTURE
CC (Concave Slope)	I	S (Sand)	1.2 - 0.8	0.6 - 0.4	NEXP (Non-expansive)	G (Single Grain)
CV (Convex Slope)		LS (Loamy Sand)			SEXP (Slightly Expansive)	M (Massive)
D (Drainage Way)					EXP (Expansive)	CR (Crumb)
DS (Debris Slump)	II	SL (Sandy Loam)	0.8 - 0.6	0.4 - 0.3		GR (Granular)
FP (Flood Plain)		L (Loam)				SBK (Subangular Blocky)
FS (Foot Slope)						ABK (Angular Blocky)
H (Head Slope)	III	Si (Silt)	0.6 - 0.3	0.3 - 0.15		PL (Platy)
L (Linear Slope)		SiCL (Silty Clay Loam)				PR (Prismatic)
N (Nose Slope)		CL (Clay Loam)				
R (Ridge)		SCL (Sandy Clay Loam)			**MOIST**	**WET**
S (Shoulder Slope)		SiL (Silt Loam)				
T (Terrace)					VFR (Very Friable)	NS (Non-sticky)
	IV	SC (Sandy Clay)	0.4 - 0.1	0.2 - 0.05	FR (Friable)	SS (Slightly Sticky)
		SiC (Silty Clay)			FI (Firm)	S (Sticky)
		C (Clay)			VFI (Very Firm v. Very Sticky)	VS (Very Sticky)
		O (Organic)	None	None	EFI (Extremely Firm)	NP (Non-plastic)
						SP (Slightly Plastic)
						P (Plastic)
						VP (Very Plastic)

*Adjust LTAR due to depth, consistence, structure, soil wetness, landscape, position, wastewater flow and quality.


NOTES

HORIZON DEPTH	In inches below natural soil surface
DEPTH OF FILL	In inches from land surface
RESTRICTIVE HORIZON	Thickness and depth from land surface
SAPROLITE	S(suitable) or U(unsuitable)
SOIL WETNESS	Inches from land surface to free water or inches from land surface to soil colors with chroma 2 or less - record Munsell color chip designation
CLASSIFICATION	S (Suitable), PS (Provisionally Suitable), or U (Unsuitable)

Evaluation of saprolite shall be by pits.

Long-term Acceptance Rate (LTAR): gal/day/ft^2

Show profile locations and other site features (dimensions, reference or benchmark, and North).

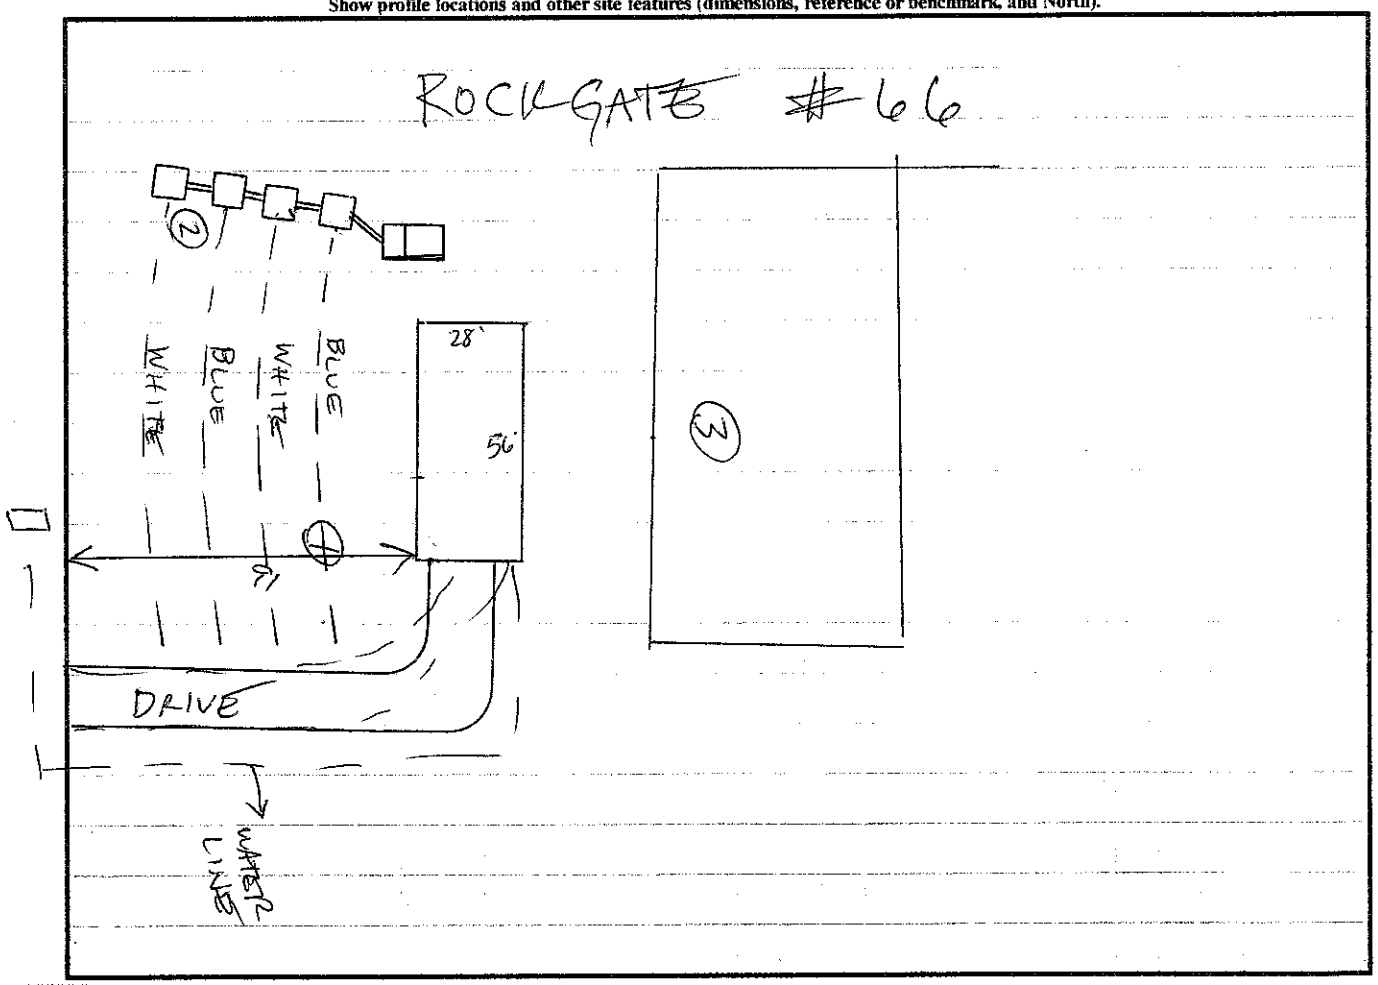

DENR (######)
Review (#####)