IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Dale Pharr DATE 6-21-83 PERMIT NO. _____

PHONE: Business _____ Home _____

LOCATION 64E TR on Barry Oak Rd Then TR on Longview Rd 1.3 mi on R behind house on Road S. R. No.

SUBDIVISION NAME _____ LOT NO. _____ SECTION OR BLOCK NO. _____

House (✓) Mobile Home ( ) Business ( ) Other _____


No. Bedrooms 3 No. Bathrooms 3

Garbage Disposal Unit Yes ( ) No (✓)
Auto. Dishwasher Yes (✓) No ( )
Auto. Wash. Machine Yes (✓) No ( )
Site Suitable Yes (✓) No ( )

Character & Porosity of Soil Clay Class IV
Percolation Rate .2 to .3 gpd/sq' Hwy
Topography 2 to 6%
Depth to Water Table 10'+
Rock or other impervious formations none

Lot Area 4 acres

✓ Basement with Plumbing both has lift pump ____ Basement without Plumbing ____ No Basement

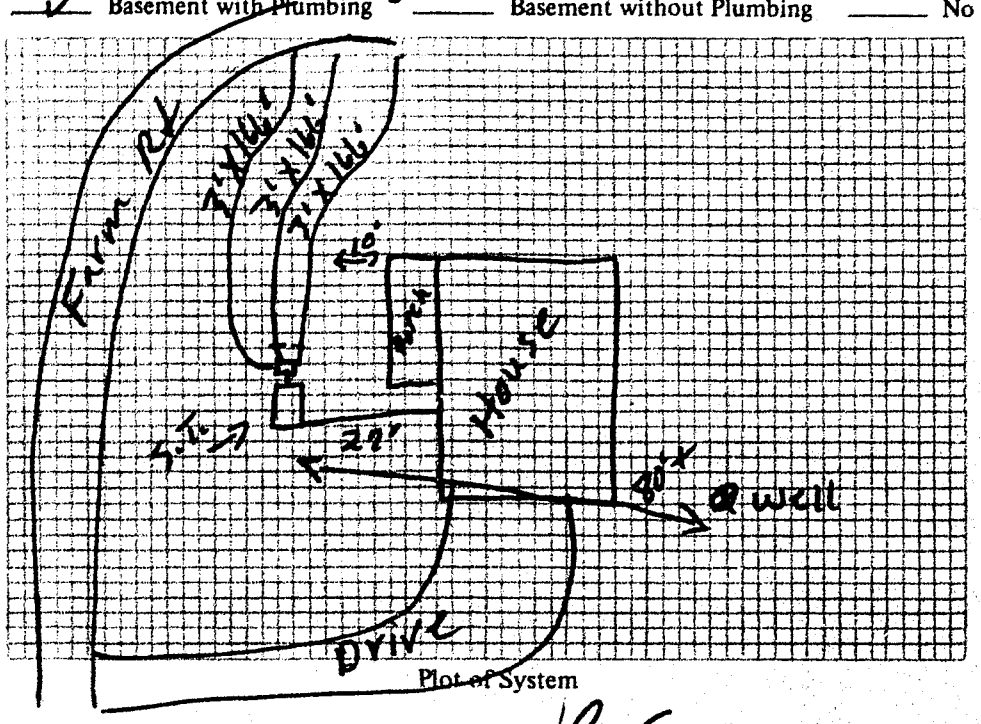

Plot of System

Size of Tank 1000 Gals.
Nitrification Field:
No. of Lines 3
Sq. Ft. 1500 Linear Ft. 500
Depth of Stone in Lines 12"
Water Supply: Individual (✓)
Public ( )

Installed by Kenneth Chaffin

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

IMPROVEMENTS PERMIT BY L. C. Moore

COMMENTS: _____

CERTIFICATE OF COMPLETION BY L. C. Moore DATE 6-21-83

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold