H.D copy

IREDELL COUNTY HEALTH DEPARTMENT

STATESVILLE 704-878-5305 MOORESVILLE 704-664-5281

IMPROVEMENT PERMIT / AUTHORIZATION TO CONSTRUCT / OPERATION PERMIT / EXISTING SYSTEM INSPECTION

PERMIT # 19341 PIN # 4821158127 DATE 2-10-09

OWNER or APPLICANT [illegible] PHONE: Business Home: 704 902 5253

OWNER or APPLICANT ADDRESS 1460 [illegible]

LOCATION / DIRECTIONS 77 N [illegible] 54 [illegible] 21 [illegible] (L) on [illegible] (L) on [illegible] at 1460

SUBDIVISION n/a BLOCK / SECTION n/a LOT # n/a LOT AREA DESIGN FLOW 360 L.T.A.R. .3

Septic Tank 1000	Gallons: STB	Date	☐ New System ☐ Repair ☐ Expansion System Type I II III IV V VI	☒ Residence No. Bedrooms 3	Water Supply
Pump Tank	Gallons: P.T.	Date	System Description: Conventional Gravity	☐ Business No. Persons	☒ Private
Pump Make	Model	Serial #	Repair System Description: Conventional Gravity	☐ Other No. Employees	☐ Public
Nitrification Field No Fields 1	No Lines 4	Linear Feet 400	Maintenance Agreement Required ☐ YES ☒ NO	☒ Slab ☐ Crawl Space	☐ Community
Trench Width 3'	Max. Trench Bottom Depth 36	Gravel Depth 12	☒ GRAVITY ☐ PRESSURE	☐ Basement w/plumbing ☐ Basement w/o plumbing	

Comments / Conditions

Comments / Conditions

The ~~proposed~~ / existing META/ storage building addition does not appear to impact the existing septic system.


**NOTE:


[signature] REHS

Date: 6-18-2010

ICHD-Environmental Health Division

INITIAL SITE SKETCH

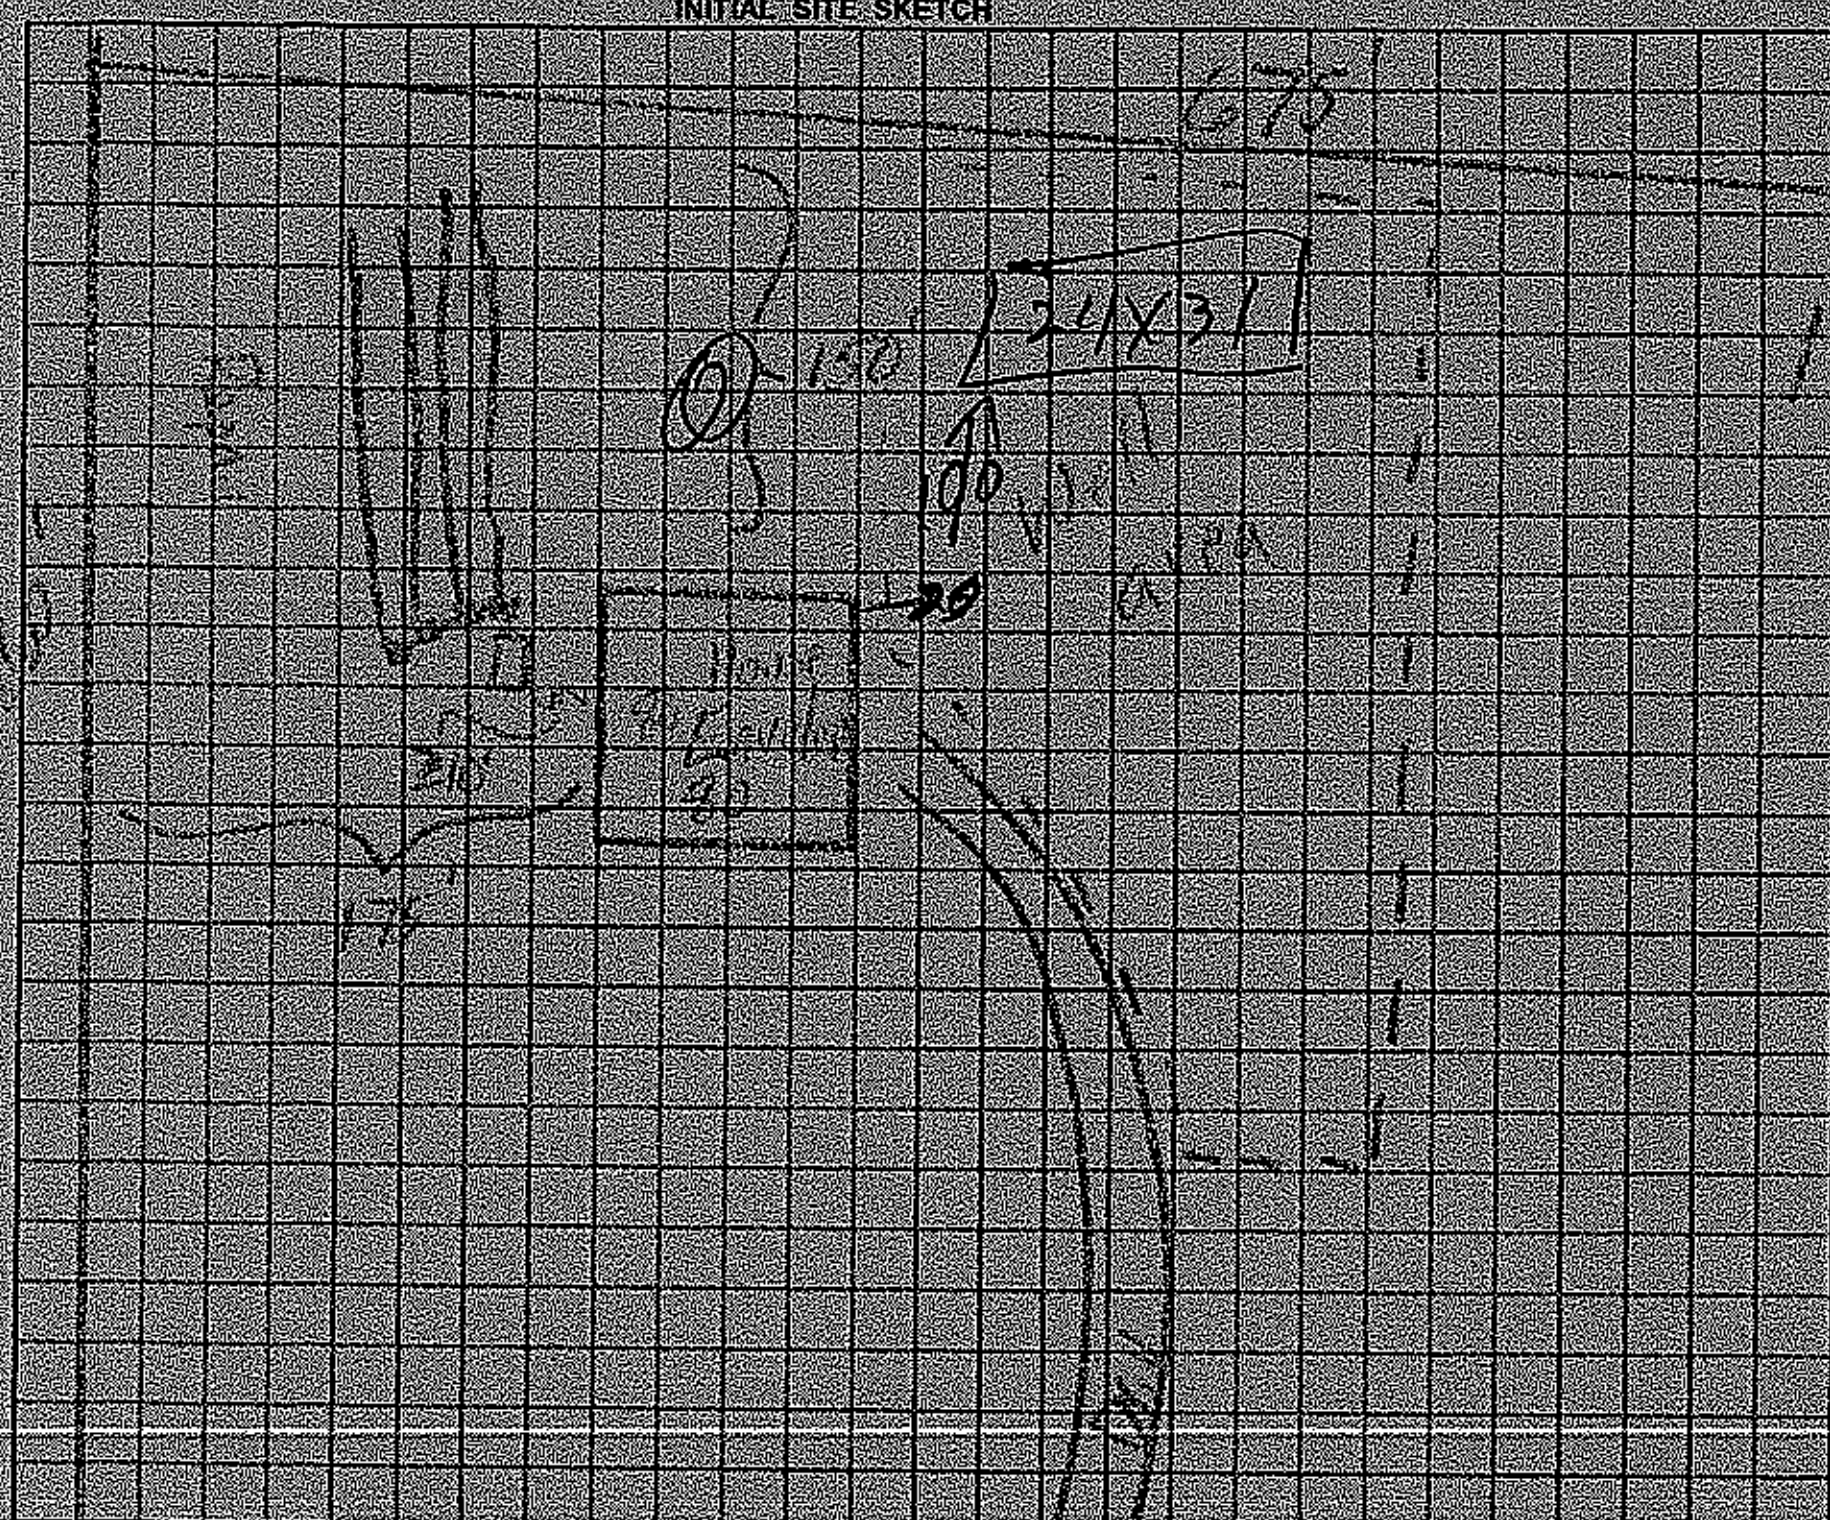

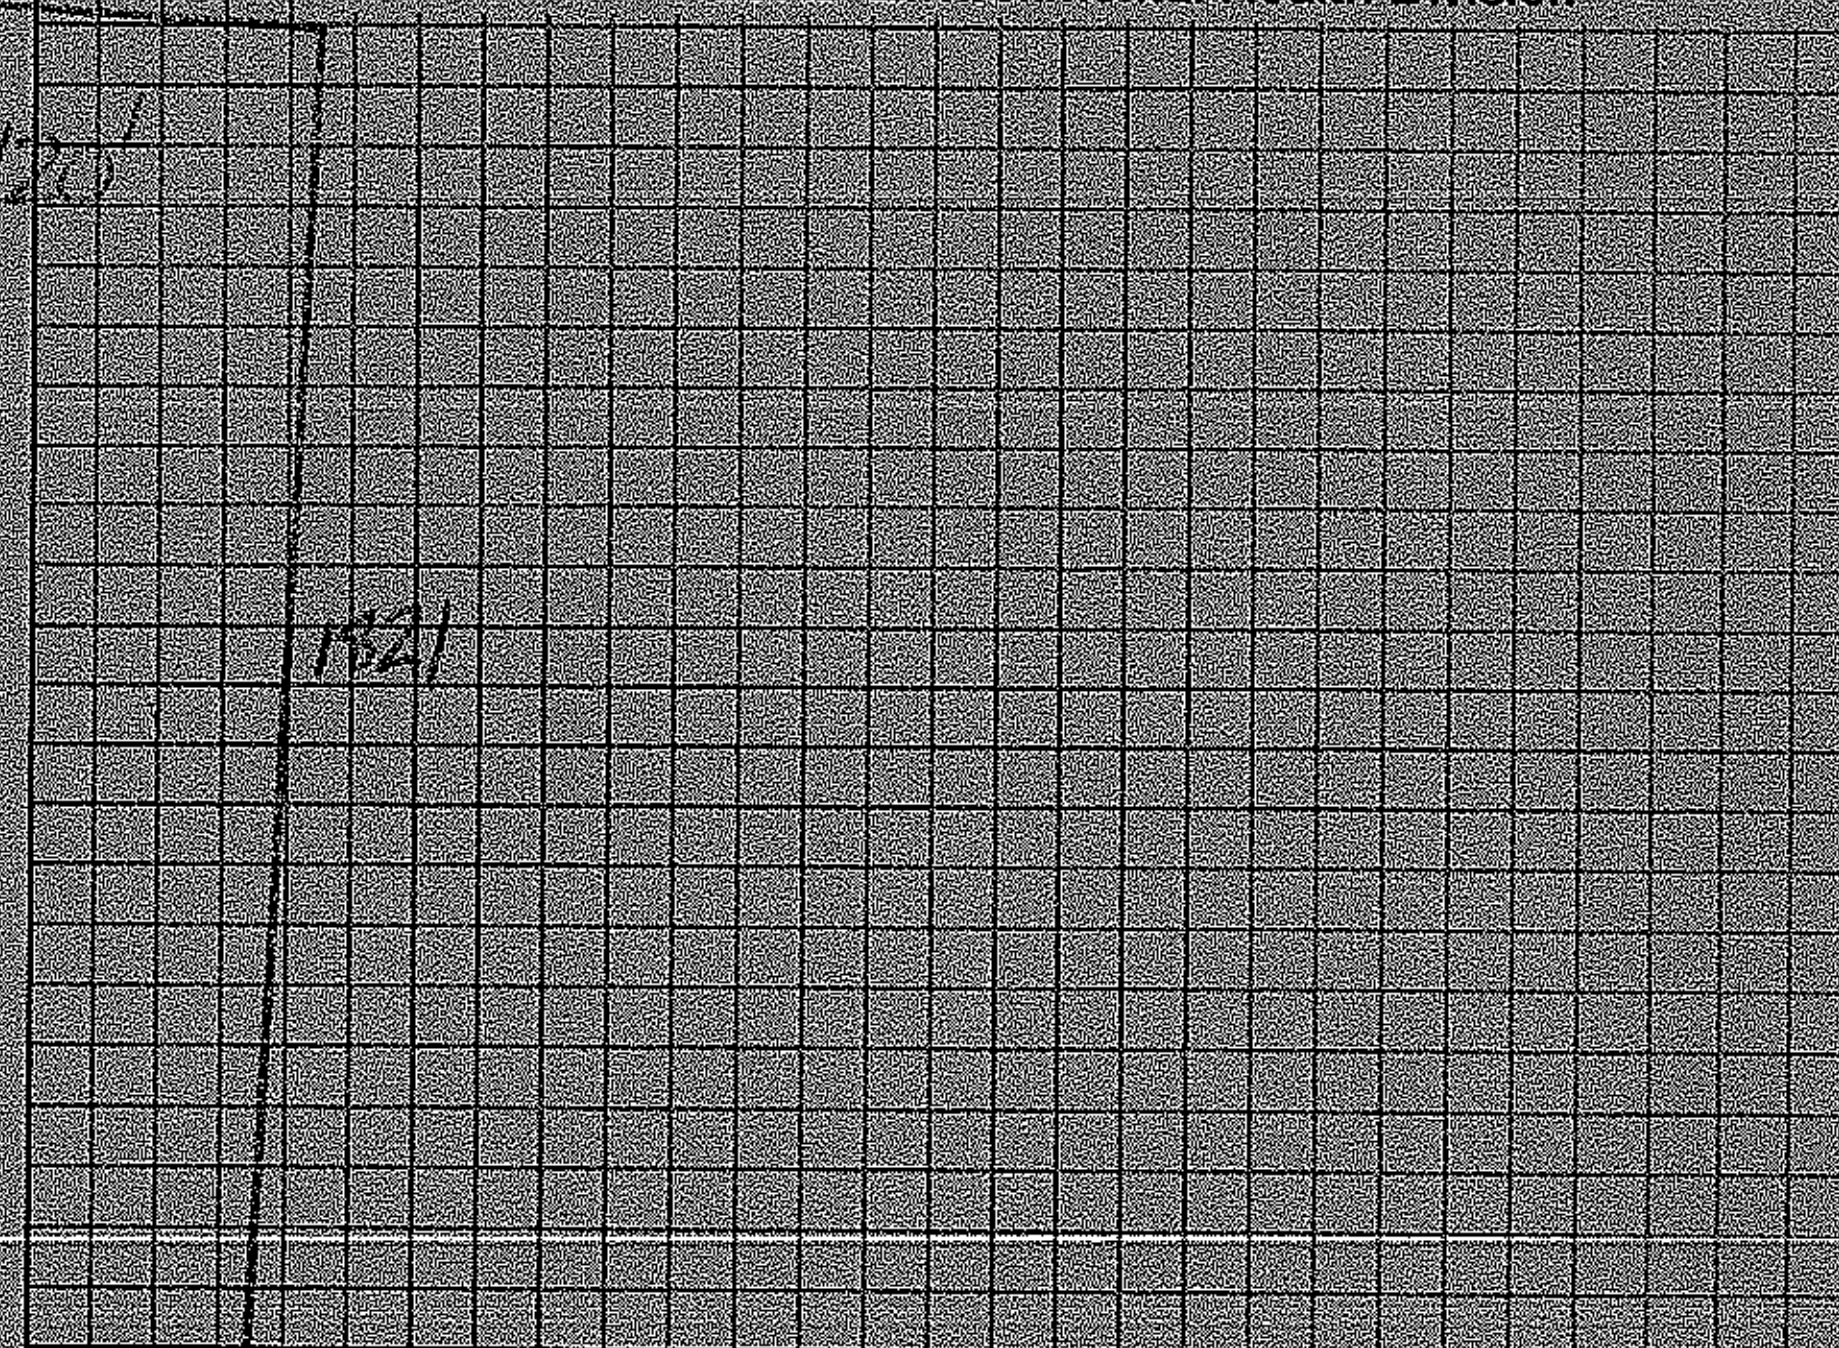

Permit can be suspended or revoked if any false information is supplied toward securing the permit / any unauthorized changes are made to the site / any unauthorized changes are made in the installation of the system.

☐ IMPROVEMENT PERMIT w / plat valid without expiration ☒ IMPROVEMENT PERMIT w / site plan valid for 60 mos. ☒ AUTHORIZATION TO CONSTRUCT valid for period equal to IMPROVEMENT PERMIT not to exceed 60 mo.

Owner / Applicant Signature: [signature] Date 2-10-09 Installed by:

Improvement Permit by: [signature] Date 2-10-09 Operation Permit by: Date:

Authorization to Construct by: [signature] Date 2-10-09 Existing System Inspected by: Date:

YOU SHOULD CONTACT A LOCATOR SERVICE PRIOR TO ANY EXCAVATION.

WHITE COPY Environmental Health YELLOW COPY (Final) Owner / Applicant PINK COPY (Initial) Owner / Applicant