
PRESSURE MANIFOLD DESIGN

ATTACHMENT TO P.D.# 211748

TAX MAP # 4832917399

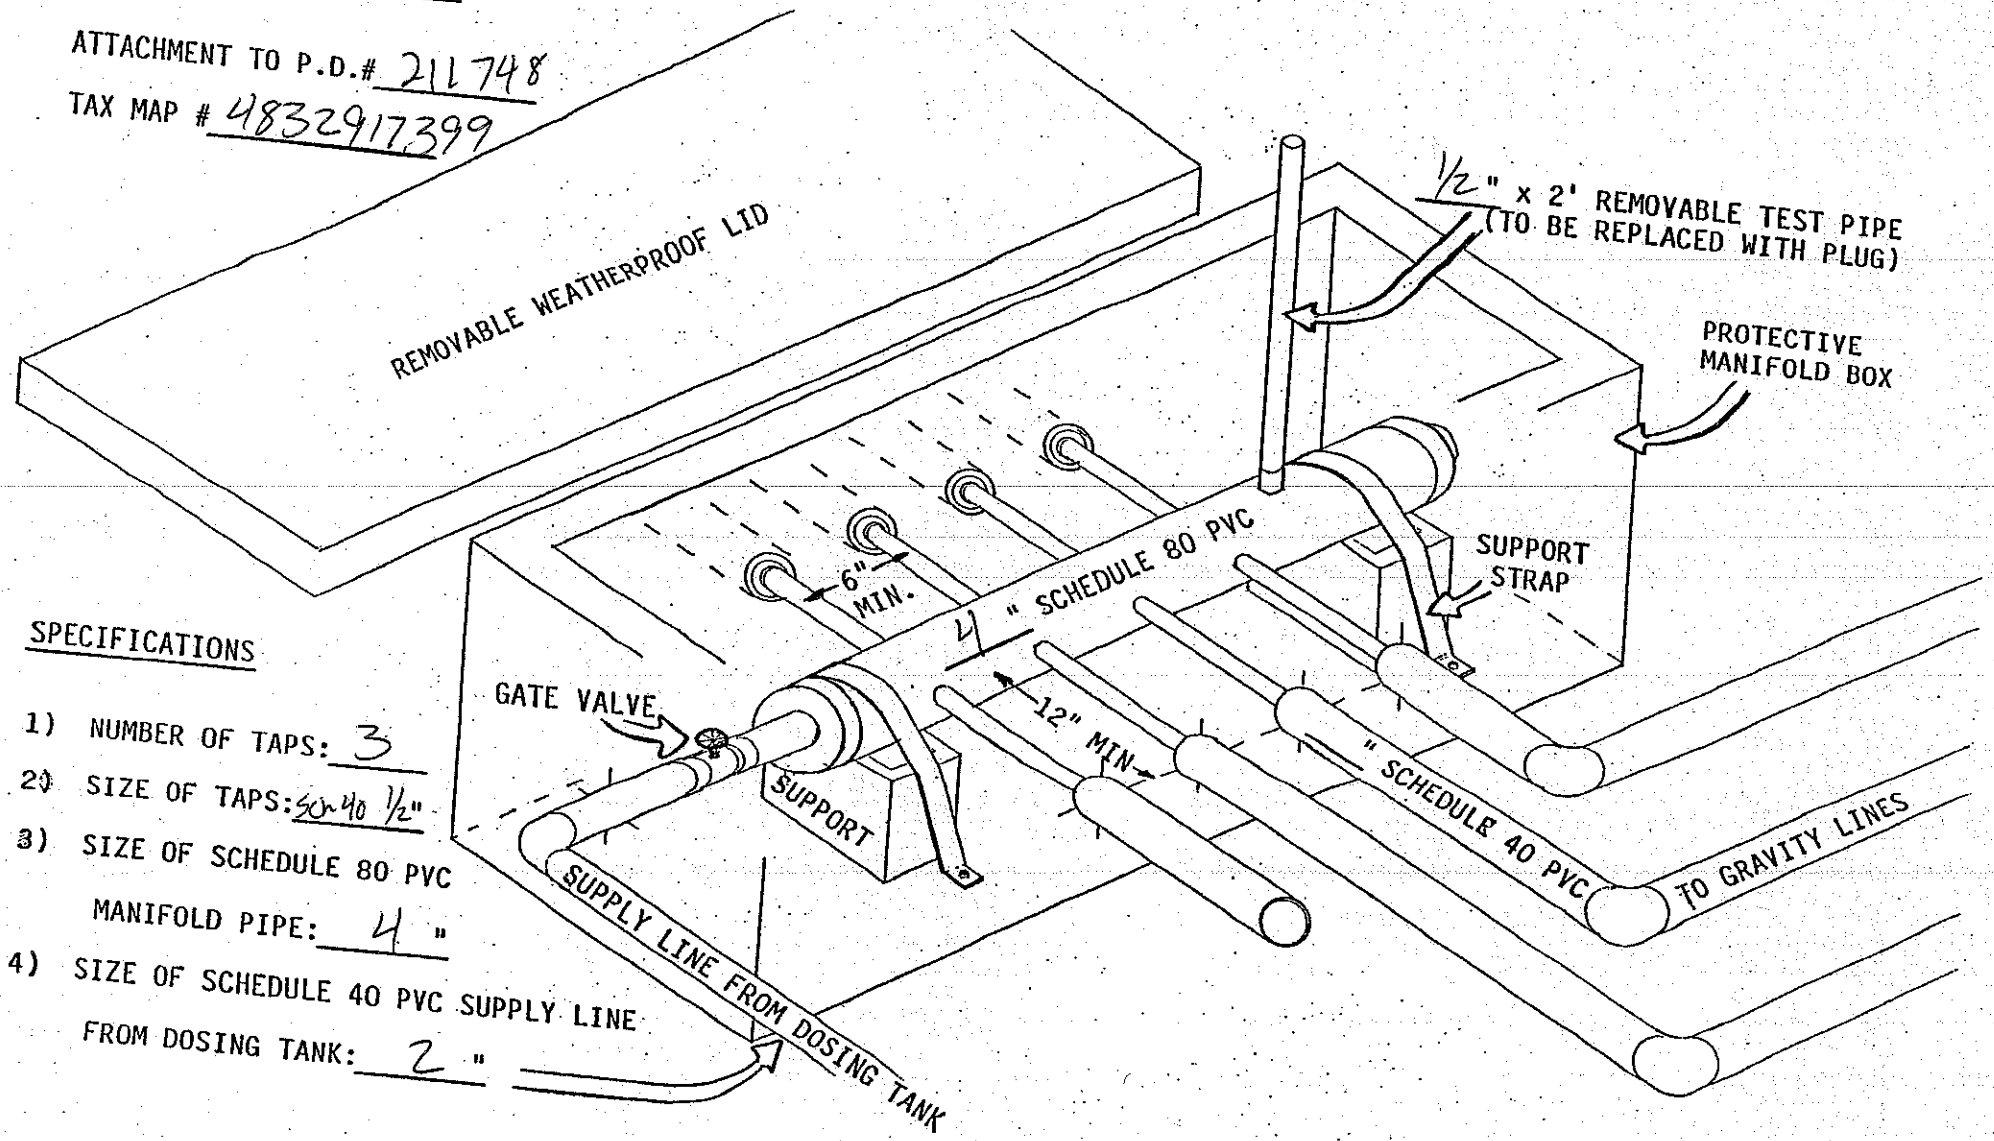


SPECIFICATIONS

1) NUMBER OF TAPS: 3
2) SIZE OF TAPS: Sch 40 1/2"
3) SIZE OF SCHEDULE 80 PVC MANIFOLD PIPE: 4 "
4) SIZE OF SCHEDULE 40 PVC SUPPLY LINE FROM DOSING TANK: 2 "

PUMP TANK DESIGN

ATTACHMENT TO PROPERTY DESCRIPTION # 211748

TAX MAP # 48329173399

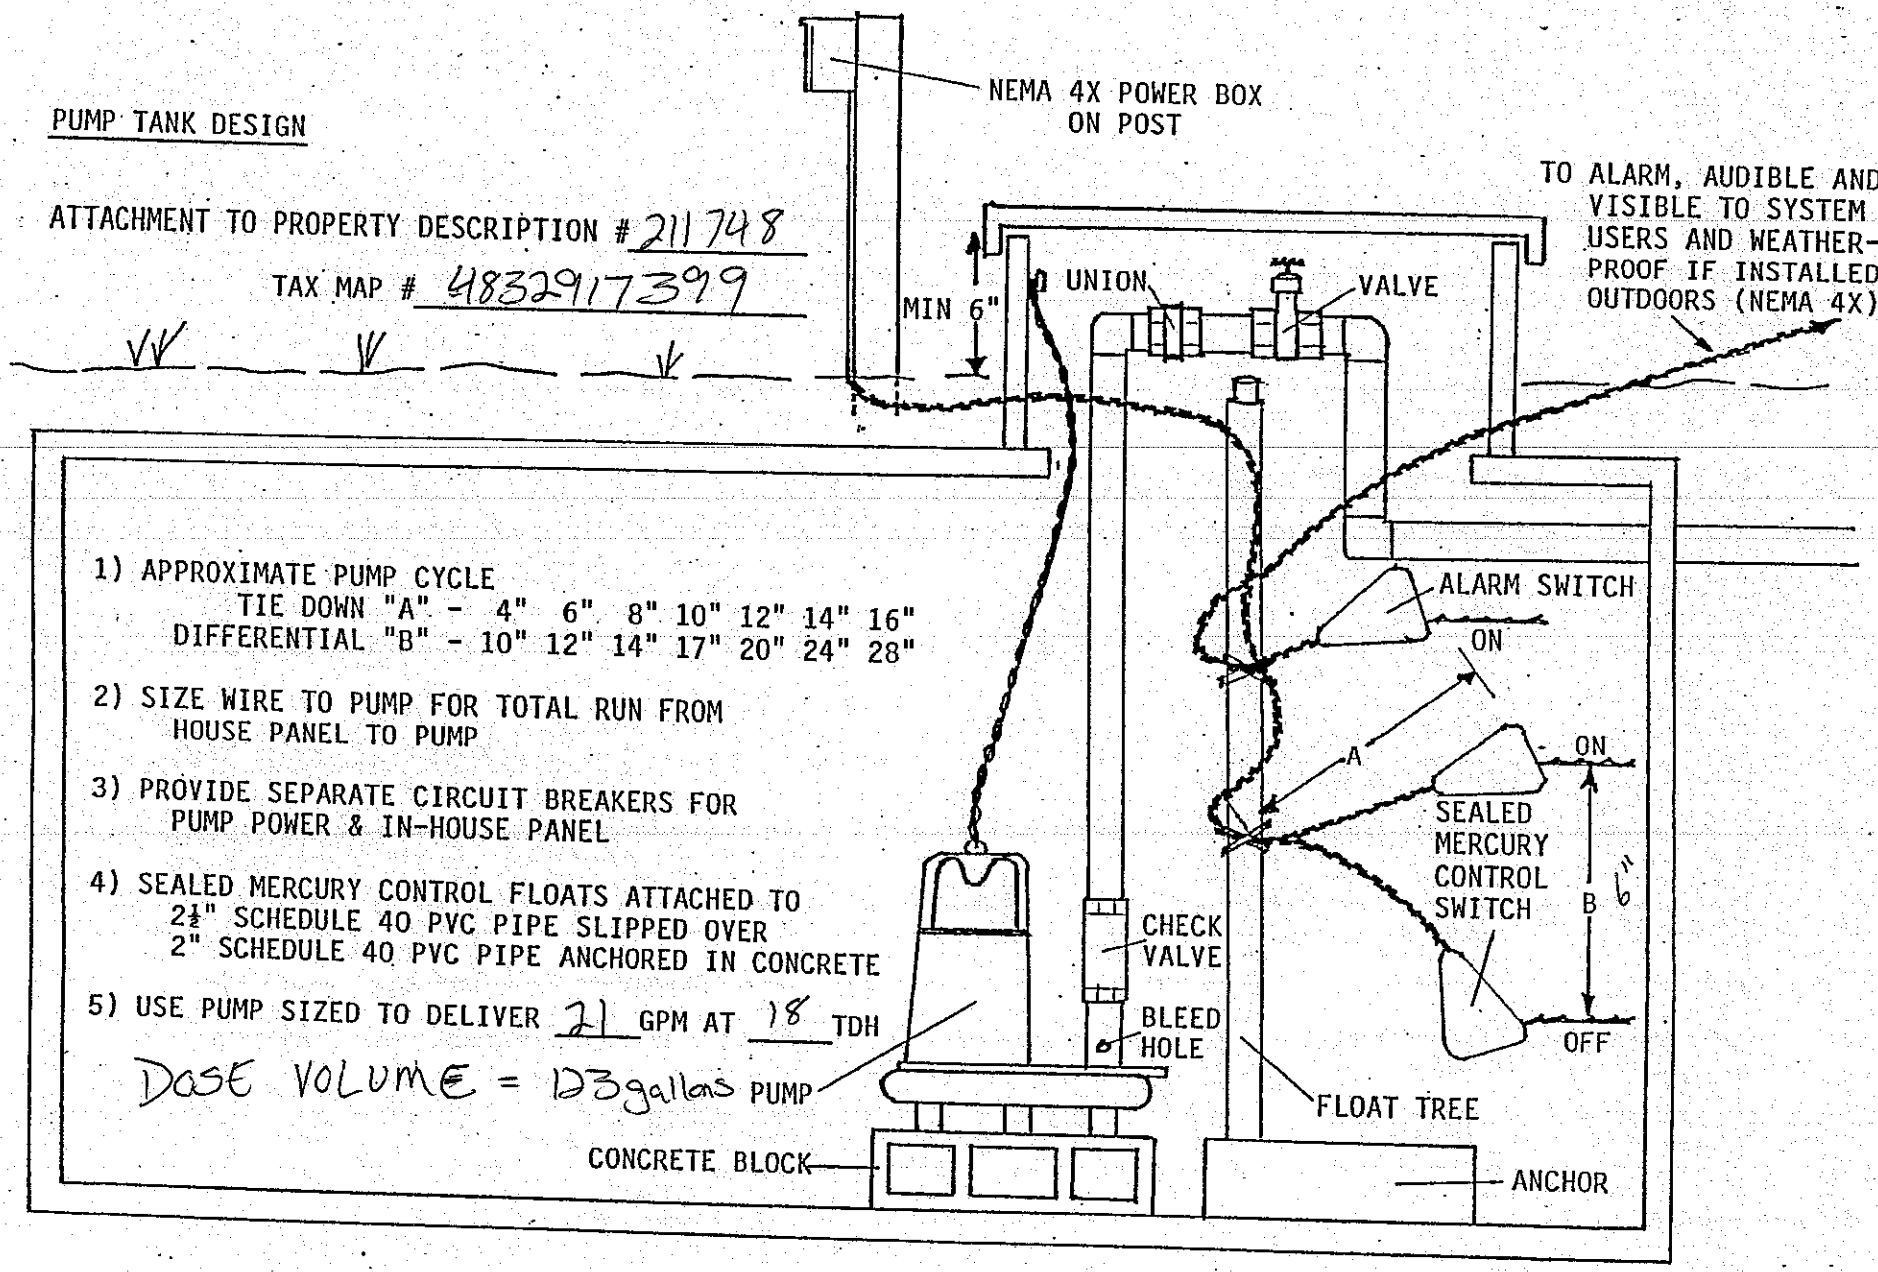

1) APPROXIMATE PUMP CYCLE
   TIE DOWN "A" - 4" 6" 8" 10" 12" 14" 16"
   DIFFERENTIAL "B" - 10" 12" 14" 17" 20" 24" 28"

2) SIZE WIRE TO PUMP FOR TOTAL RUN FROM HOUSE PANEL TO PUMP

3) PROVIDE SEPARATE CIRCUIT BREAKERS FOR PUMP POWER & IN-HOUSE PANEL

4) SEALED MERCURY CONTROL FLOATS ATTACHED TO 2½" SCHEDULE 40 PVC PIPE SLIPPED OVER 2" SCHEDULE 40 PVC PIPE ANCHORED IN CONCRETE

5) USE PUMP SIZED TO DELIVER 21 GPM AT 18 TDH

DOSE VOLUME = 123 gallons PUMP