
PUMP TANK DESIGN

ATTACHMENT TO P.D.# 20830

TAX MAP #16H-A-64A

FOR: WISCO DIVERSIFIED

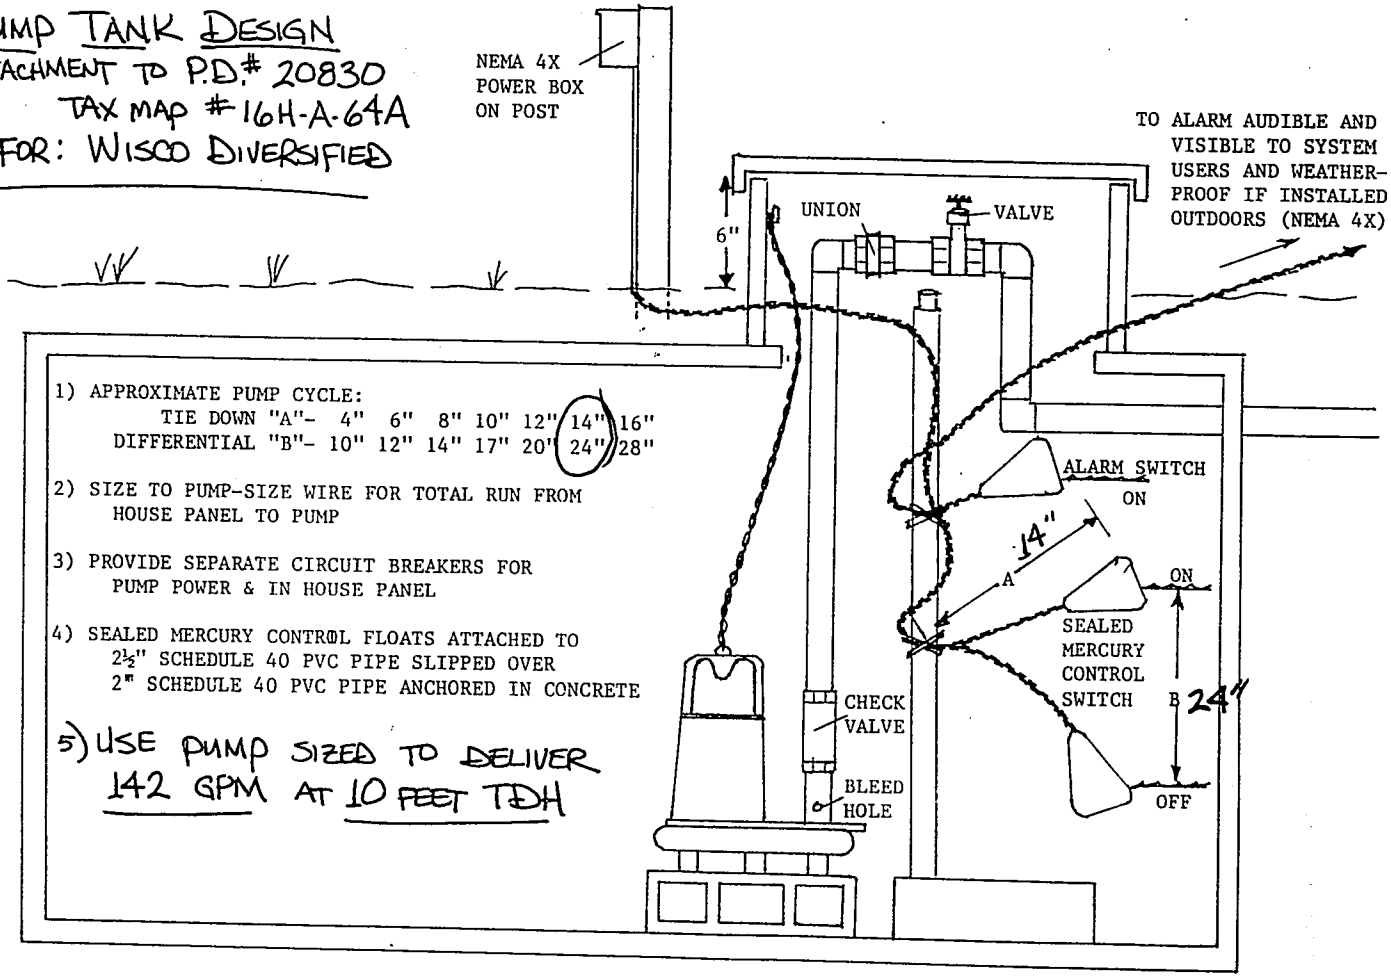

1) APPROXIMATE PUMP CYCLE:
   TIE DOWN "A"- 4" 6" 8" 10" 12" 14" 16"
   DIFFERENTIAL "B"- 10" 12" 14" 17" 20" 24" 28"

2) SIZE TO PUMP-SIZE WIRE FOR TOTAL RUN FROM HOUSE PANEL TO PUMP

3) PROVIDE SEPARATE CIRCUIT BREAKERS FOR PUMP POWER & IN HOUSE PANEL

4) SEALED MERCURY CONTROL FLOATS ATTACHED TO 2½" SCHEDULE 40 PVC PIPE SLIPPED OVER 2" SCHEDULE 40 PVC PIPE ANCHORED IN CONCRETE

5) USE PUMP SIZED TO DELIVER 142 GPM AT 10 FEET TDH

- PUMP TANK DESIGN -