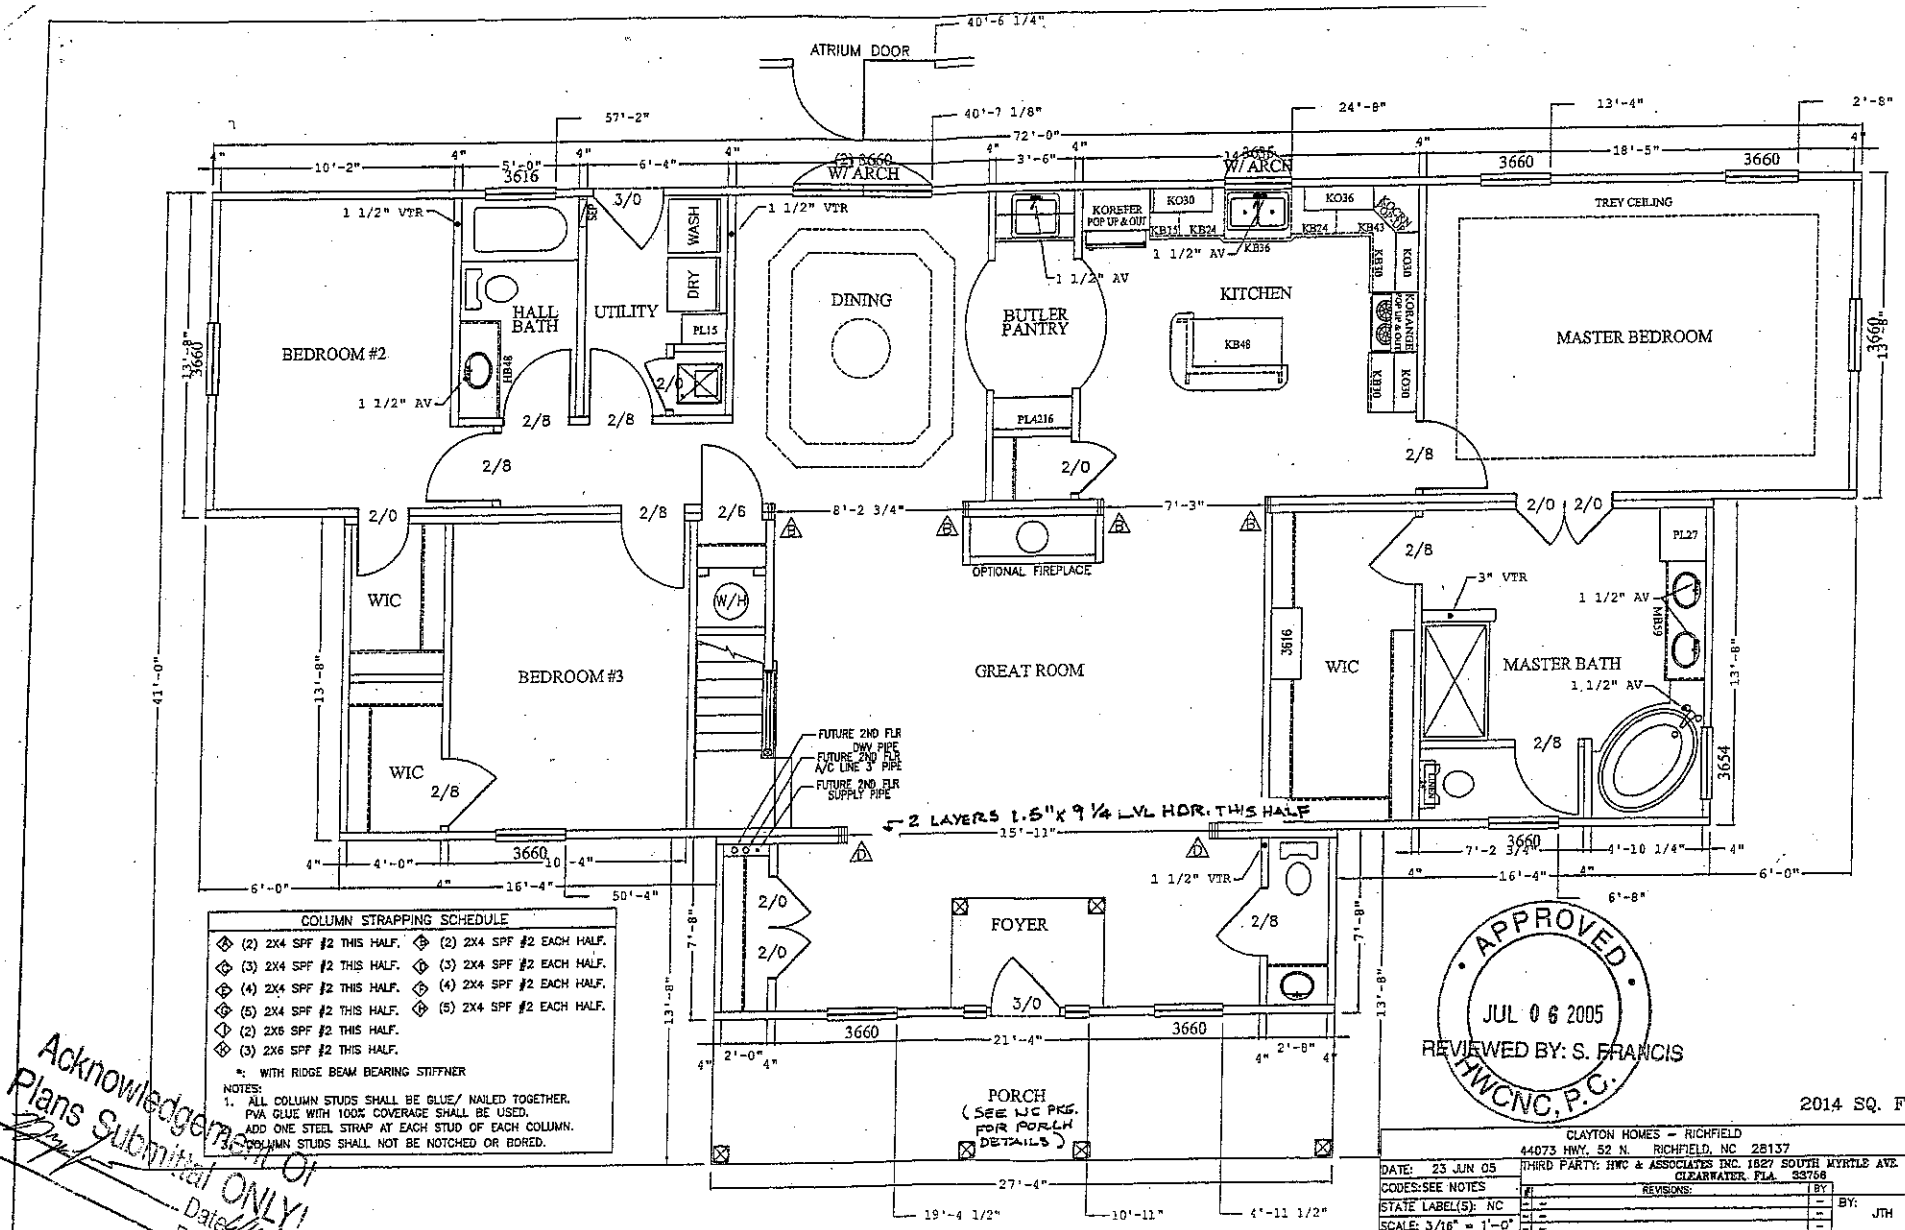


COLUMN STRAPPING SCHEDULE	
(2) 2X4 SPF #2 THIS HALF.	(2) 2X4 SPF #2 EACH HALF.
(3) 2X4 SPF #2 THIS HALF.	(3) 2X4 SPF #2 EACH HALF.
(4) 2X4 SPF #2 THIS HALF.	(4) 2X4 SPF #2 EACH HALF.
(5) 2X4 SPF #2 THIS HALF.	(5) 2X4 SPF #2 EACH HALF.
(2) 2X6 SPF #2 THIS HALF.	
(3) 2X6 SPF #2 THIS HALF.	

*: WITH RIDGE BEAM BEARING STIFFNER

NOTES:
1. ALL COLUMN STUDS SHALL BE GLUE/ NAILED TOGETHER. PVA GLUE WITH 100% COVERAGE SHALL BE USED. ADD ONE STEEL STRAP AT EACH STUD OF EACH COLUMN.
2. COLUMN STUDS SHALL NOT BE NOTCHED OR BORED.

Acknowledgement Of Plans Submittal ONLY!
Dwg Date 6/16/05
Date

APPROVED
JUL 06 2005
REVIEWED BY: S. FRANCIS
HWCNC, P.C.

2014 SQ. FT.

CLAYTON HOMES – RICHFIELD
44073 HWY. 52 N. RICHFIELD, NC 28137
THIRD PARTY: HWC & ASSOCIATES INC. 1627 SOUTH MYRTLE AVE. CLEARWATER, FLA. 33756

DATE: 23 JUN 05
CODES: SEE NOTES
STATE LABEL(S): NC
SCALE: 3/16" = 1'-0"

REVISIONS: | BY

BY: JTH

41'-0" x 72'-0" RESIDENTIAL MOD.

SHEET 4 OF 24

FLOOR PLAN

DRAWING #	Model #	JOB NO.
730NQ	MNJA7230	1868-3585