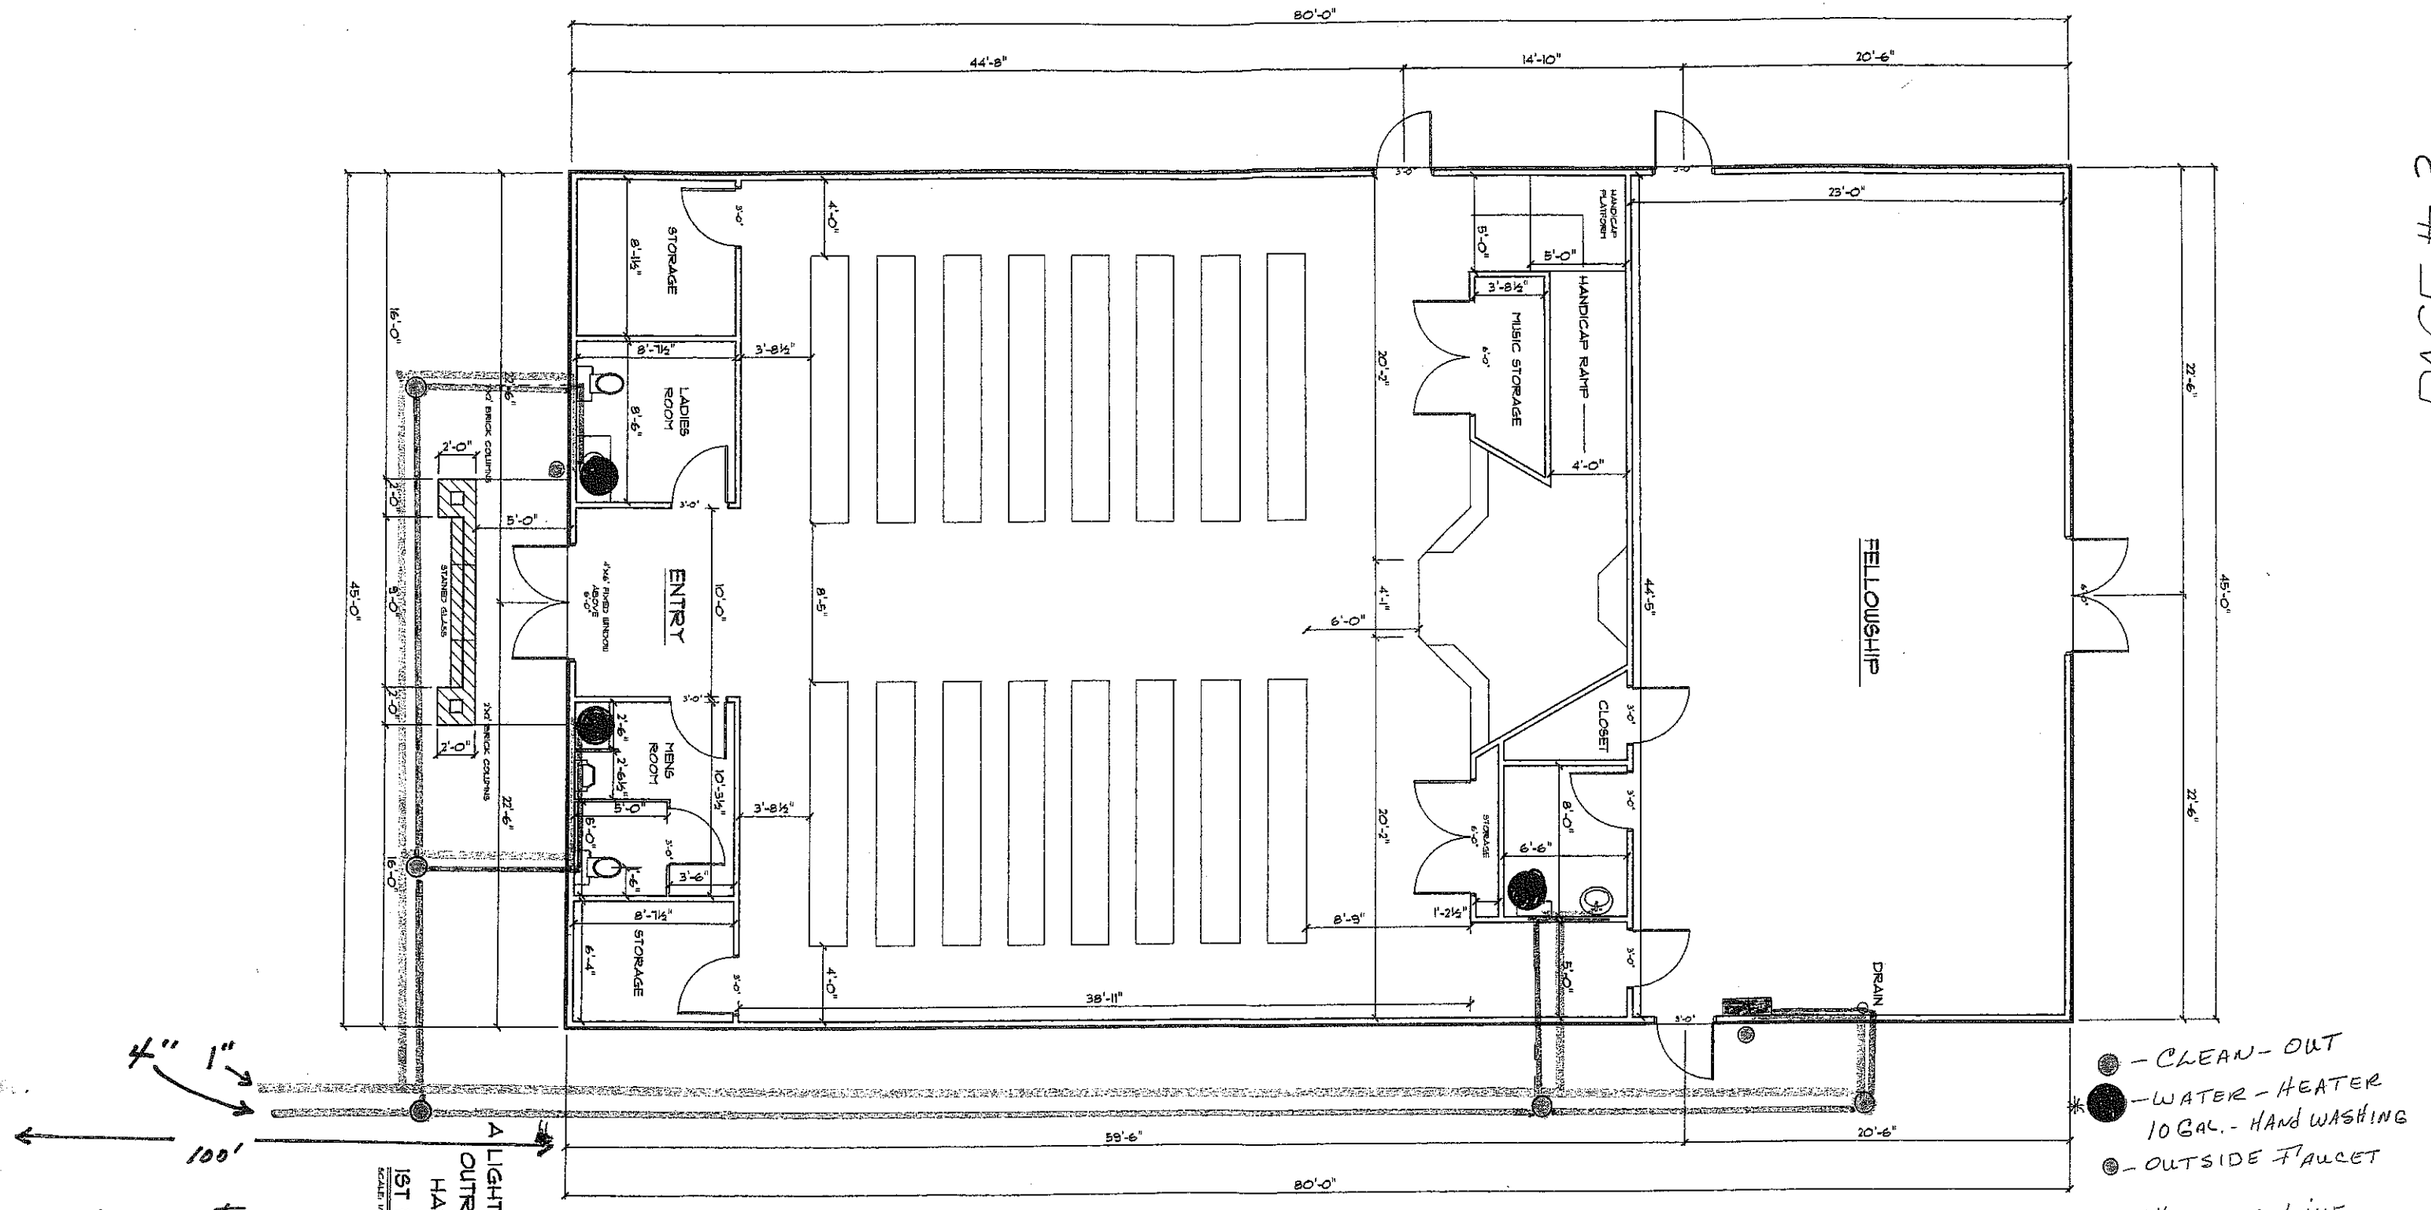


100' TO WATER AND SEWER LINE CITY

BACK FLOW PREVENTER PRESSURE REDUCTION VALVE AT MAIN

- — CLEAN-OUT
- * — WATER-HEATER 10 GAL. - HAND WASHING
- — OUTSIDE FAUCET
- 4" SEWER LINE
- 1" WATER LINE
- — HIGH-LOW DRINKING FOUNTAINS
- * - WATER HEATER PLACED IN ATTIC ON PAN AND DRAIN

Acknowledgement Of Plans Submittal ONLY!

Date 6-28-04

Date 6-30-04