
Acknowledgement Of Plans Submittal ONLY!

Date 1-29-13

Date 2-13-13

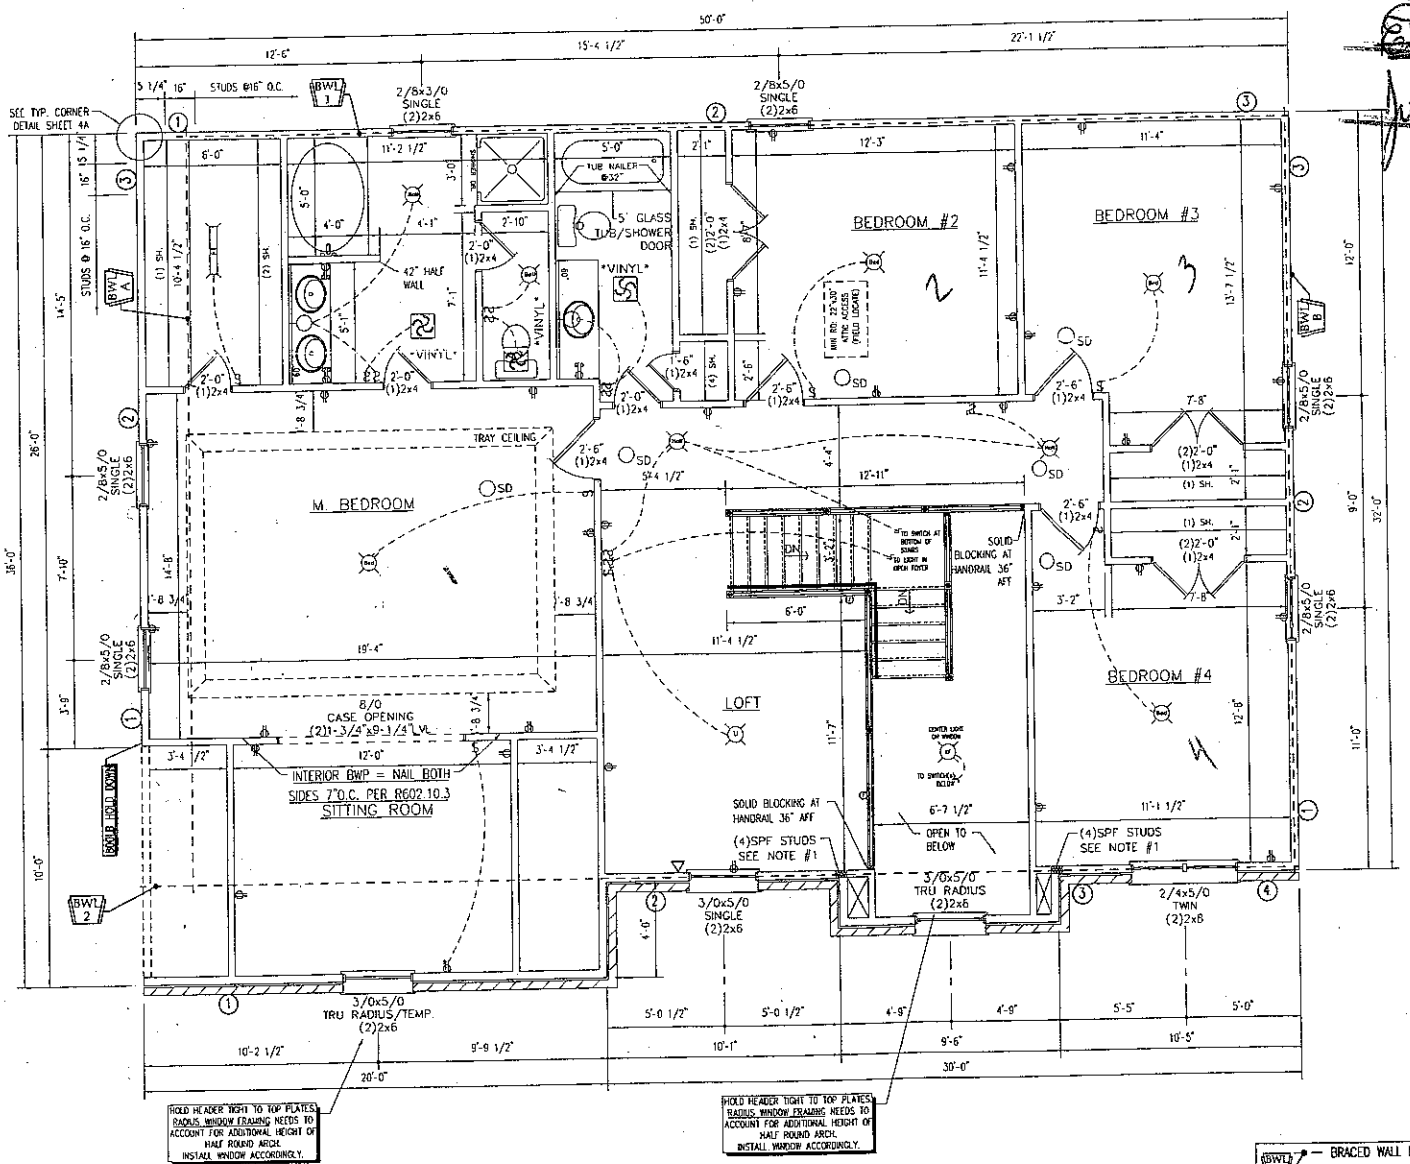

SECOND FLOOR PLAN = 1531 SQ. FT.

SCALE: 3/16" = 1'-0"

BRICK LINTEL SPANS
Per IRC Table R703.7.3

Steel Angle Size	No Story Above	1-Story Above	2-Stories Above
3"x3"x.25"	5'-6"	4'-6"	3'-6"
4"x3"x.25"	8'-0"	6'-0"	4'-6"
5"x3.5"x.3125"	10'-0"	8'-0"	6'-0"
6"x3.5"x.3125"	11'-0"	9'-6"	7'-0"
(2)6"x3.5"x.3125"	20'-0"	17'-0"	13'-6"

NC EXCP.	Min. Steel Angle Size	Max. Span
	3-1/2"x3-1/2"x1/4"	8'-0"
	5"x3-1/2"x5/16"	10'-0"

Spans not covered by this chart select lintel size to be used directly at the opening
NOTE: REFER TO LINTEL DETAIL PAGE 3A or 4A

NOTE:
1.NAIL TOGETHER w/ 16d NAILS SPACED EVERY 6", STAGGERED FROM SIDE TO SIDE. MAINTAIN A 1.5" EDGE DIST. FROM THE SIDES AND A 3.5" EDGE DIST. FROM THE ENDS OF THE COLUMN.

ALL EXTERIOR WALL STUDS TO BE 2x4 #2SPF SPACED 16" O.C. - UNLESS OTHERWISE NOTED.
ALL INTERIOR WALL STUDS TO BE 2x4 #2SPF SPACED 24" O.C. - UNLESS OTHERWISE NOTED
SEE FRAMING DETAILS PAGE 4A or 3A FOR:
- FRAMING NOTES.
- GRADE AND SPECIES OF LUMBER NOT SPECIFIED ON PLANS
- FRAMING DETAILS NOT SHOWN ON PLANS
- FRAMER'S MATERIAL LENGTH USAGE GUIDE

3/0x5/0 WINDOWS SHOWN IN BEDROOMS FOR EGRESS REQ. - EXCEPT NC. SEE BLDR FOR ACTUAL SIZE PROVIDED BY MANF.
ALL LVL's TO BE 1.8E 2800fb MIN. - UNLESS OTHERWISE NOTED.
ALL PSL's TO BE 1.8E 2500fb MIN. - UNLESS OTHERWISE NOTED.
ALL BEARING WALL HEADERS TO BE MIN. #2SYP.

BWL # — BRACED WALL LINE
(#) BRACED WALL PANEL - LENGTH PER SPREADSHEET

COLLINWOOD

REVISIONS

04

H:\Plans_DY\WintSalm\DYOL-WS\WS106-\Floor2 1-17-13 11:28 am