DENR/DEH

ON-SITE WASTEWATER SECTION

Sheet 1 of 1
PROPERTY ID #: 4886853109 4
COUNTY: Iredell

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: Retha Gaither
ADDRESS: 204 Sheffield Rd.
PROPOSED FACILITY: SFD
PROPOSED DESIGN FLOW (.1949): 240gpd
LOCATION OF SITE: 204 Sheffield Rd.
WATER SUPPLY: • (Private) • Public • Well • Spring • Other N/A
EVALUATION METHOD: • (Auger Boring) • Pit • Cut
TYPE OF WASTEWATER: • (Sewage) • Industrial Process • Mixed

APPLICATION DATE 6-5-15
DATE EVALUATED: 6-10-15
PROPERTY SIZE: 8.165 acres
PROPERTY RECORDED: Yes

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	9% Slight HS	0-9	SCL SBK	Fr Mod SE	>48"	>48"	>48"	~~38"~~ 38" PL	PS 0.25
		9-20	C Y/B Mottles ABK	Fr Mod SE					
		20-32	BC ABK	Fr Mod SE					
		32-48	BC Sap Irel WSBK	Fr Mod SE					
			38" PLaty						
2	5% L	0-9	SCL SBK	Fr Mod SE	>48"	>48"	>48"	>48"	PS 0.25
		9-24	C ABK	Fr Mod SE					
		24-48	BC Sap Irel WSBK	Fr Mod SE					
3									
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		PS
System Type(s)		III
Site LTAR		0.25

OTHER FACTORS (.1946): N/A
SITE CLASSIFICATION (.1948): PS
EVALUATED BY: Jack Henderson
OTHER(S) PRESENT: N/A

COMMENTS:

TBC @ 36"

LEGEND

use the following standard abbreviations

LANDSCAPE POSITION	GROUP	SOIL TEXTURE	CONVENTIONAL .1955 LTAR*	LPP .1957 LTAR*	MINERALOGY/ CONSISTENCE	STRUCTURE
CC (Concave Slope)	I	S (Sand)	1.2 - 0.8	0.6 - 0.4	NEXP (Non-expansive)	G (Single Grain)
CV (Convex Slope)		LS (Loamy Sand)			SEXP (Slightly Expansive)	M (Massive)
D (Drainage Way)					EXP (Expansive)	CR (Crumb)
DS (Debris Slump)	II	SL (Sandy Loam)	0.8 - 0.6	0.4 - 0.3		GR (Granular)
FP (Flood Plain)		L (Loam)				SBK (Subangular Blocky)
FS (Foot Slope)						ABK (Angular Blocky)
H (Head Slope)	III	Si (Silt)	0.6 - 0.3	0.3 - 0.15		PL (Platy)
L (Linear Slope)		SiCL (Silty Clay Loam)				PR (Prismatic)
N (Nose Slope)		CL (Clay Loam)				
R (Ridge)		SCL (Sandy Clay Loam)			MOIST	WET
S (Shoulder Slope)		SiL (Silt Loam)				
T (Terrace)					VFR (Very Friable)	NS (Non-sticky)
	IV	SC (Sandy Clay)	0.4 - 0.1	0.2 - 0.05	FR (Friable)	SS (Slightly Sticky)
		SiC (Silty Clay)			FI (Firm)	S (Sticky)
		C (Clay)			VFI (Very Firm v. Very Sticky)	VS (Very Sticky)
		O (Organic)	None	None	EFI (Extremely Firm)	NP (Non-plastic)
						SP (Slightly Plastic)
						P (Plastic)
						VP (Very Plastic)

*Adjust LTAR due to depth, consistence, structure, soil wetness, landscape, position, wastewater flow and quality.

NOTES

HORIZON DEPTH — In inches below natural soil surface

DEPTH OF FILL — In inches from land surface

RESTRICTIVE HORIZON — Thickness and depth from land surface

SAPROLITE — S(suitable) or U(unsuitable)


SOIL WETNESS — Inches from land surface to free water or inches from land surface to soil colors with chroma 2 or less - record Munsell color chip designation

CLASSIFICATION — S (Suitable), PS (Provisionally Suitable), or U (Unsuitable)

Evaluation of saprolite shall be by pits.

Long-term Acceptance Rate (LTAR): ~~gal/day/ft²~~ DC-VE

Show profile locations and other site features (dimensions, reference or benchmark, and North).

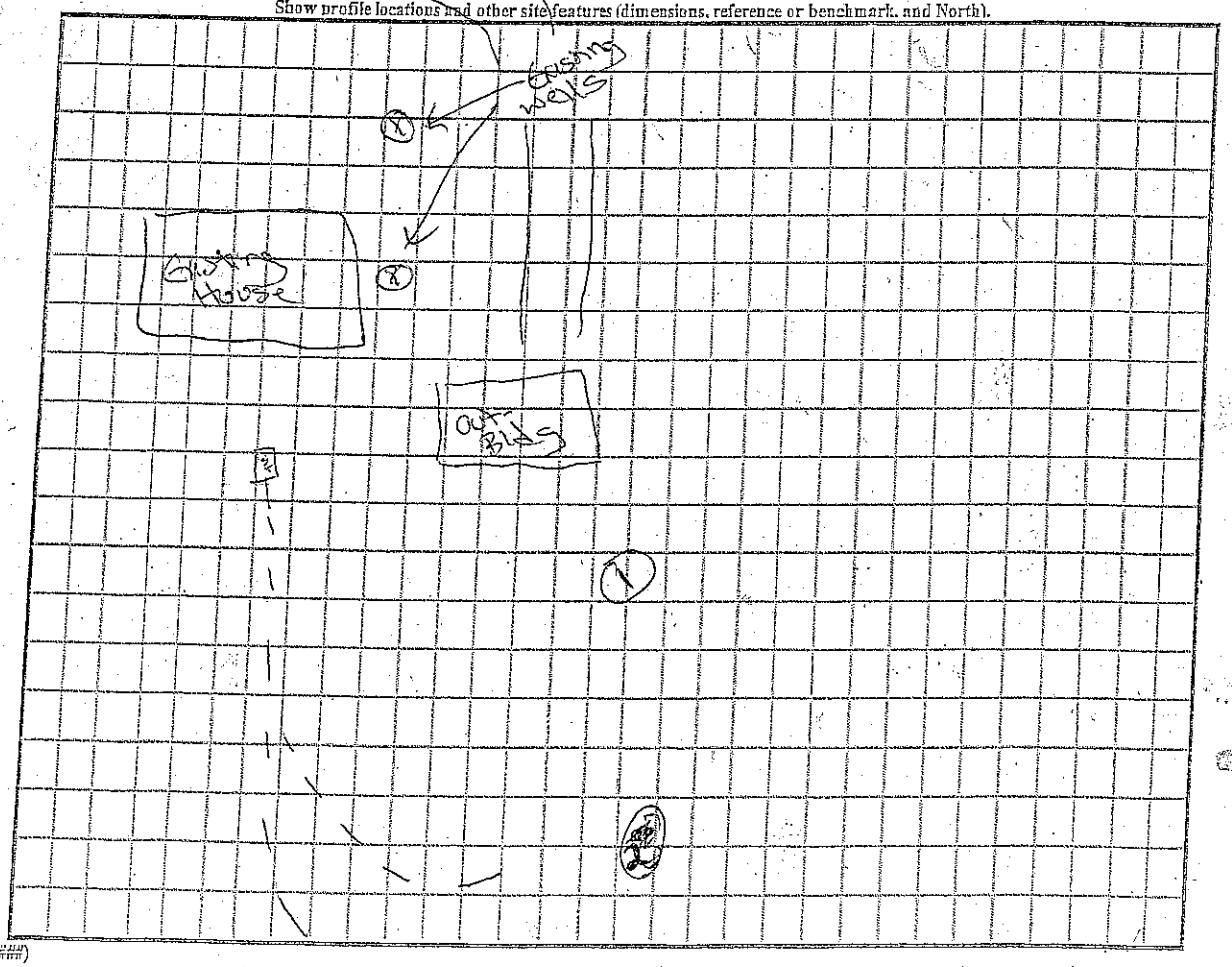

DENR (_____)
Review (_____)

** Plumb washing machine into septic tank

TRENCH BOTTOMS @ 36"

