
* 217 SKYVIEW LAKE RD.

PUMP TANK DESIGN

ATTACHMENT TO PROPERTY DESCRIPTION # REPAIR

TAX MAP # 4880-72-0340

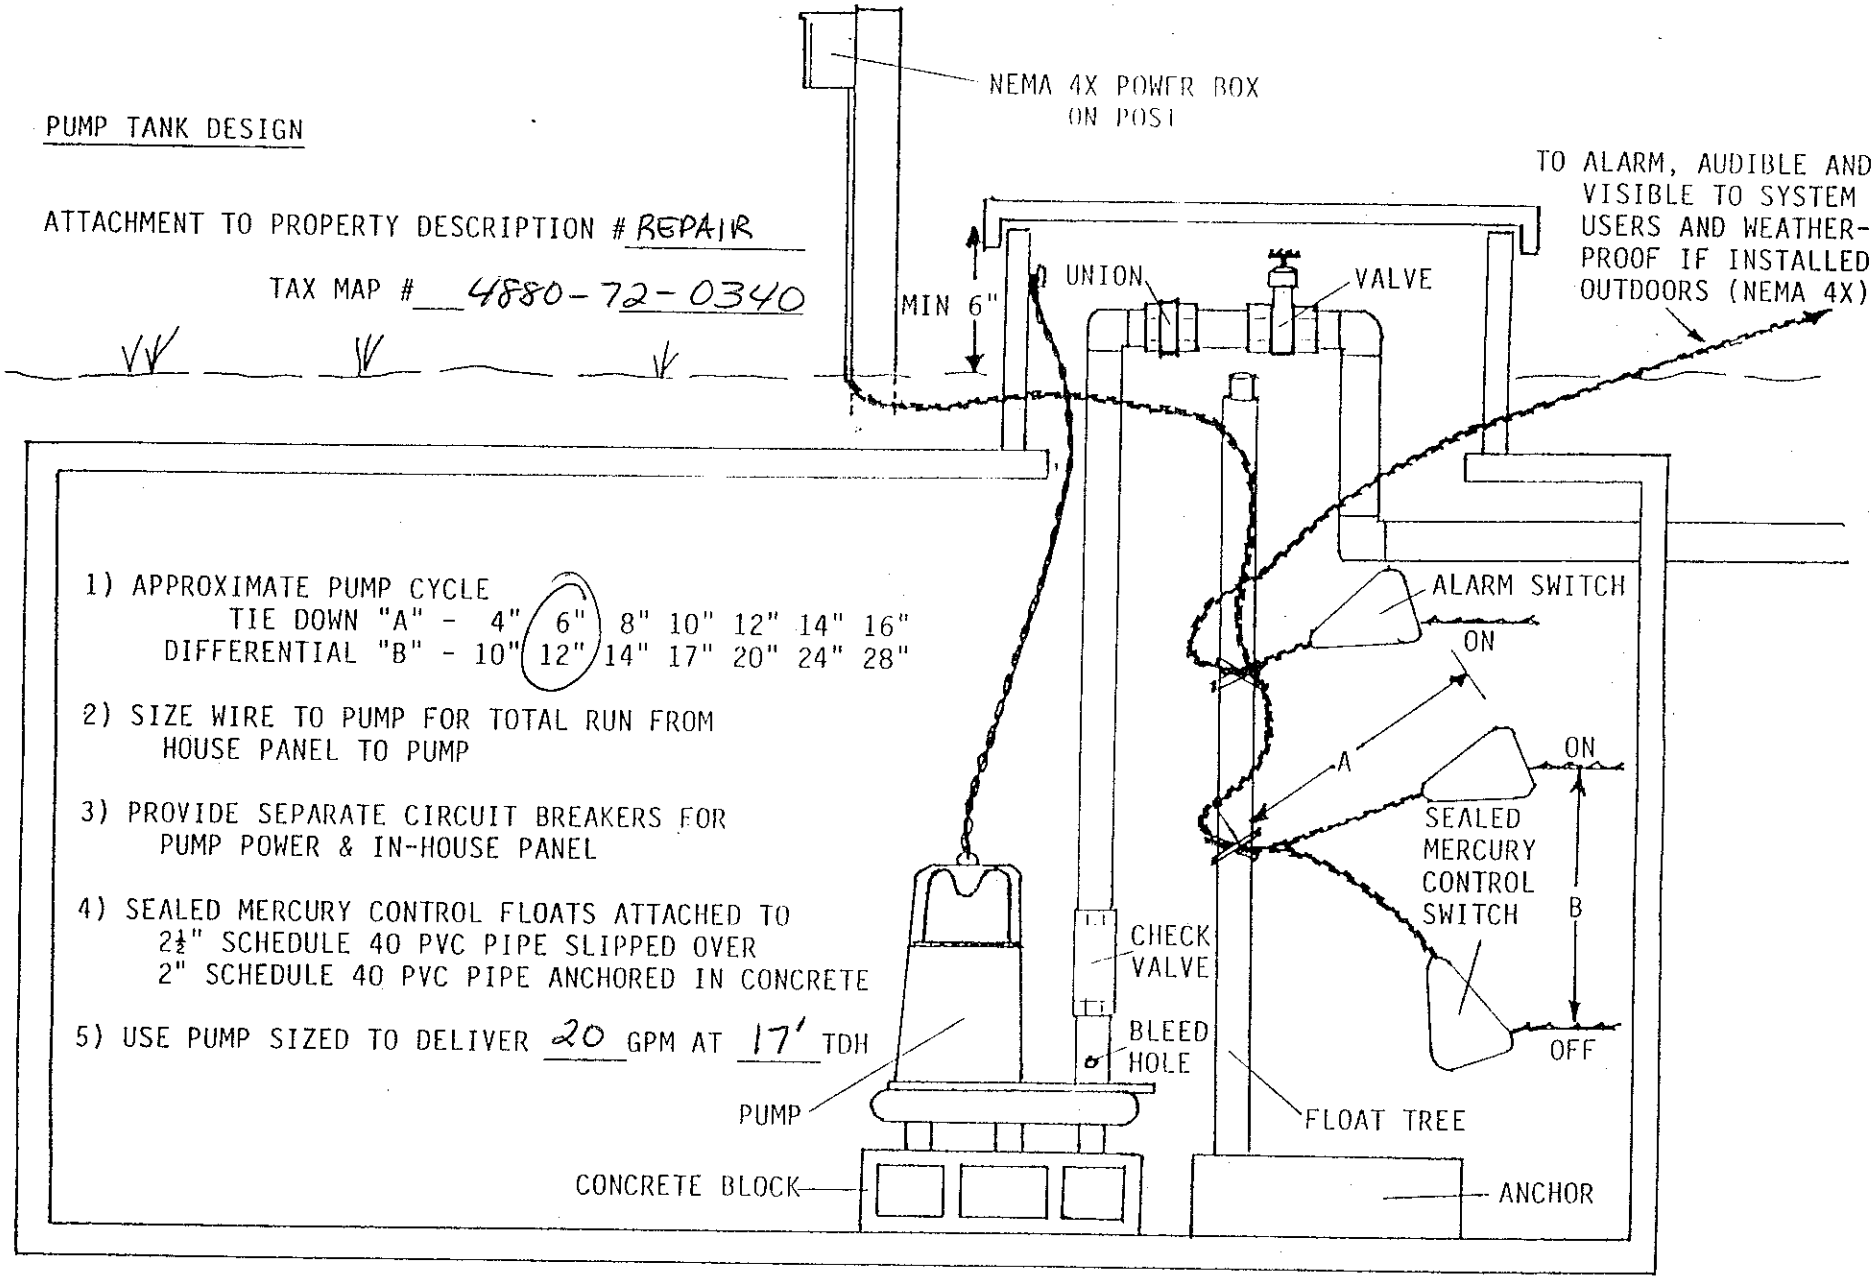

1) APPROXIMATE PUMP CYCLE
   TIE DOWN "A" - 4" (6") 8" 10" 12" 14" 16"
   DIFFERENTIAL "B" - 10" (12") 14" 17" 20" 24" 28"


2) SIZE WIRE TO PUMP FOR TOTAL RUN FROM HOUSE PANEL TO PUMP

3) PROVIDE SEPARATE CIRCUIT BREAKERS FOR PUMP POWER & IN-HOUSE PANEL

4) SEALED MERCURY CONTROL FLOATS ATTACHED TO 2½" SCHEDULE 40 PVC PIPE SLIPPED OVER 2" SCHEDULE 40 PVC PIPE ANCHORED IN CONCRETE

5) USE PUMP SIZED TO DELIVER 20 GPM AT 17' TDH

*217 SKYVIEW LAKE RD. 4880-72-0340

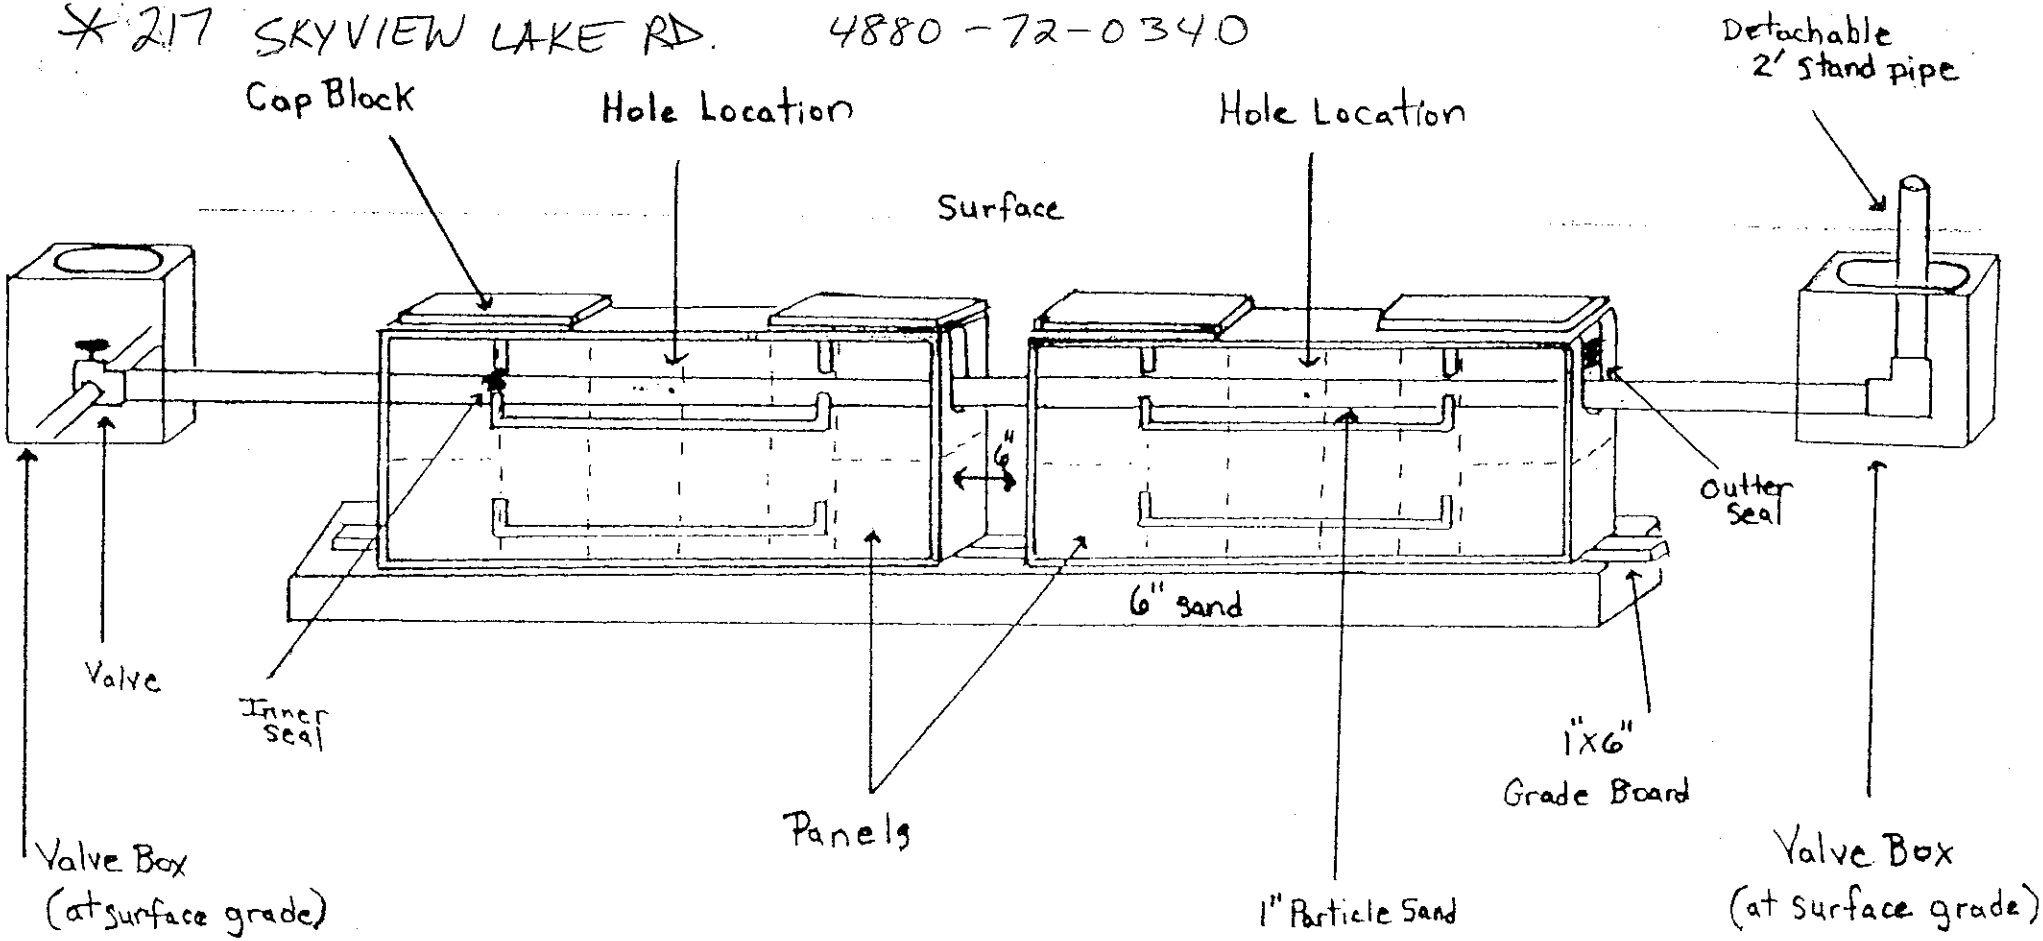

Pressure Dosed PPBPS

# of panels 34.
Size holes 3/16". 1 hole per panel.
Approximate amount of sand needed 25 TONS.
100lbs. of partical sand per 8 panels.
Sidewalls raked and limed.
GPM 20.
TDH 17'.

Comments