...m/m/mod/lh/A53543/index.cpc?strict;scale=fitheight;controls=all,!view;page=1]

APPROVED BY

NIH INC


DAVID J. BARTS

FEB 23 2007

*NOTE: SEE COLUMN CHARTS FOR REQUIREMENTS

22½"x30½" ATTIC ACCESS REQUIRED WHEN CLEAR HGT. OF ATTIC IS 30" OR GREATER.

SERVICE PANEL MAY BE LOCATED IN GARAGE

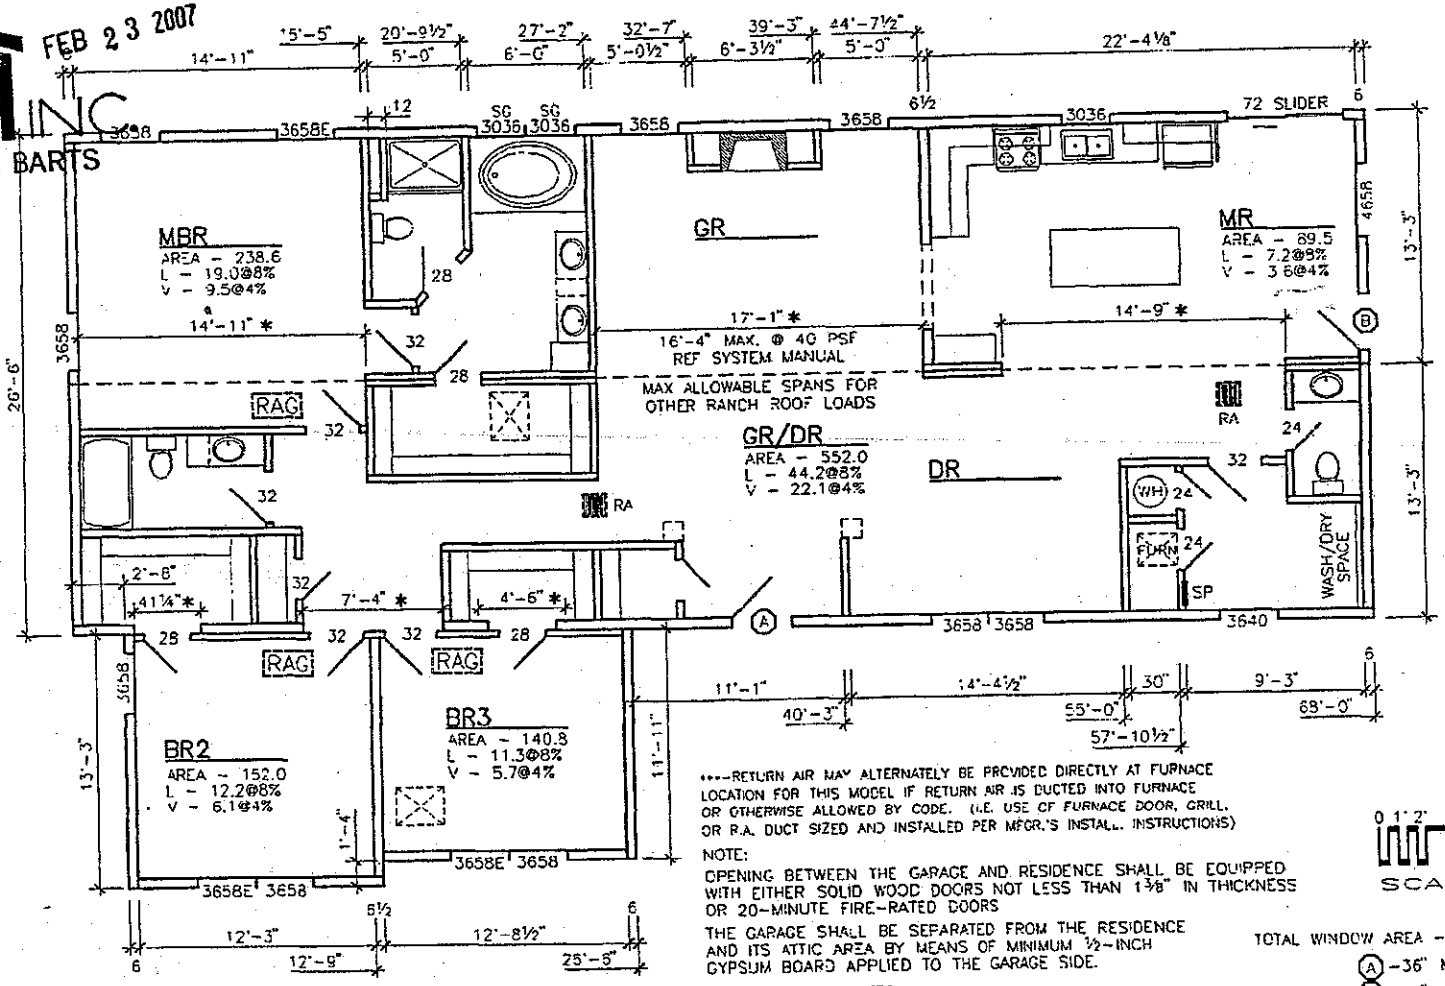

***-RETURN AIR MAY ALTERNATELY BE PROVIDED DIRECTLY AT FURNACE LOCATION FOR THIS MODEL IF RETURN AIR IS DUCTED INTO FURNACE OR OTHERWISE ALLOWED BY CODE. (I.E. USE OF FURNACE DOOR, GRILL, OR R.A. DUCT SIZED AND INSTALLED PER MFGR.'S INSTALL. INSTRUCTIONS)

NOTE:
OPENING BETWEEN THE GARAGE AND RESIDENCE SHALL BE EQUIPPED WITH EITHER SOLID WOOD DOORS NOT LESS THAN 1⅜" IN THICKNESS OR 20-MINUTE FIRE-RATED DOORS

THE GARAGE SHALL BE SEPARATED FROM THE RESIDENCE AND ITS ATTIC AREA BY MEANS OF MINIMUM ½-INCH GYPSUM BOARD APPLIED TO THE GARAGE SIDE.

SCALE BAR 0 1' 2' 5' 10'

TOTAL WINDOW AREA - 265.03 SQ. FT.

(A) -36" MIN. DOOR WIDTH

(B) -32" MIN. DOOR WIDTH

THIRD PARTY LABEL - KITCHEN SINK BASE CABINET DOOR

DATA PLATE LOCATION - KITCHEN SINK BASE CABINET DOOR

STATE LABEL LOCATION - KITCHEN SINK BASE CABINET DOOR

SECONDARY STATE LABEL AND/OR 3RD PARTY LABEL LOCATION-BR2 CLOSET/BR3(BEHIND DR)

NOTE: FOR HVAC NOTES, SPECS, DIMS., ETC., SEE PERIMETER HEAT DUCT PLAN

OFF-FRAME MODELS:
HVAC SYSTEMS TO BE SUPPLIED, INSTALLED, AND INSPECTED ON STE BY OTHERS.

EXT. WALL SPANS REF: 84-10-0010 & 20 OF SYSTEMS MANUAL
CENTER WALL SPANS REF: 85-10-0010 OF SYSTEMS MANUAL

ALL EXTERIOR OPTIONS SUCH AS DORMERS, BOX BAYS, ETC., MAY VARY PER HOME. SEE SYSTEMS MANUAL FOR CONST. SPECS.

THE INFORMATION ON THIS PAGE IS PROPRIETARY

△		JRD	4 AUG 04	SUBMITTAL PLAN		M5R68-NL1	1
				DESCRIPTION	SECTION	DWG NO	PAGE OF

LIBERTY HOMES, INC. A Subsidiary of Thor Industries, Inc. P.O. BOX 351 GOSHEN, NI 46526

Plans Submitted ONLY
Jeff Bullard Date 4-17-07
Steve Haddock Date 5-16-07